



Energy Use in State Facilities

Fiscal Year 2024 Report

Final Report – June 18, 2025

Facilities include:

- Universities of Wisconsin
- Department of Administration
- Department of Corrections
- Department of Health Services
- Department of Veterans Affairs
- Department of Public Instruction
- Department of Natural Resources
- Department of Transportation

Wisconsin Office of Energy Innovation

Energy Use in State-Owned Facilities

**Universities of Wisconsin
Department of Administration
Department of Corrections
Department of Health Services
Department of Public Instruction
Department of Veterans Affairs
Department of Natural Resources
Department of Transportation**

Report for Fiscal Year 2024

June 18, 2025

Acknowledgements

This report was prepared for the Wisconsin Office of Energy Innovation with supporting documentation provided by the following agencies:

Universities of Wisconsin
Department of Administration
Department of Corrections
Department of Health Services
Department of Public Instruction
Department of Veterans Affairs
Department of Natural Resources
Department of Transportation

Agency and facility energy coordinators deserve special mention not only for supplying needed data, but more importantly, for being personally involved in the energy conservation programs that have achieved the results documented on the following pages.

This material is based upon work supported by the U.S. Department of Energy's Office of Energy Efficiency and Renewable Energy (EERE) under the State Energy Program Award Number DE-EE0008669.

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

Energy information was compiled, and report prepared, by Innovative Business Engineering, McFarland, Wisconsin.

Table of Contents

Executive Summary	4
Introduction	5
Statewide Energy Use Summary	6
Agency Energy Use Summaries	10
Universities of Wisconsin (UWS).....	10
Department of Administration (DOA)	40
Department of Corrections (DOC)	62
Department of Health Services (DHS)	85
Department of Public Instruction (DPI)	94
Department of Veterans Affairs (DVA)	100
Department of Natural Resources (DNR)	104
Department of Transportation (DOT)	112
Department of Military Affairs (DMA) Energy Expenditures.....	122
State Fair Park (SFP) Energy Expenditures	123
State Historical Society (SHS) Energy Expenditures.....	124
Benchmarking, Tracking and Managing Energy Use	125
Facilities Energy Use Performance & Benchmarks	129
Appendix A - Weather Adjustments and Degree Days	132
Appendix B - Degree Days Data for Wisconsin First Order Weather Stations	135
Appendix C - Historical Statewide Consumption Data	138
Appendix D - Facility and Building Data/Cost Reports	140

Executive Summary

Wisconsin's efforts to reduce energy consumption and costs in state-owned facilities began because of the rapid energy cost increases following the first foreign oil embargo in 1973. Energy conservation and energy management efforts have received continued support from the Governor, the State Building Commission, and the Wisconsin Legislature. The rate of annual energy use in state facilities has been reduced 41.96 percent since 1973.

This report refers to Fiscal Year 2005 (FY2005 or FY05) as a baseline comparison year and adjusted for weather to reflect renewed energy conservation efforts as part of the Wisconsin Act 141 and the Energy Bond Fund Program. The FY2024 rate of annual energy use in state facilities was 23.37 percent less than FY2005 baseline when adjusted for weather:

Agency	Agency Name	FY05 Base Btu/GSF/Yr	FY24 Weather Adjusted Btu/GSF/Yr	FY24 % Change from FY05 Base
UW	Universities of Wisconsin	206,711	152,474	-26.24%
DOA	Department of Administration	157,840	125,542	-20.46%
DOC	Department of Corrections	178,132	155,408	-12.76%
DHS	Department of Health Services	204,184	170,580	-16.46%
DPI	Department of Public Instruction	98,001	91,147	-6.99%
DVA	Department of Veterans Affairs	197,411	216,709	9.78%
DNR	Department of Natural Resources	111,053	85,981	-22.58%
DOT	Department of Transportation	106,355	71,599	-32.68%
State	Above Statewide Totals	198,390	152,017	-23.37%

The success of the state's energy and fuel management efforts are directly dependent on the efforts of the people who operate and maintain the central plants and distribution systems, as well as those managers and occupants of individual buildings. The Wisconsin State Energy Office and Department of Administration have lead roles in developing and overseeing these efforts. *Note that the second half of FY21 energy use was affected by Covid-19 shutdowns and unoccupied facilities with increased in FY23 and FY24 as building operations and occupancy returned to pre-Covid levels.*

ENERGY EXPENDITURES INCREASE DESPITE CONSERVATION EFFORTS

Energy expenditures in Wisconsin State Government facilities totaled \$219 million in FY2024 compared to \$279 million in FY2023, including sewer and water utilities. This total includes all buildings (not just those represented in this report) and includes expenditures for electricity, natural gas, solid fuels, sewer, water, propane and fuel oil. The FY2024 energy expenditures represented a 21 percent decrease over FY2023 with a 50% decrease in total natural gas expenditures. In addition, FY2024 electrical energy unit costs (\$/kwh) increased by 5 percent while unit thermal energy costs (\$/MMBtu) decreased by 40 percent in FY24 compared to FY23.

The Energy Use in State Facilities Reports are updated from time-to-time to reflect updated utility data, accounting data and state agency building information/area (Gross Square Feet) input. Please refer to <https://psc.wi.gov/Pages/ServiceType/OEI/WisconsinEnergyStatistics.aspx> for the latest and updated Energy Use in State Facilities Reports.

Introduction

BACKGROUND

This report presents total energy consumption for the largest State of Wisconsin owned and operated major institutions and facilities. These facilities account for the majority of energy consumed in buildings owned by the State of Wisconsin. Statewide, agency, and individual facility energy consumption totals are presented. Values for each agency reflect buildings owned but not necessarily occupied by that agency. Agencies addressed in this report include the following: Department of Public Instruction (DPI), Universities of Wisconsin (UWS), Department of Health Services (DHS), Department of Corrections (DOC), Department of Veterans Affairs (DVA), Department of Administration (DOA), Department of Natural Resources (DNR) and Department of Transportation (DOT).

Providing detailed facility level data proved to be a challenge. In many cases, accounting systems did not readily lend themselves to compiling the required data. The State Energy Office will continue to work to expand the detail and completeness of future reports. Buildings not included in this report are thousands of other smaller facilities ranging from military armories, utility buildings, comfort stations to park offices and farm buildings.

ENERGY USE MEASUREMENT

Two common ways to account for energy use are end-use energy consumption and resource energy consumption. End-use consumption refers to the energy content of fuel, steam, or electricity at the point of use by the consumer. Resource energy consumption is equal to end-use consumption plus all energy used in the production and transportation of fuel, steam, or electricity. This report is based on end-use energy consumption to coincide with reports from other sources.

State-owned facilities' monitored energy consumption is broken down into two categories:

- 1) **Electricity**, which represents total purchased and central plant co-generated electricity; and
- 2) **Thermal or Fossil Fuel**, which includes coal, natural gas, oil, purchased steam and renewable wood/paper fuel pellets used in central plants or in building boilers to generate steam and other resources such as hot water, chilled water, electricity, and compressed air.

Energy consumption in these categories is monitored through the coordination of monthly utilities billings and fuel consumption reports.

All forms of energy consumption are converted to units of Btu/GSF/year. The conversion also removes any variation in energy use over time caused by changes in the size of an individual institution or facility. Electricity consumption is converted from metered kWh to Btu/GSF/Year by multiplying the total fiscal year metered kWh of electricity by 3,413 (Btu/kwh standard conversion factor) and then dividing the resulting number by the gross square footage (GSF) of serviced building area. Fossil fuel energy use is converted to units of Btu/GSF/Year by dividing the Btu value of the fossil fuel thermal energy consumption by the gross square footage of serviced building area.

WEATHER FACTORS AFFECTING ENERGY USE

Weather has a significant impact upon facility energy consumption and should be considered when evaluating efficiencies. Annual heating and cooling degree days can change dramatically from location to location and year to year. Such changes can significantly affect the demand for heating and cooling systems of a facility. Appendix A and Appendix B present weather adjustments and degree days for selected Wisconsin locations.

Statewide Energy Use Summary



SCOPE

Includes the major facilities in eight state agencies. Agencies and facilities are discussed individually in this report.

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 23.4 percent decrease

Includes the major facilities in eight state agencies. Agencies and facilities are discussed individually in this report.

Latest Year Change - Weather Adjusted: 0.9 percent decrease

Energy use (BTU/GSF/Yr) for FY24 decrease 0.9 percent from the previous fiscal year, FY24.

Average Annual Change - Weather Adjusted: 1.2 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 1.2 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: 16.4 percent increase.



Gross square footage (GSF) has increased 16.4% from the base fiscal year, FY05.

Consumption Change from Base: 19.3 percent decrease.

Total consumption was 19.3 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 13.1 percent less than in the base year when adjusted for weather compared to FY05.


State of Wisconsin Totals

Subcategory Name	FY2020	FY2021	FY2022	FY2023	FY2024
Electricity	\$ 98,471,311	\$ 98,196,226	\$ 100,181,485	\$ 112,650,446	\$ 116,423,359
Coal	\$ 4,248,393	\$ 684,237	\$ 1,288,572	\$ 294,627	\$ 1,484
Natural Gas	\$ 46,397,008	\$ 72,698,517	\$ 96,565,762	\$ 129,256,803	\$ 64,183,350
Fuel Oil	\$ 276,176	\$ 4,703,740	\$ 496,520	\$ 2,238,581	\$ 1,034,901
Other Fuels	\$ 1,085,885	\$ 899,878	\$ 1,486,210	\$ 1,461,001	\$ 1,414,810
Steam/Heat	\$ 2,174,515	\$ 2,190,633	\$ 2,138,168	\$ 2,615,667	\$ 2,631,463
Chilled Water	\$ 93,703	\$ 59,721	\$ 69,047	\$ 89,711	\$ 128,361
Water & Sewage	\$ 29,191,079	\$ 25,451,081	\$ 27,800,075	\$ 30,105,671	\$ 33,488,683
Total Utilities	\$ 181,938,070	\$ 204,884,033	\$ 230,025,839	\$ 278,712,506	\$ 219,306,410

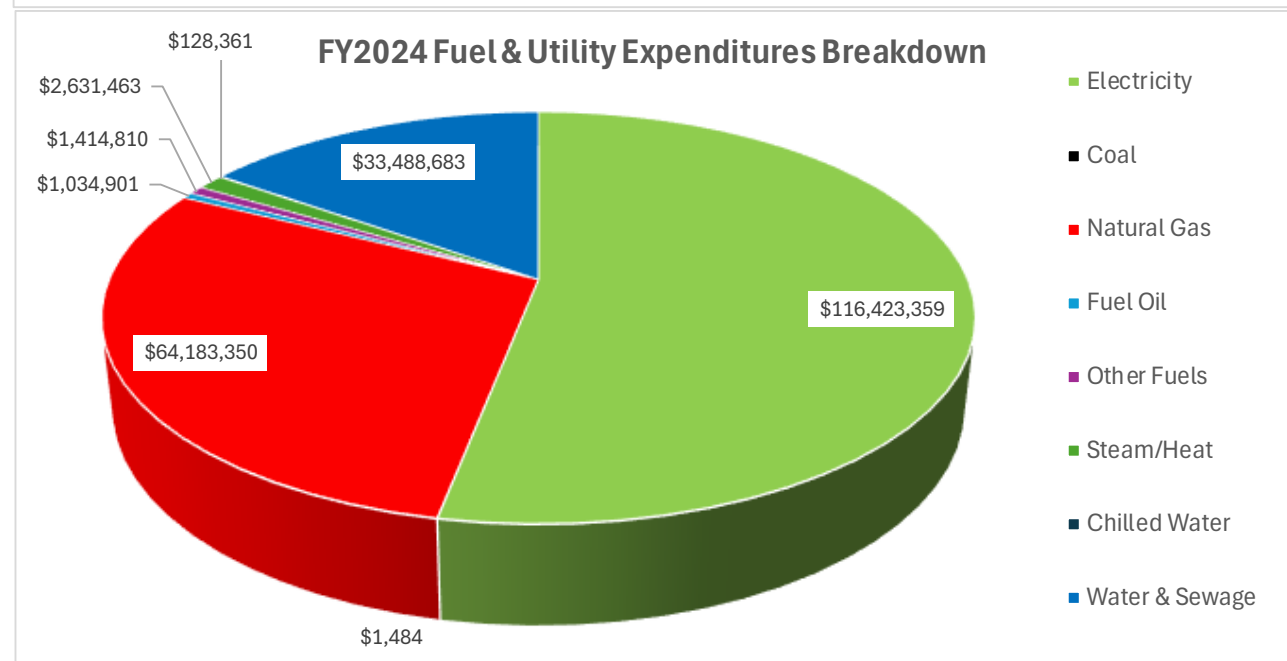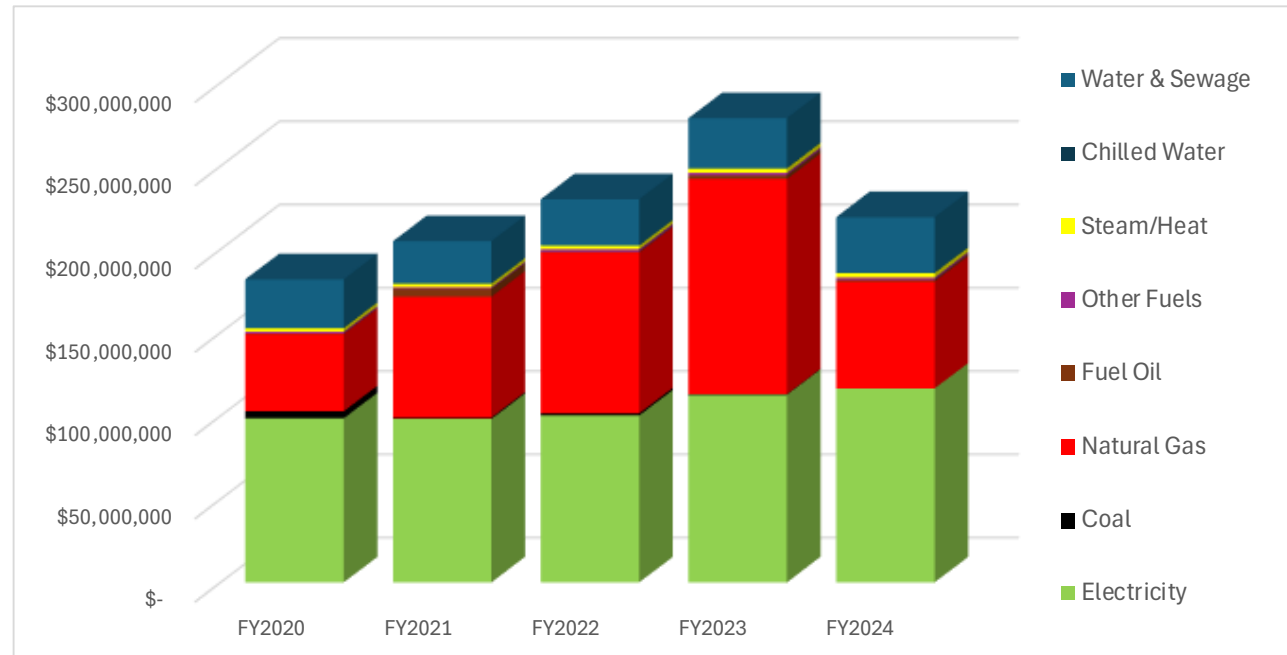

Statewide Facilities Total Fiscal Year 2024 Total State Agency Total (FY05 Base)






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	64,753,150	148,686	49,704	198,390	0.0%	47.39	100.0%	100.0%	198,390	0.0%
FY06	65,405,533	145,097	51,086	196,183	-1.1%	48.45	100.8%	99.4%	197,123	-0.6%
FY07	66,508,886	141,908	50,876	192,785	-2.8%	47.28	99.4%	99.8%	191,805	-3.3%
FY08	67,703,290	145,897	50,932	196,829	-0.8%	45.66	94.9%	99.5%	189,117	-4.7%
FY09	68,186,861	139,820	49,815	189,636	-4.4%	45.03	94.5%	100.0%	181,899	-8.3%
FY10	68,774,525	133,168	49,479	182,648	-7.9%	46.89	99.0%	100.2%	181,375	-8.6%
FY11	69,655,003	133,843	50,379	184,223	-7.1%	46.08	95.0%	99.5%	177,287	-10.6%
FY12	71,400,599	114,015	49,671	163,686	-17.5%	50.91	105.5%	98.5%	169,167	-14.7%
FY13	72,698,283	124,481	47,863	172,344	-13.1%	46.52	96.5%	99.6%	167,852	-15.4%
FY14	73,275,335	132,369	47,479	179,848	-9.3%	43.72	89.7%	99.6%	165,974	-16.3%
FY15	73,553,273	124,210	46,752	170,962	-13.8%	45.19	94.9%	100.1%	164,642	-17.0%
FY16	74,064,464	111,046	46,512	157,558	-20.6%	49.28	104.1%	99.4%	161,837	-18.4%
FY17	74,080,246	111,028	46,293	157,321	-20.7%	49.46	103.7%	98.8%	160,902	-18.9%
FY18	73,838,150	119,429	45,532	164,961	-16.9%	46.31	96.3%	99.8%	160,400	-19.1%
FY19	74,054,921	121,297	44,753	166,051	-16.3%	45.41	95.1%	100.0%	160,084	-19.3%
FY20	74,749,271	114,087	42,821	156,908	-20.9%	47.61	100.2%	99.6%	156,933	-20.9%
FY21	75,060,520	109,400	41,179	150,580	-24.1%	47.80	99.5%	98.9%	149,547	-24.6%
FY22	74,879,851	112,947	43,137	156,084	-21.3%	47.78	98.8%	98.6%	154,107	-22.3%
FY23	75,451,468	109,147	42,162	151,308	-23.7%	48.39	102.0%	99.5%	153,336	-22.7%
FY24	75,399,512	102,443	42,063	144,506	-27.2%	50.79	108.0%	98.5%	152,017	-23.4%

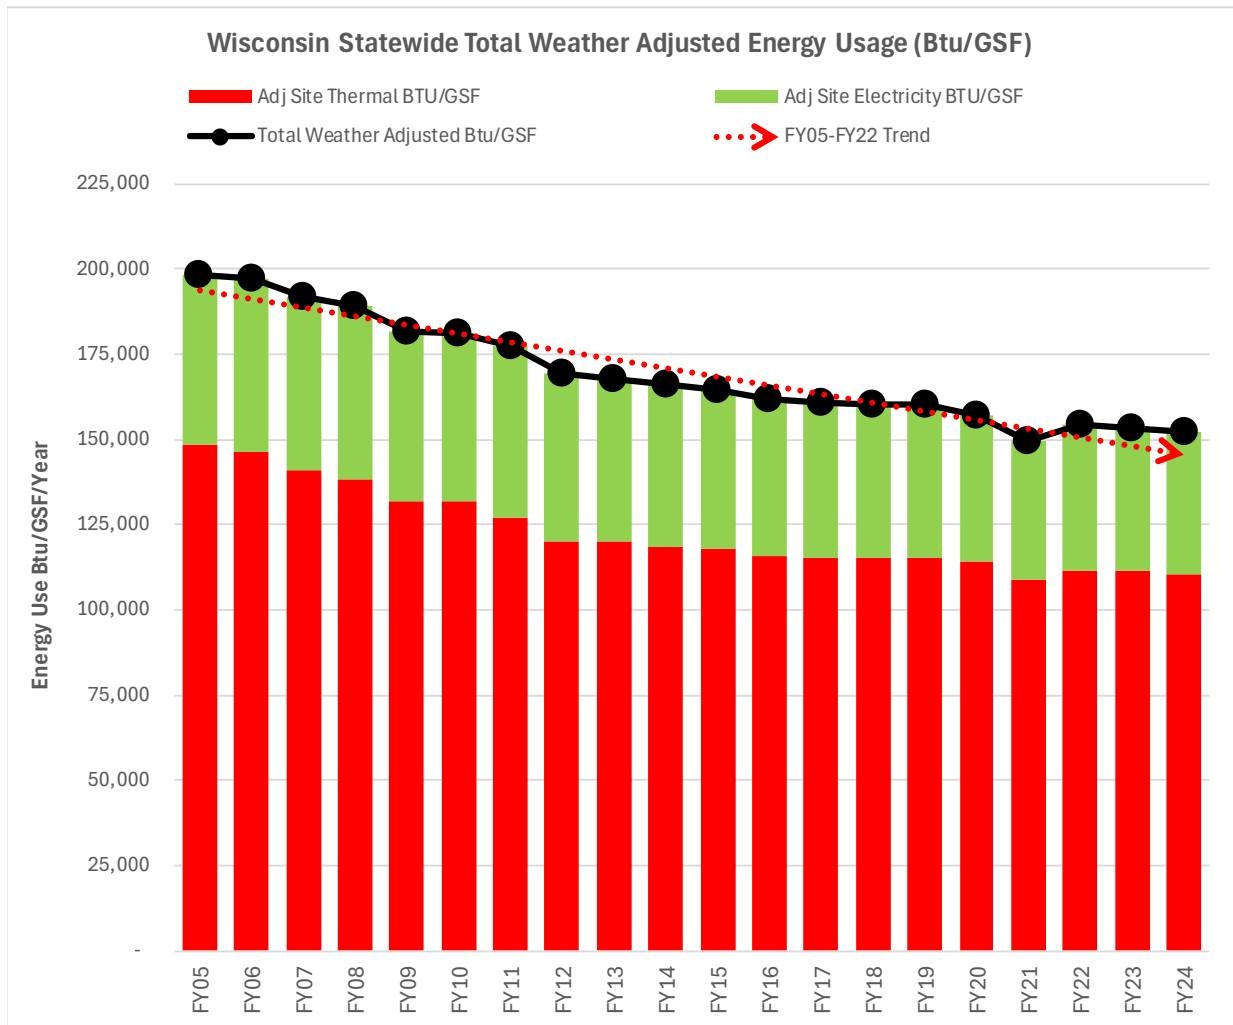

State Fiscal Year 2024 State Energy Report

FY24 Electric kwh/GSF = 12.32			FY24 Therm/GSF = 1.02			FY24 Total Btu/GSF = 144,506			05-24 Thm -25.6%	
FY24 Electric \$/GSF = \$ 1.39			FY24 Thermal \$/GSF = \$ 0.45			FY24 Energy \$/GSF = \$ 1.84			05-24 kwh -16.7%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	64,753,150	148,686	49,704	198,390	0.0%	47.39	100.0%	100.0%	198,390	0.0%
FY06	65,405,533	145,097	51,086	196,183	-1.1%	48.45	100.8%	99.4%	197,123	-0.6%
FY07	66,508,886	141,908	50,876	192,785	-2.8%	47.28	99.4%	99.8%	191,805	-3.3%
FY08	67,703,290	145,897	50,932	196,829	-0.8%	45.66	94.9%	99.5%	189,117	-4.7%
FY09	68,186,861	139,820	49,815	189,636	-4.4%	45.03	94.5%	100.0%	181,899	-8.3%
FY10	68,774,525	133,168	49,479	182,648	-7.9%	46.89	99.0%	100.2%	181,375	-8.6%
FY11	69,655,003	133,843	50,379	184,223	-7.1%	46.08	95.0%	99.5%	177,287	-10.6%
FY12	71,400,599	114,015	49,671	163,686	-17.5%	50.91	105.5%	98.5%	169,167	-14.7%
FY13	72,698,283	124,481	47,863	172,344	-13.1%	46.52	96.5%	99.6%	167,852	-15.4%
FY14	73,275,335	132,369	47,479	179,848	-9.3%	43.72	89.7%	99.6%	165,974	-16.3%
FY15	73,507,268	124,288	46,781	171,069	-13.8%	45.19	94.9%	100.1%	164,745	-17.0%
FY16	74,064,464	111,046	46,512	157,558	-20.6%	49.28	104.1%	99.4%	161,837	-18.4%
FY17	74,080,246	111,028	46,293	157,321	-20.7%	49.46	103.7%	98.8%	160,902	-18.9%
FY18	73,838,150	119,429	45,532	164,961	-16.9%	46.31	96.3%	99.8%	160,400	-19.1%
FY19	74,054,921	121,297	44,753	166,051	-16.3%	45.41	95.1%	100.0%	160,084	-19.3%
FY20	74,749,271	114,087	42,821	156,908	-20.9%	47.61	100.2%	99.6%	156,933	-20.9%
FY21	75,060,520	109,400	41,179	150,580	-24.1%	47.80	99.5%	98.9%	149,547	-24.6%
FY22	74,879,851	112,947	43,137	156,084	-21.3%	47.78	98.8%	98.6%	154,107	-22.3%
FY23	75,451,468	109,147	42,162	151,308	-23.7%	48.39	102.0%	99.5%	153,336	-22.7%
FY24	75,399,512	102,443	42,063	144,506	-27.2%	50.79	108.0%	98.5%	152,017	-23.4%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

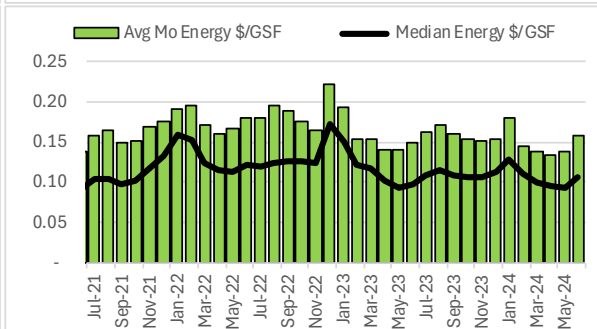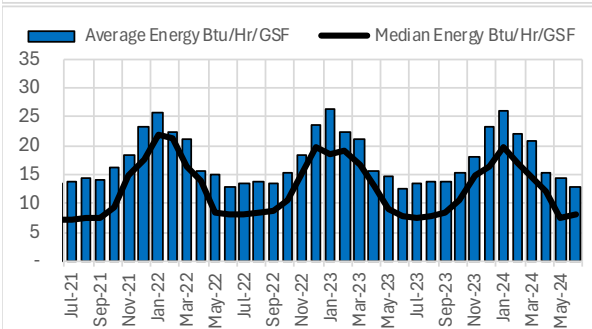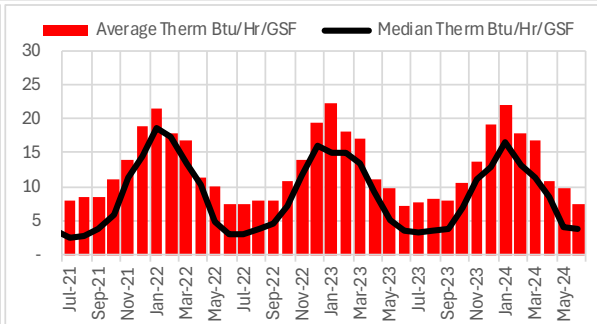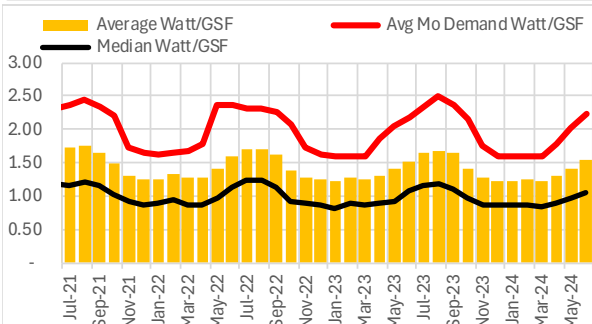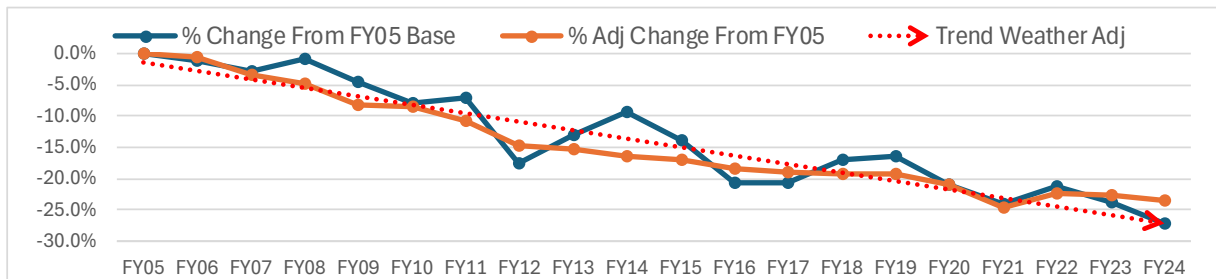

Agency Energy Use Summary



SCOPE

Includes 13-four year university campuses: UW-Eau Claire; UW-Green Bay; UW-La Crosse; UW-Madison; UW-Milwaukee; UW-Oshkosh; UW-Parkside; UW-Platteville; UW-River Falls; UW-Stevens Point; UW-Stout; UW-Superior; and UW-Whitewater.

Also, includes 13 two-year college campuses: UW-Platteville, Baraboo Sauk County; UW-Eau Claire, Barron County; UW-Oshkosh, Fond du Lac; UW-Oshkosh, Fox Cities; UW-Green Bay, Manitowoc; UW-Stevens Point, Wausau; UW-Green Bay, Marinette; UW-Stevens Point, Wausau; UW-Platteville, Richland; UW-Whitewater, Rock County; UW-Green Bay, Sheboygan; UW-Milwaukee, Washington County; and UW-Milwaukee, Waukesha. Beginning in FY24 UW-Platteville, Richland is no longer a UW campus. As a result, the FY24 energy use and GSF for UW-Richland Center were not included in State Energy and CO₂e Reports.

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 26.2 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 1 percent decrease

Energy use (BTU/GSF/Yr) for FY24 decrease 1 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 1.4 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 1.4 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: 22.6 percent increase.



Gross square footage (GSF) has increased 22.6% from the base fiscal year, FY05.

Consumption Change from Base: 19.3 percent decrease.

Total consumption was 19.3 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 13.1 percent less than in the base year when adjusted for weather compared to FY05.


University of Wisconsin System

Subcategory Name	FY2020	FY2021	FY2022	FY2023	FY2024
Electricity	\$ 64,024,188	\$ 68,187,676	\$ 67,683,837	\$ 75,223,263	\$ 77,922,102
Coal	\$ 951,408	\$ 494,049	\$ 1,227,232	\$ 185,590	\$ -
Natural Gas	\$ 14,373,188	\$ 34,801,801	\$ 30,327,856	\$ 57,790,146	\$ 27,601,448
Fuel Oil	\$ 67,154	\$ 1,837,870	\$ 118,006	\$ 829,529	\$ 358,779
Other Fuels	\$ 114,383	\$ 150,674	\$ 333,127	\$ 171,619	\$ 148,392
Steam/Heat	\$ 737,717	\$ 741,135	\$ 373,200	\$ 419,398	\$ 511,501
Chilled Water	\$ -	\$ -	\$ -	\$ -	\$ -
Water & Sewage	\$ 13,792,165	\$ 12,870,545	\$ 14,654,268	\$ 15,380,234	\$ 17,321,415
Total Utilities	\$ 94,060,202	\$ 119,083,751	\$ 114,717,525	\$ 149,999,780	\$ 123,863,637

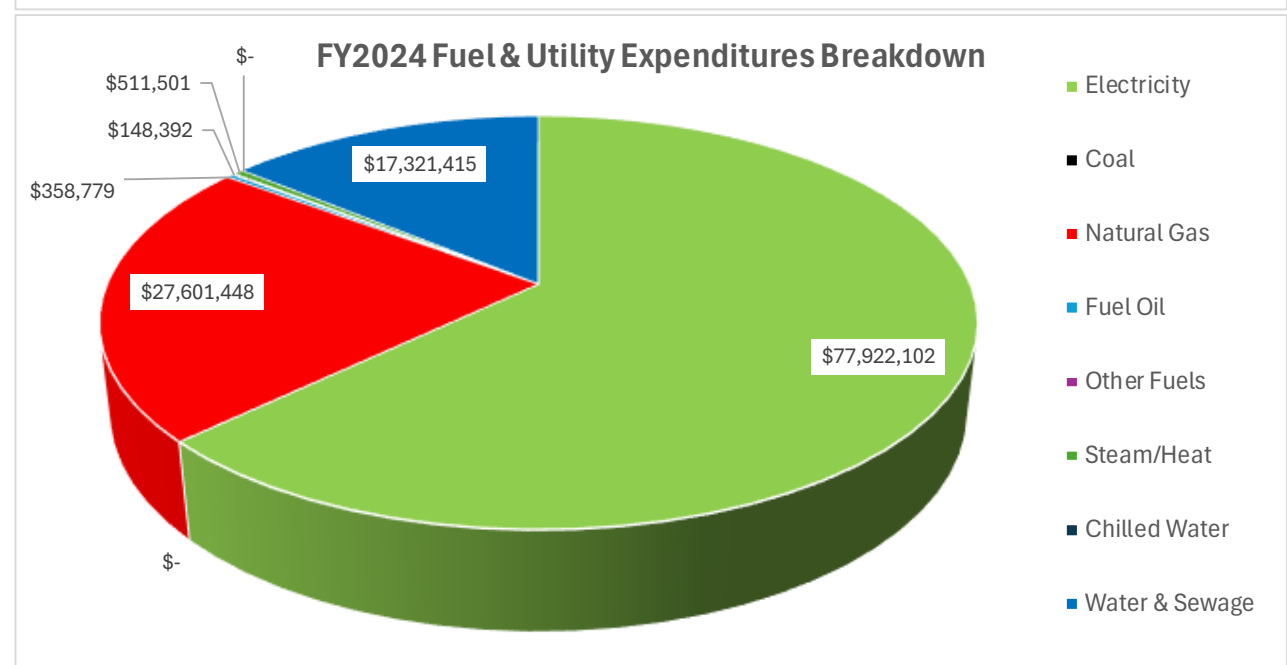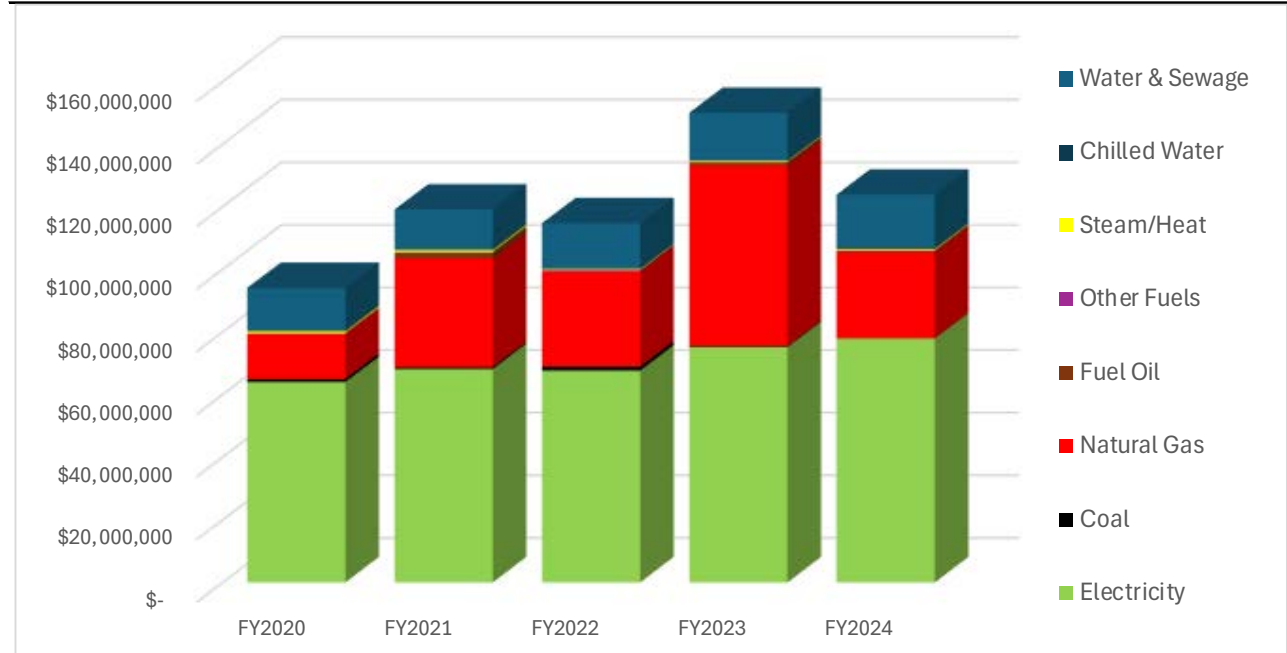

UW Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	46,655,255	155,225	51,486	206,711	0.0%	47.38	100.0%	100.0%	206,711	0.0%
FY06	47,261,328	151,762	53,242	205,004	-0.8%	48.45	100.7%	99.4%	205,773	-0.5%
FY07	48,307,694	146,908	52,866	199,775	-3.4%	47.26	99.2%	99.8%	198,535	-4.0%
FY08	49,502,098	150,890	52,653	203,543	-1.5%	45.60	94.8%	99.7%	195,569	-5.4%
FY09	50,134,229	142,932	51,396	194,328	-6.0%	45.01	94.5%	100.1%	186,605	-9.7%
FY10	50,622,897	137,478	51,538	189,017	-8.6%	46.87	98.8%	100.3%	187,563	-9.3%
FY11	51,475,349	137,050	52,528	189,578	-8.3%	46.06	94.9%	99.7%	182,414	-11.8%
FY12	53,330,388	116,087	51,548	167,635	-18.9%	50.88	105.0%	98.3%	172,539	-16.5%
FY13	54,571,090	126,536	49,422	175,958	-14.9%	46.49	96.6%	99.6%	171,422	-17.1%
FY14	55,395,590	134,034	48,750	182,784	-11.6%	43.72	89.4%	99.7%	168,469	-18.5%
FY15	55,761,596	125,607	47,986	173,593	-16.0%	45.19	94.8%	100.1%	167,140	-19.1%
FY16	56,318,792	110,783	47,608	158,391	-23.4%	49.28	104.0%	99.3%	162,499	-21.4%
FY17	56,334,574	110,831	47,398	158,228	-23.5%	49.43	103.4%	98.8%	161,424	-21.9%
FY18	56,143,320	118,948	46,677	165,625	-19.9%	46.28	96.1%	99.9%	160,978	-22.1%
FY19	56,125,576	123,240	46,234	169,474	-18.0%	45.35	95.0%	100.1%	163,347	-21.0%
FY20	56,819,926	114,992	43,900	158,892	-23.1%	47.59	100.1%	99.5%	158,848	-23.2%
FY21	57,131,175	109,253	42,298	151,551	-26.7%	47.77	99.1%	99.0%	150,190	-27.3%
FY22	56,998,506	112,765	44,673	157,438	-23.8%	47.75	98.5%	98.7%	155,173	-24.9%
FY23	57,231,497	108,380	43,679	152,059	-26.4%	48.36	102.0%	99.5%	154,002	-25.5%
FY24	57,179,541	101,352	43,774	145,127	-29.8%	50.77	108.0%	98.2%	152,474	-26.2%

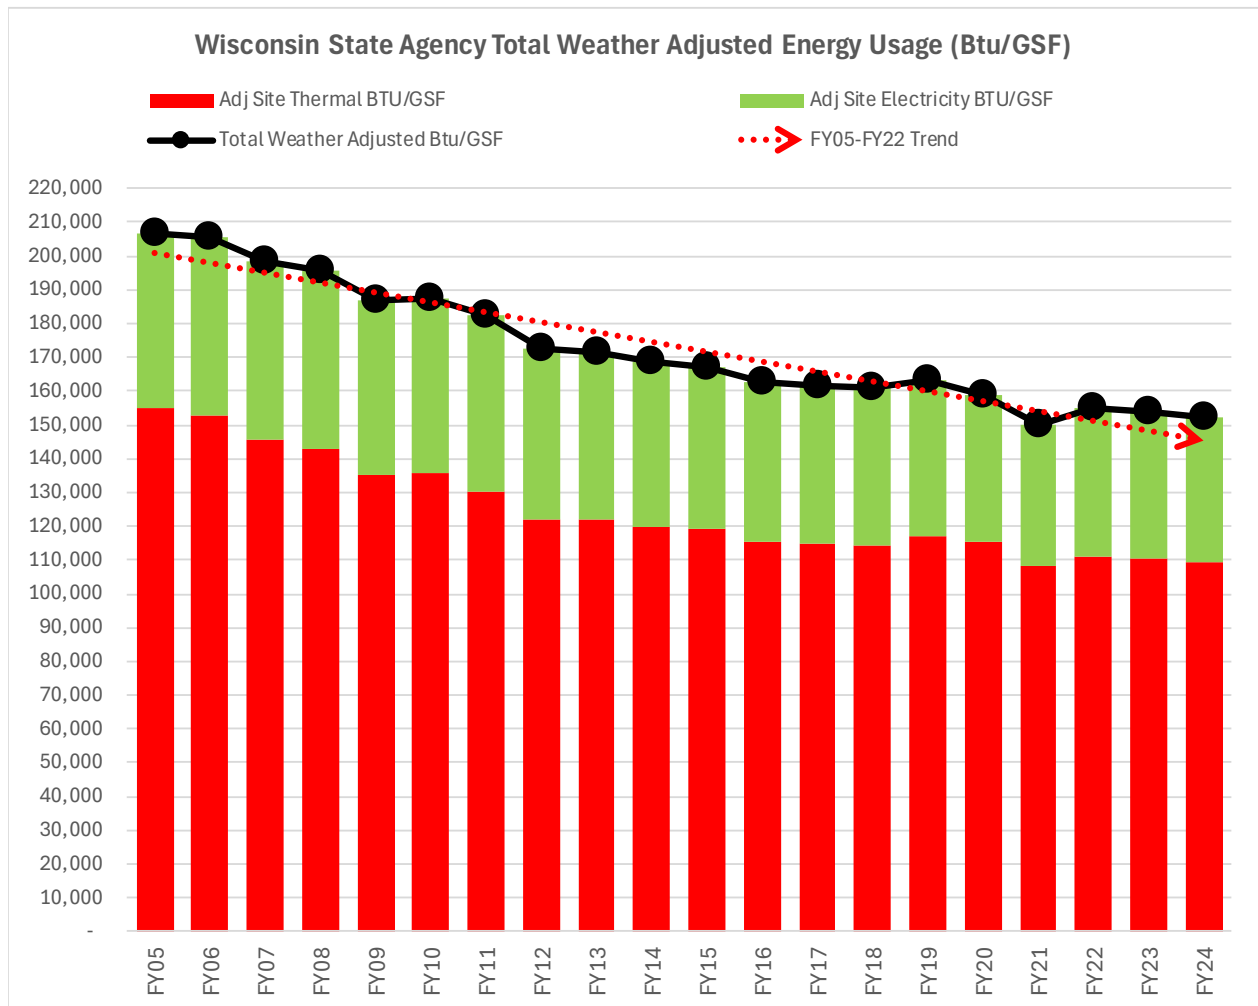

UW Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 12.83			FY24 Therm/GSF = 1.01			FY24 Total Btu/GSF = 145,127			05-24 Thm -29.5%	
FY24 Electric \$/GSF = \$ 1.45			FY24 Thermal \$/GSF = \$ 0.46			FY24 Energy \$/GSF = \$ 1.91			05-24 kwh -16.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	46,655,255	155,225	51,486	206,711	0.0%	47.38	100.0%	100.0%	206,711	0.0%
FY06	47,261,328	151,762	53,242	205,004	-0.8%	48.45	100.7%	99.4%	205,773	-0.5%
FY07	48,307,694	146,908	52,866	199,775	-3.4%	47.26	99.2%	99.8%	198,535	-4.0%
FY08	49,502,098	150,890	52,653	203,543	-1.5%	45.60	94.8%	99.7%	195,569	-5.4%
FY09	50,134,229	142,932	51,396	194,328	-6.0%	45.01	94.5%	100.1%	186,605	-9.7%
FY10	50,622,897	137,478	51,538	189,017	-8.6%	46.87	98.8%	100.3%	187,563	-9.3%
FY11	51,475,349	137,050	52,528	189,578	-8.3%	46.06	94.9%	99.7%	182,414	-11.8%
FY12	53,330,388	116,087	51,548	167,635	-18.9%	50.88	105.0%	98.3%	172,539	-16.5%
FY13	54,571,090	126,536	49,422	175,958	-14.9%	46.49	96.6%	99.6%	171,422	-17.1%
FY14	55,395,590	134,034	48,750	182,784	-11.6%	43.72	89.4%	99.7%	168,469	-18.5%
FY15	55,761,596	125,607	47,986	173,593	-16.0%	45.19	94.8%	100.1%	167,140	-19.1%
FY16	56,318,792	110,783	47,608	158,391	-23.4%	49.28	104.0%	99.3%	162,499	-21.4%
FY17	56,334,574	110,831	47,398	158,228	-23.5%	49.43	103.4%	98.8%	161,424	-21.9%
FY18	56,143,320	118,948	46,677	165,625	-19.9%	46.28	96.1%	99.9%	160,978	-22.1%
FY19	56,125,576	123,240	46,234	169,474	-18.0%	45.35	95.0%	100.1%	163,347	-21.0%
FY20	56,819,926	114,992	43,900	158,892	-23.1%	47.59	100.1%	99.5%	158,848	-23.2%
FY21	57,131,175	109,253	42,298	151,551	-26.7%	47.77	99.1%	99.0%	150,190	-27.3%
FY22	56,998,506	112,765	44,673	157,438	-23.8%	47.75	98.5%	98.7%	155,173	-24.9%
FY23	57,231,497	108,380	43,679	152,059	-26.4%	48.36	102.0%	99.5%	154,002	-25.5%
FY24	57,179,541	101,352	43,774	145,127	-29.8%	50.77	108.0%	98.2%	152,474	-26.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

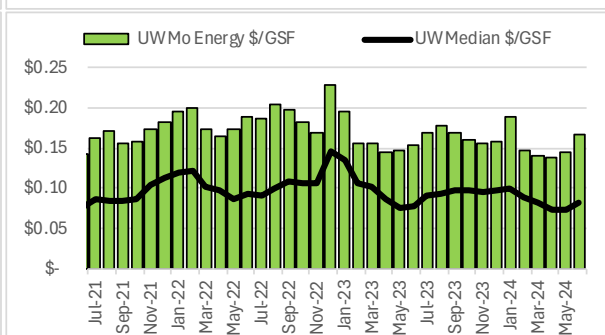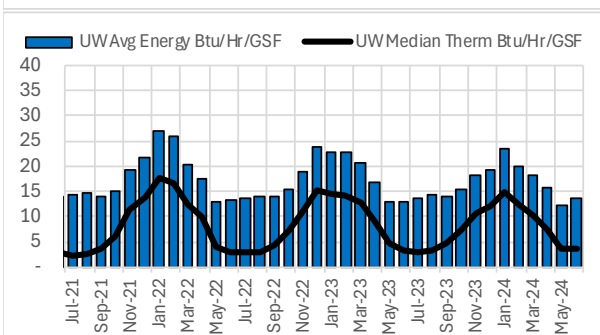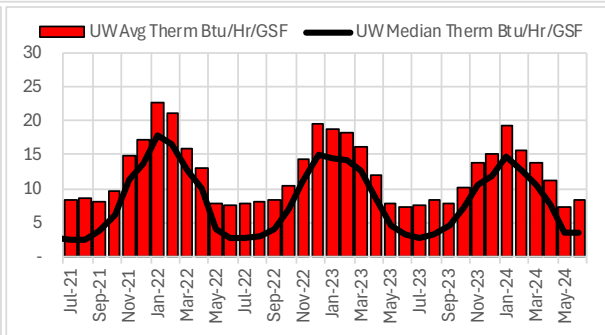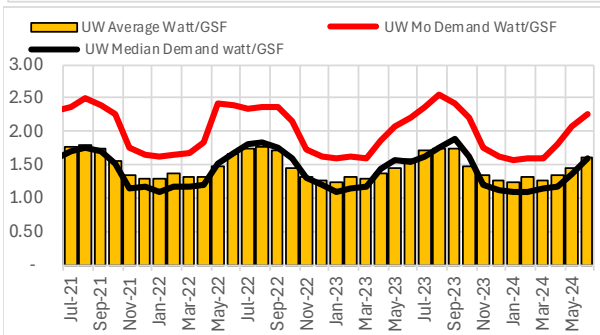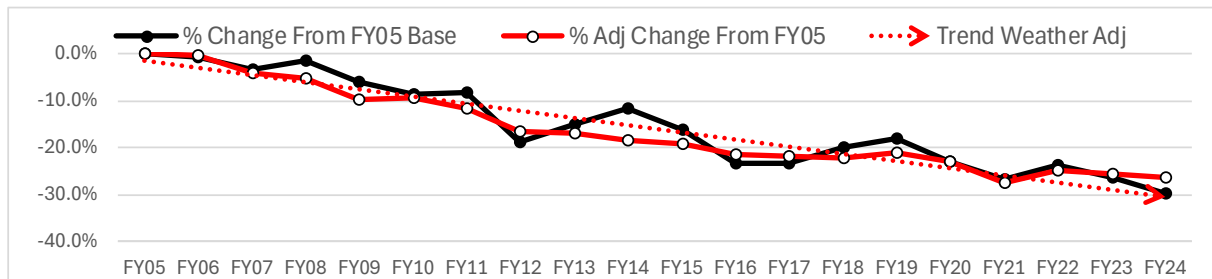

FY2024 UW-Eau Claire State Facilities Energy Report

FY24 Electric kwh/GSF= 7.79			FY24 Therm/GSF = 0.67			FY24 Total Btu/GSF= 93,947			05-24 Thm -31.2%	
FY24 Electric \$/GSF= \$ 0.77			FY24 Thermal \$/GSF= \$ 0.31			FY24 Energy \$/GSF= \$ 1.08			05-24 kwh -35.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,438,217	108,640	40,508	149,148	0.0%	45.85	100.0%	100.0%	149,148	0.0%
FY06	2,436,936	100,153	42,818	142,972	-4.1%	47.80	103.7%	99.0%	146,241	-1.9%
FY07	2,436,936	98,235	38,579	136,814	-8.3%	46.32	100.3%	99.4%	136,836	-8.3%
FY08	2,436,936	98,592	37,164	135,756	-9.0%	43.27	91.5%	99.6%	127,261	-14.7%
FY09	2,436,936	95,121	34,913	130,033	-12.8%	42.97	91.8%	100.4%	122,365	-18.0%
FY10	2,436,963	88,749	32,720	121,470	-18.6%	45.29	97.6%	100.1%	119,350	-20.0%
FY11	2,436,963	95,979	33,367	129,346	-13.3%	43.68	91.1%	99.8%	120,705	-19.1%
FY12	2,452,457	79,834	33,875	113,709	-23.8%	49.02	107.7%	99.4%	119,646	-19.8%
FY13	2,452,457	90,372	32,263	122,635	-17.8%	43.85	91.5%	100.0%	114,939	-22.9%
FY14	2,634,457	95,483	30,862	126,345	-15.3%	41.37	83.4%	99.3%	110,281	-26.1%
FY15	2,634,457	86,137	29,408	115,545	-22.5%	43.42	92.3%	100.2%	108,936	-27.0%
FY16	2,634,457	76,042	29,066	105,108	-29.5%	47.61	105.6%	99.4%	109,207	-26.8%
FY17	2,634,457	74,225	28,091	102,316	-31.4%	47.07	104.0%	99.6%	105,168	-29.5%
FY18	2,634,457	76,146	27,337	103,484	-30.6%	43.54	88.9%	100.6%	95,222	-36.2%
FY19	2,634,457	86,878	26,955	113,832	-23.7%	42.23	88.5%	100.3%	103,897	-30.3%
FY20	2,785,457	76,331	25,027	101,358	-32.0%	45.42	98.5%	99.7%	100,168	-32.8%
FY21	2,785,457	72,721	25,121	97,843	-34.4%	46.01	99.5%	99.4%	97,302	-34.8%
FY22	2,801,457	79,037	27,064	106,101	-28.9%	44.82	95.8%	100.1%	102,813	-31.1%
FY23	2,729,192	75,184	26,784	101,968	-31.6%	45.82	99.1%	99.8%	101,229	-32.1%
FY24	2,729,192	67,347	26,600	93,947	-37.0%	49.00	110.9%	98.5%	100,907	-32.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

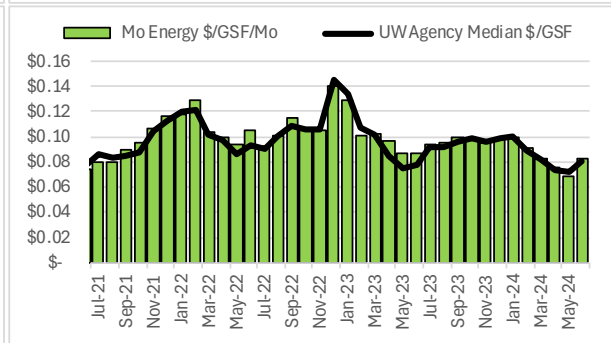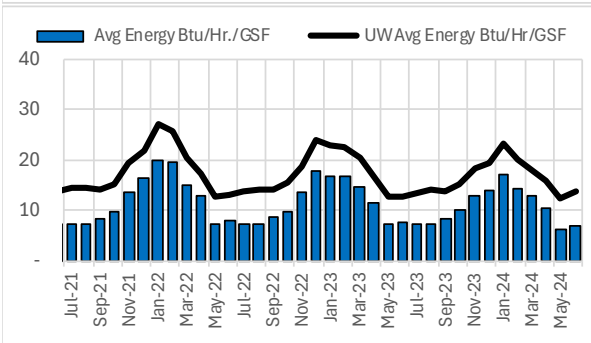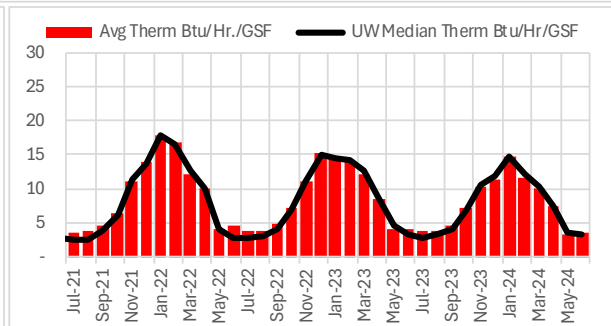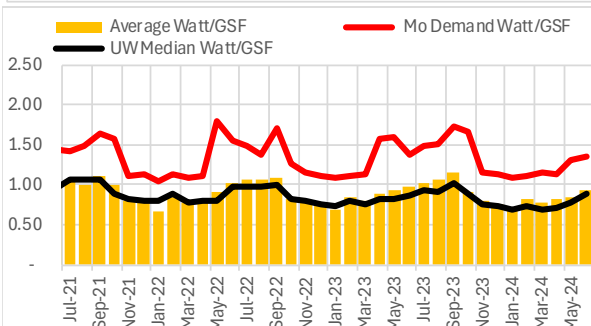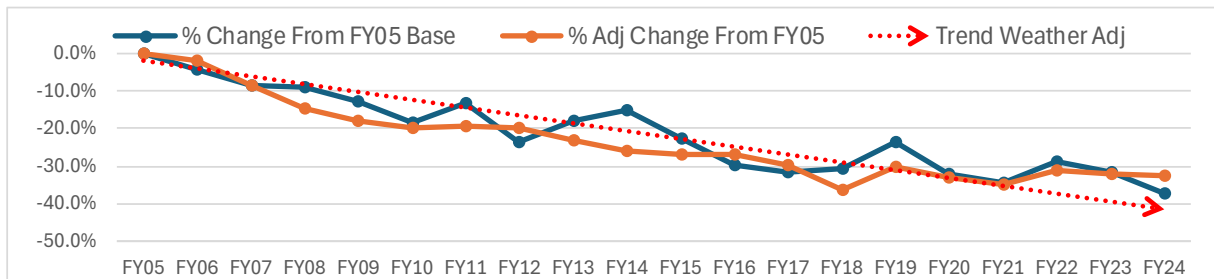

FY2024 UW-Green Bay State Facilities Energy Report

FY24 Electric kwh/GSF= 9.92			FY24 Therm/GSF = 0.75			FY24 Total Btu/GSF= 108,527			05-24 Thm -30.8%	
FY24 Electric \$/GSF= \$ 0.94			FY24 Thermal \$/GSF= \$ 0.26			FY24 Energy \$/GSF= \$ 1.21			05-24 kwh -38.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,157,746	120,311	54,211	174,522	0.0%	45.94	100.0%	100.0%	174,522	0.0%
FY06	1,179,796	103,003	52,689	155,692	-10.8%	47.26	103.2%	99.0%	158,453	-9.2%
FY07	1,179,796	89,260	49,961	139,222	-20.2%	46.64	103.4%	99.9%	142,243	-18.5%
FY08	1,386,055	85,323	45,712	131,035	-24.9%	45.02	96.4%	99.6%	127,793	-26.8%
FY09	1,386,055	82,101	44,231	126,332	-27.6%	43.47	93.9%	100.5%	121,515	-30.4%
FY10	1,386,055	79,218	42,285	121,502	-30.4%	45.98	100.3%	100.3%	121,820	-30.2%
FY11	1,386,055	84,331	42,679	127,010	-27.2%	44.58	95.5%	99.6%	123,056	-29.5%
FY12	1,386,055	75,586	42,479	118,065	-32.3%	49.86	109.2%	98.6%	124,441	-28.7%
FY13	1,386,055	86,895	41,790	128,685	-26.3%	45.29	98.3%	99.9%	127,207	-27.1%
FY14	1,386,055	94,549	40,324	134,874	-22.7%	41.95	89.5%	99.7%	124,776	-28.5%
FY15	1,386,055	89,115	38,829	127,944	-26.7%	43.98	95.4%	100.3%	123,943	-29.0%
FY16	1,386,055	77,285	37,980	115,265	-34.0%	48.11	106.0%	99.3%	119,664	-31.4%
FY17	1,386,055	77,751	37,774	115,524	-33.8%	48.65	107.8%	99.3%	121,332	-30.5%
FY18	1,386,055	81,181	37,442	118,623	-32.0%	45.41	98.4%	100.2%	117,362	-32.8%
FY19	1,386,055	83,250	37,539	120,790	-30.8%	44.90	97.1%	100.1%	118,389	-32.2%
FY20	1,386,058	79,329	35,050	114,379	-34.5%	46.40	101.8%	99.8%	115,742	-33.7%
FY21	1,386,058	81,055	35,189	116,244	-33.4%	47.28	103.4%	99.2%	118,729	-32.0%
FY22	1,386,058	84,623	37,114	121,737	-30.2%	46.76	101.2%	98.9%	122,314	-29.9%
FY23	1,386,058	83,495	35,684	119,179	-31.7%	47.58	104.7%	99.6%	122,986	-29.5%
FY24	1,386,058	74,680	33,846	108,527	-37.8%	49.93	111.5%	99.1%	116,830	-33.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

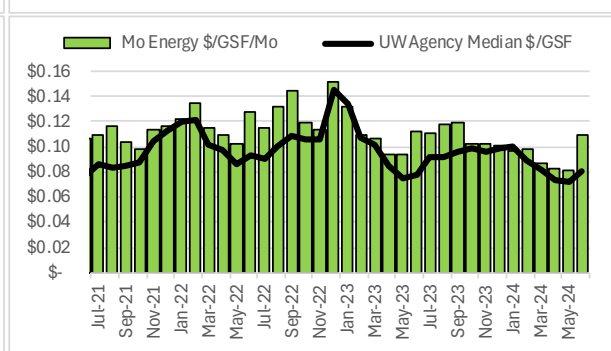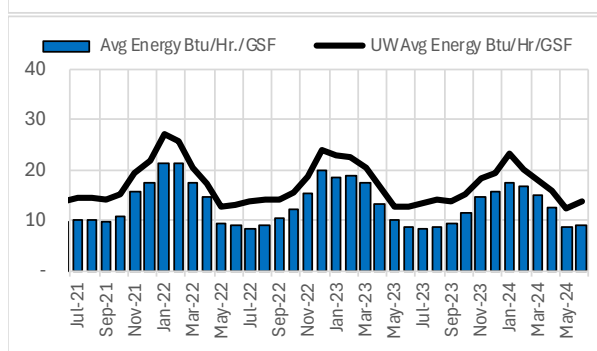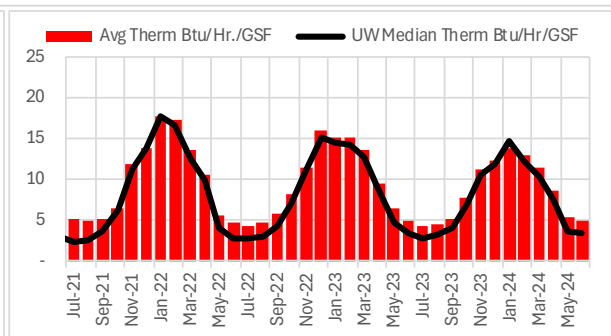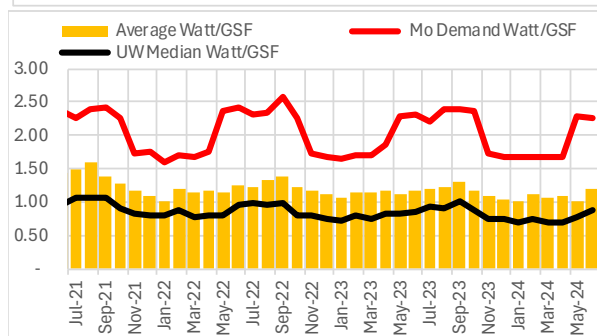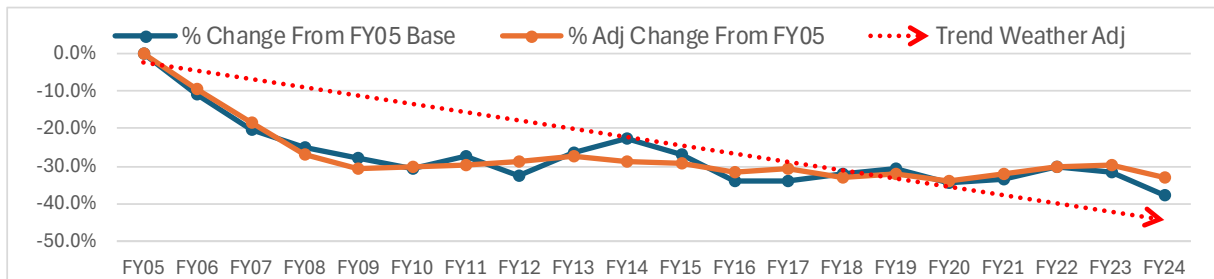

FY2024 UW-La Crosse State Facilities Energy Report

FY24 Electric kwh/GSF= 9.92			FY24 Therm/GSF = 0.81			FY24 Total Btu/GSF= 115,298			05-24 Thm -19.8%	
FY24 Electric \$/GSF= \$ 1.00			FY24 Thermal \$/GSF= \$ 0.42			FY24 Energy \$/GSF= \$ 1.42			05-24 kwh -13.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,260,874	111,932	38,509	150,442	0.0%	48.43	100.0%	100.0%	150,442	0.0%
FY06	2,206,741	112,859	41,060	153,918	2.3%	49.77	103.1%	98.9%	156,960	4.3%
FY07	2,371,272	106,564	39,666	146,230	-2.8%	48.68	100.3%	99.6%	146,369	-2.7%
FY08	2,371,272	107,435	38,037	145,472	-3.3%	46.15	95.0%	100.2%	140,218	-6.8%
FY09	2,371,272	109,799	37,932	147,731	-1.8%	45.86	94.3%	100.8%	141,799	-5.7%
FY10	2,261,088	105,044	35,731	140,775	-6.4%	47.43	97.3%	100.2%	137,964	-8.3%
FY11	2,261,088	114,130	40,565	154,696	2.8%	46.70	95.9%	99.7%	149,838	-0.4%
FY12	2,677,906	92,097	36,609	128,706	-14.4%	51.77	108.4%	98.0%	135,681	-9.8%
FY13	2,677,906	99,742	34,662	134,404	-10.7%	46.71	95.9%	99.9%	130,274	-13.4%
FY14	2,677,906	109,817	36,240	146,057	-2.9%	44.97	90.7%	99.0%	135,464	-10.0%
FY15	2,797,642	102,174	33,283	135,457	-10.0%	47.28	97.6%	99.5%	132,876	-11.7%
FY16	3,008,972	87,787	31,540	119,327	-20.7%	51.01	106.4%	98.8%	124,561	-17.2%
FY17	3,008,972	86,235	31,077	117,312	-22.0%	51.62	107.6%	98.7%	123,432	-18.0%
FY18	3,008,972	90,162	32,779	122,940	-18.3%	48.61	99.6%	99.3%	122,345	-18.7%
FY19	3,008,972	103,829	36,618	140,447	-6.6%	46.76	94.4%	99.5%	134,451	-10.6%
FY20	3,207,814	87,642	31,833	119,475	-20.6%	49.35	101.6%	98.0%	120,213	-20.1%
FY21	3,220,082	88,743	33,052	121,795	-19.0%	49.59	101.7%	97.9%	122,635	-18.5%
FY22	3,069,582	88,700	35,634	124,335	-17.4%	48.90	99.7%	97.9%	123,323	-18.0%
FY23	3,209,701	91,165	34,491	125,657	-16.5%	49.35	101.4%	98.7%	126,449	-15.9%
FY24	3,209,701	81,445	33,853	115,298	-23.4%	52.02	110.2%	97.9%	122,900	-18.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

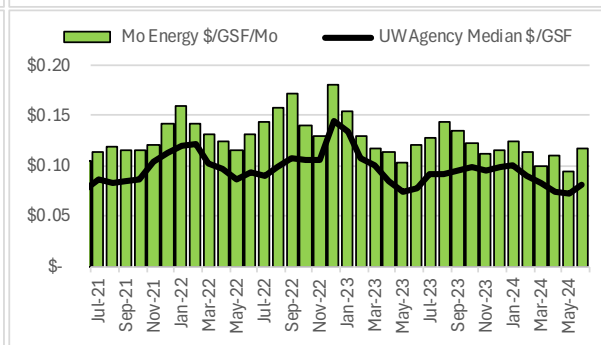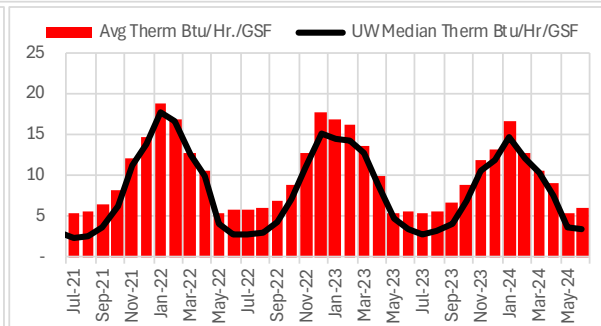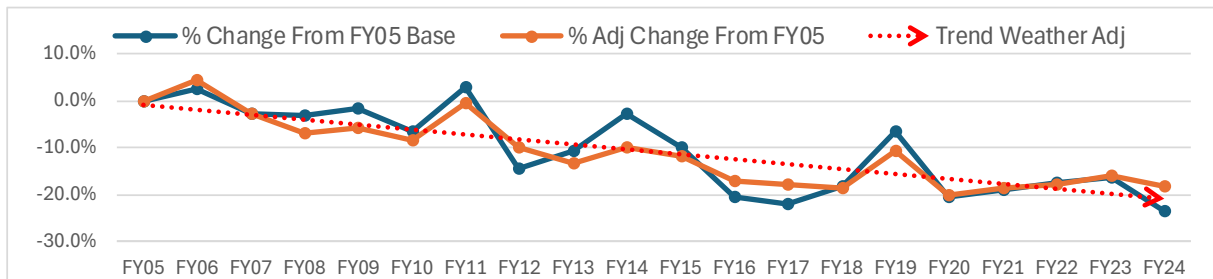

FY2024 UW-Madison State Facilities Energy Report

FY24 Electric kwh/GSF= 18.83			FY24 Therm/GSF = 1.34			FY24 Total Btu/GSF= 197,839			05-24 Thm -37.9%	
FY24 Electric \$/GSF= \$ 2.31			FY24 Thermal \$/GSF= \$ 0.63			FY24 Energy \$/GSF= \$ 2.94			05-24 kwh -7.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	19,207,711	226,083	68,693	294,776	0.0%	48.12	100.0%	100.0%	294,776	0.0%
FY06	19,361,692	228,039	72,458	300,497	1.9%	48.65	99.8%	99.5%	299,651	1.7%
FY07	19,913,817	218,280	72,444	290,723	-1.4%	47.46	98.7%	99.9%	287,777	-2.4%
FY08	20,578,984	222,587	72,402	294,989	0.1%	46.19	95.3%	99.6%	284,134	-3.6%
FY09	20,979,443	201,882	70,317	272,200	-7.7%	45.66	95.4%	100.0%	262,950	-10.8%
FY10	20,678,457	198,630	71,666	270,295	-8.3%	47.10	98.4%	100.5%	267,533	-9.2%
FY11	21,120,379	191,751	73,773	265,524	-9.9%	46.81	95.4%	99.6%	256,418	-13.0%
FY12	22,153,550	161,185	72,184	233,369	-20.8%	51.51	103.2%	98.0%	237,075	-19.6%
FY13	22,362,671	174,852	69,426	244,278	-17.1%	47.29	97.2%	99.6%	239,149	-18.9%
FY14	22,810,139	182,317	68,825	251,142	-14.8%	44.58	90.8%	99.8%	234,207	-20.5%
FY15	22,931,250	171,216	67,872	239,089	-18.9%	45.84	95.7%	100.2%	231,889	-21.3%
FY16	22,931,250	152,560	67,974	220,535	-25.2%	49.68	102.5%	99.3%	223,906	-24.0%
FY17	22,947,032	152,337	68,409	220,746	-25.1%	49.72	101.5%	98.8%	222,281	-24.6%
FY18	22,755,778	163,357	67,055	230,413	-21.8%	46.66	96.3%	99.8%	224,251	-23.9%
FY19	22,738,034	166,914	65,675	232,588	-21.1%	45.87	95.7%	100.4%	225,602	-23.5%
FY20	22,871,102	160,144	63,748	223,893	-24.0%	48.08	99.6%	99.6%	223,045	-24.3%
FY21	23,025,678	152,781	61,929	214,710	-27.2%	47.61	97.2%	99.2%	209,992	-28.8%
FY22	23,025,678	153,771	64,468	218,239	-26.0%	48.04	97.4%	98.8%	213,458	-27.6%
FY23	23,091,606	141,786	64,257	206,043	-30.1%	48.63	101.0%	99.7%	207,189	-29.7%
FY24	23,144,475	133,589	64,250	197,839	-32.9%	50.95	105.2%	98.5%	203,778	-30.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

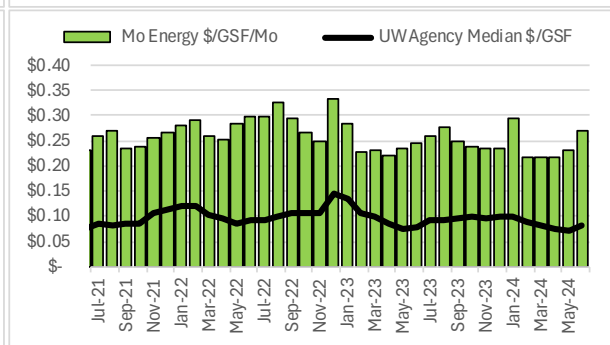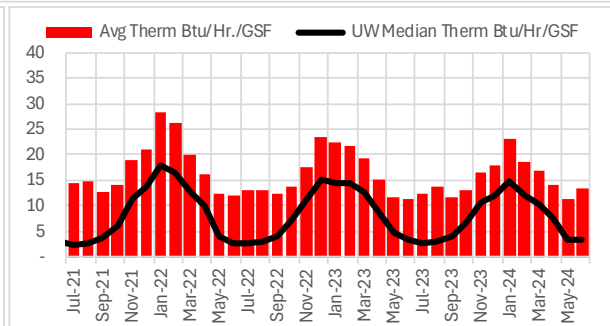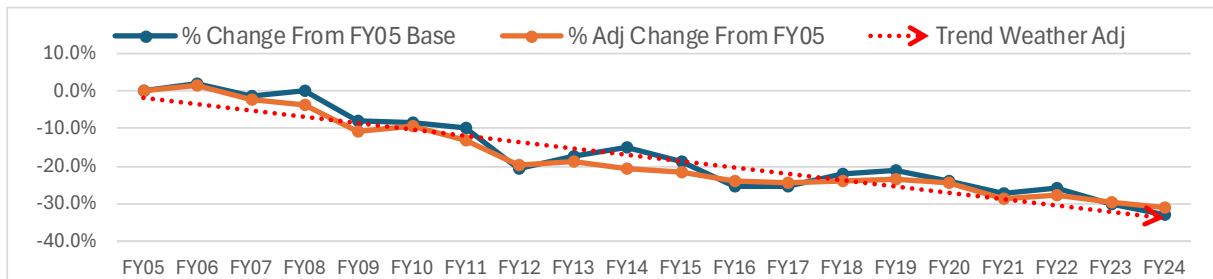

FY2024 UW-Milwaukee State Facilities Energy Report

FY24 Electric kwh/GSF= 11.89			FY24 Therm/GSF = 0.77			FY24 Total Btu/GSF= 117,616			05-24 Thm -26.9%	
FY24 Electric \$/GSF= \$ 1.23			FY24 Thermal \$/GSF= \$ 0.33			FY24 Energy \$/GSF= \$ 1.56			05-24 kwh -22.8%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	4,190,131	120,968	50,959	171,927	0.0%	48.47	100.0%	100.0%	171,927	0.0%
FY06	4,190,131	113,043	53,589	166,632	-3.1%	50.11	100.6%	99.0%	166,769	-3.0%
FY07	4,324,831	118,950	53,955	172,905	0.6%	48.88	100.2%	99.6%	172,894	0.6%
FY08	4,320,806	126,609	54,956	181,564	5.6%	47.87	97.0%	99.4%	177,428	3.2%
FY09	4,344,925	131,382	54,261	185,643	8.0%	47.26	96.5%	100.1%	181,096	5.3%
FY10	5,124,577	119,065	52,092	171,157	-0.4%	49.10	101.6%	99.8%	172,956	0.6%
FY11	5,124,577	114,381	50,373	164,754	-4.2%	48.17	96.4%	99.2%	160,217	-6.8%
FY12	5,124,577	92,415	48,045	140,460	-18.3%	52.24	107.5%	98.0%	146,456	-14.8%
FY13	6,026,992	90,078	42,192	132,270	-23.1%	48.26	97.8%	99.1%	129,925	-24.4%
FY14	6,032,861	94,977	40,391	135,368	-21.3%	45.20	89.7%	99.6%	125,428	-27.0%
FY15	6,078,866	98,619	41,553	140,172	-18.5%	46.08	93.8%	100.3%	134,243	-21.9%
FY16	6,208,809	83,883	41,521	125,403	-27.1%	50.51	106.4%	99.5%	130,618	-24.0%
FY17	6,208,809	87,314	41,490	128,804	-25.1%	51.99	108.6%	97.9%	135,478	-21.2%
FY18	6,208,809	91,906	41,226	133,132	-22.6%	48.79	99.5%	99.3%	132,364	-23.0%
FY19	6,208,809	90,037	40,888	130,925	-23.8%	47.88	97.5%	99.4%	128,370	-25.3%
FY20	6,204,204	83,786	38,772	122,558	-28.7%	49.85	104.2%	99.3%	125,800	-26.8%
FY21	6,204,204	81,148	37,439	118,587	-31.0%	50.84	106.2%	97.6%	122,745	-28.6%
FY22	6,204,204	81,346	40,091	121,438	-29.4%	50.91	105.1%	97.0%	124,407	-27.6%
FY23	6,204,204	77,173	37,629	114,802	-33.2%	51.08	108.7%	98.4%	120,895	-29.7%
FY24	6,204,204	77,050	40,565	117,616	-31.6%	53.15	114.7%	97.0%	127,775	-25.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

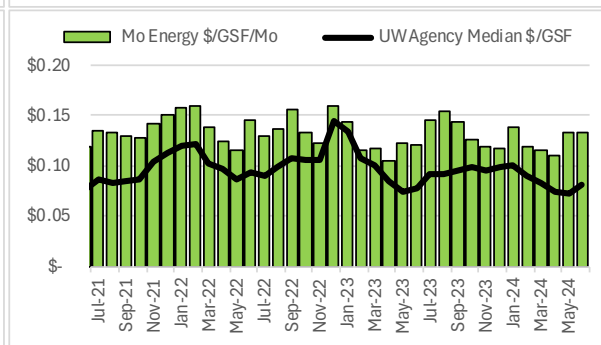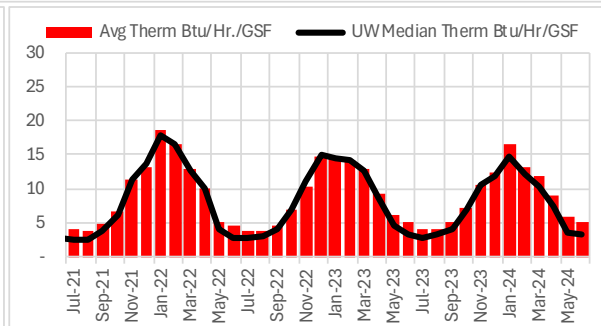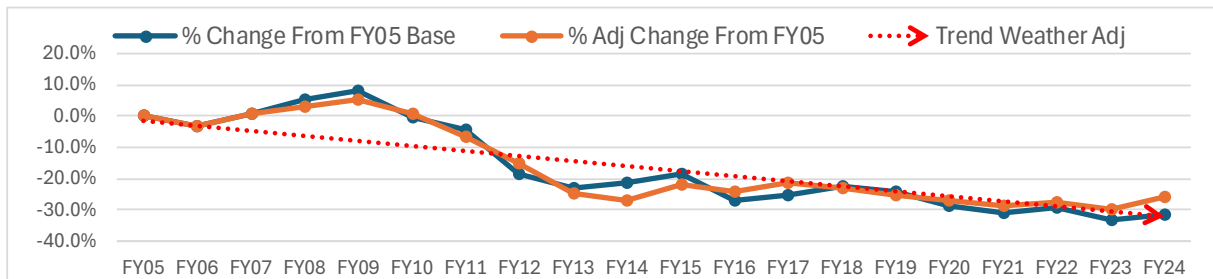

FY2024 UW-Oshkosh State Facilities Energy Report

FY24 Electric kwh/GSF= 7.45			FY24 Therm/GSF = 0.74			FY24 Total Btu/GSF= 99,297			05-24 Thm -14.1%	
FY24 Electric \$/GSF= \$ 0.66			FY24 Thermal \$/GSF= \$ 0.25			FY24 Energy \$/GSF= \$ 0.91			05-24 kwh -36.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,674,233	97,371	39,080	136,452	0.0%	45.94	100.0%	100.0%	136,452	0.0%
FY06	2,746,643	90,160	38,047	128,207	-6.0%	47.26	103.8%	99.3%	131,364	-3.7%
FY07	2,753,951	92,028	37,296	129,324	-5.2%	46.64	103.3%	99.8%	132,282	-3.1%
FY08	2,889,527	96,011	36,061	132,072	-3.2%	45.02	97.0%	100.5%	129,422	-5.2%
FY09	2,855,351	94,812	35,226	130,038	-4.7%	43.47	92.8%	100.6%	123,405	-9.6%
FY10	2,826,573	92,436	35,384	127,820	-6.3%	45.98	100.8%	100.2%	128,605	-5.8%
FY11	2,892,390	89,695	33,923	123,619	-9.4%	44.58	95.5%	100.4%	119,721	-12.3%
FY12	2,892,390	85,067	35,571	120,638	-11.6%	49.86	110.9%	98.6%	129,385	-5.2%
FY13	3,001,171	92,892	34,815	127,707	-6.4%	45.29	97.9%	100.0%	125,719	-7.9%
FY14	3,001,171	102,450	34,326	136,776	0.2%	41.95	88.0%	100.5%	124,631	-8.7%
FY15	3,126,330	89,692	32,045	121,737	-10.8%	43.98	94.6%	100.3%	117,008	-14.2%
FY16	3,259,189	78,674	30,631	109,306	-19.9%	48.11	106.9%	99.3%	114,516	-16.1%
FY17	3,259,189	73,824	29,753	103,577	-24.1%	48.65	109.8%	98.9%	110,501	-19.0%
FY18	3,259,189	83,654	29,123	112,777	-17.4%	45.41	98.2%	100.3%	111,366	-18.4%
FY19	3,259,189	87,213	28,737	115,950	-15.0%	44.90	97.5%	99.7%	113,659	-16.7%
FY20	3,288,596	79,546	25,768	105,314	-22.8%	46.40	101.9%	100.0%	106,847	-21.7%
FY21	3,288,596	77,264	24,294	101,557	-25.6%	47.28	103.5%	99.3%	104,120	-23.7%
FY22	3,288,596	79,345	27,702	107,047	-21.5%	46.76	101.4%	98.9%	107,866	-20.9%
FY23	3,288,596	77,108	25,732	102,841	-24.6%	47.58	105.2%	99.1%	106,643	-21.8%
FY24	3,288,596	73,874	25,423	99,297	-27.2%	49.93	113.2%	97.8%	108,479	-20.5%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

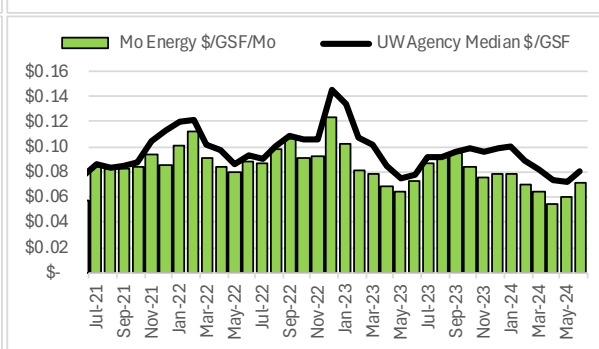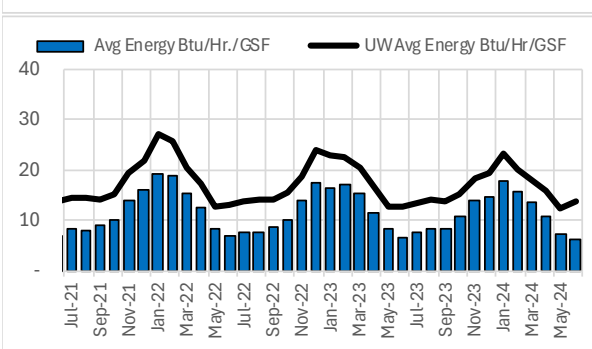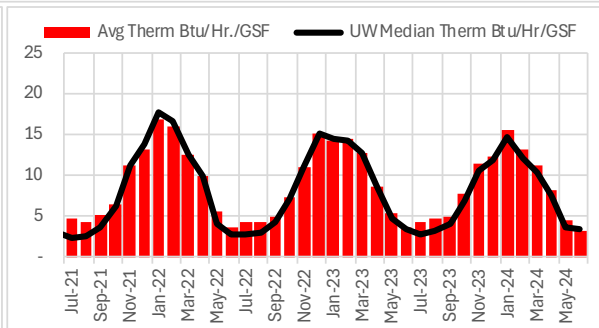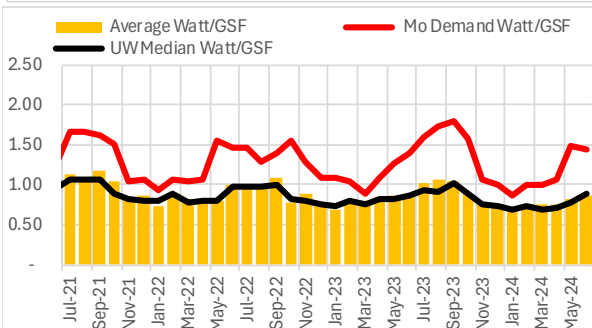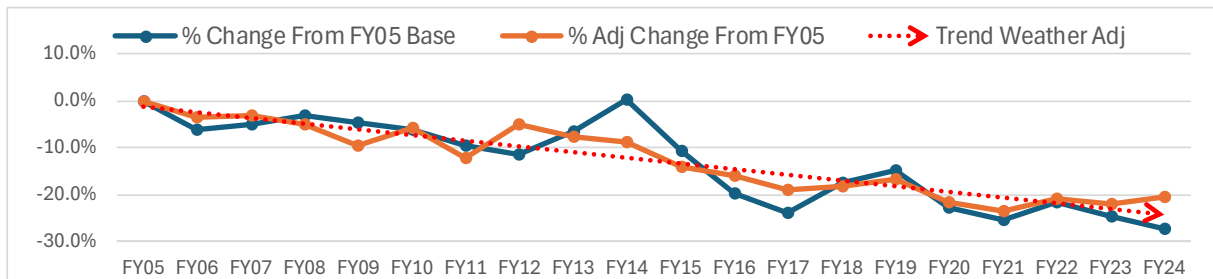

FY2024 UW-Parkside State Facilities Energy Report

FY24 Electric kwh/GSF= 7.85			FY24 Therm/GSF = 0.71			FY24 Total Btu/GSF= 97,425			05-24 Thm -16.8%	
FY24 Electric \$/GSF= \$ 0.88			FY24 Thermal \$/GSF= \$ 0.27			FY24 Energy \$/GSF= \$ 1.15			05-24 kwh -47.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,132,766	97,238	48,885	146,123	0.0%	48.47	100.0%	100.0%	146,123	0.0%
FY06	1,135,611	92,933	48,494	141,428	-3.2%	50.11	102.3%	98.2%	142,709	-2.3%
FY07	1,135,611	92,812	47,413	140,224	-4.0%	48.88	100.5%	99.1%	140,275	-4.0%
FY08	1,135,611	96,311	47,038	143,349	-1.9%	47.87	96.8%	98.9%	139,757	-4.4%
FY09	1,191,207	95,784	44,059	139,843	-4.3%	47.26	95.7%	99.4%	135,432	-7.3%
FY10	1,190,505	91,337	42,696	134,033	-8.3%	49.10	101.8%	99.8%	135,623	-7.2%
FY11	1,190,505	99,535	43,573	143,108	-2.1%	48.17	97.2%	98.5%	139,670	-4.4%
FY12	1,262,322	86,719	43,465	130,183	-10.9%	52.24	108.1%	97.5%	136,090	-6.9%
FY13	1,262,322	97,434	40,419	137,853	-5.7%	48.26	98.6%	99.0%	136,081	-6.9%
FY14	1,262,322	106,314	40,203	146,517	0.3%	45.20	90.2%	99.0%	135,691	-7.1%
FY15	1,262,322	104,554	39,040	143,595	-1.7%	46.08	94.0%	100.8%	137,637	-5.8%
FY16	1,262,322	94,192	38,812	133,005	-9.0%	50.51	105.2%	98.4%	137,223	-6.1%
FY17	1,262,322	89,719	37,404	127,123	-13.0%	51.99	107.8%	95.9%	132,617	-9.2%
FY18	1,262,322	93,045	36,003	129,048	-11.7%	48.79	99.9%	98.8%	128,556	-12.0%
FY19	1,262,322	97,055	34,704	131,759	-9.8%	47.88	98.0%	98.6%	129,304	-11.5%
FY20	1,374,576	82,165	30,140	112,305	-23.1%	49.85	103.6%	98.8%	114,923	-21.4%
FY21	1,374,576	73,128	31,411	104,539	-28.5%	50.84	105.3%	97.0%	107,462	-26.5%
FY22	1,374,576	68,359	30,304	98,663	-32.5%	50.91	104.3%	96.8%	100,617	-31.1%
FY23	1,374,576	74,360	28,900	103,260	-29.3%	51.08	108.1%	98.9%	108,980	-25.4%
FY24	1,374,576	70,624	26,801	97,425	-33.3%	53.15	114.6%	95.7%	106,561	-27.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

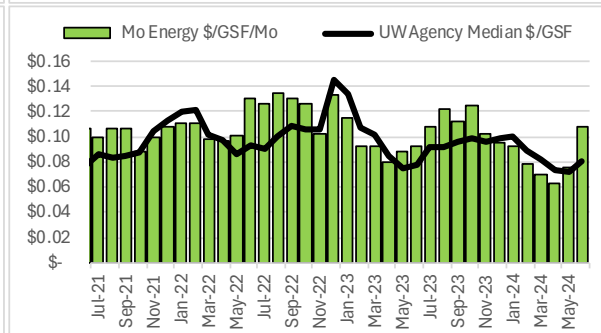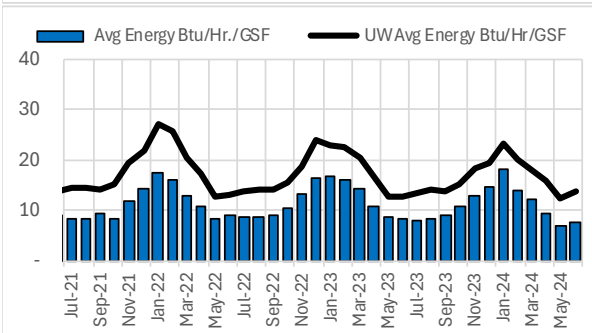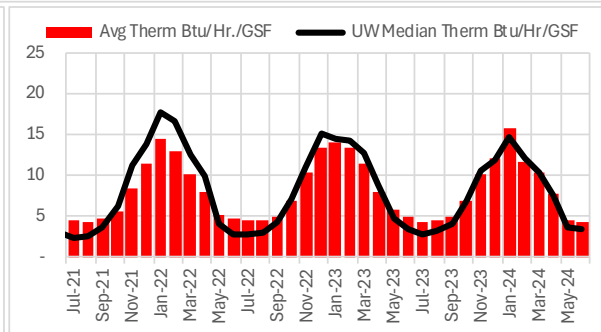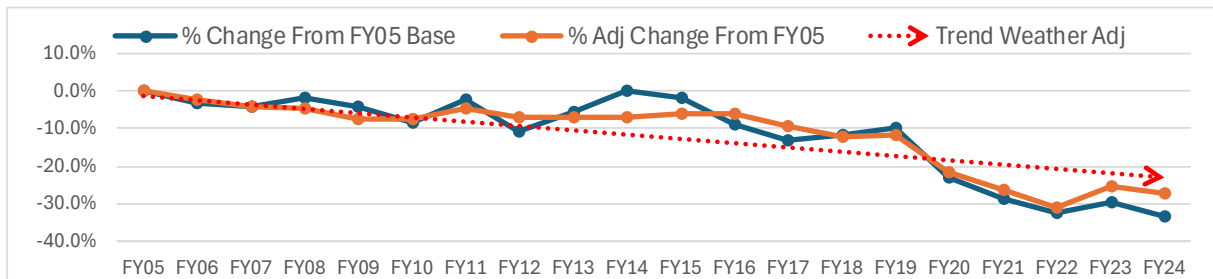

FY2024 UW-Platteville State Facilities Energy Report

FY24 Electric kwh/GSF= 8.30			FY24 Therm/GSF = 0.92			FY24 Total Btu/GSF= 120,310			05-24 Thm -3.3%	
FY24 Electric \$/GSF= \$ 0.80			FY24 Thermal \$/GSF= \$ 0.39			FY24 Energy \$/GSF= \$ 1.18			05-24 kwh -22.8%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,767,380	103,200	36,016	139,216	0.0%	48.12	100.0%	100.0%	139,216	0.0%
FY06	1,754,450	101,158	37,098	138,256	-0.7%	48.65	100.9%	99.8%	139,041	-0.1%
FY07	1,905,950	91,622	35,117	126,739	-9.0%	47.46	98.1%	100.1%	125,021	-10.2%
FY08	1,951,401	98,076	36,032	134,108	-3.7%	46.19	92.8%	99.9%	126,984	-8.8%
FY09	2,051,105	99,652	36,238	135,890	-2.4%	45.66	91.6%	100.1%	127,509	-8.4%
FY10	2,051,105	95,342	37,995	133,337	-4.2%	47.10	96.6%	100.4%	130,274	-6.4%
FY11	2,070,851	103,837	37,815	141,652	1.8%	46.81	94.3%	100.1%	135,735	-2.5%
FY12	2,070,851	88,288	35,073	123,361	-11.4%	51.51	108.1%	98.3%	129,884	-6.7%
FY13	2,070,851	103,588	33,516	137,104	-1.5%	47.29	95.1%	99.1%	131,757	-5.4%
FY14	2,244,485	104,542	31,937	136,478	-2.0%	44.58	89.3%	99.5%	125,153	-10.1%
FY15	2,244,485	96,423	31,305	127,728	-8.3%	45.84	92.9%	100.1%	120,889	-13.2%
FY16	2,244,485	84,267	30,498	114,766	-17.6%	49.68	106.3%	99.4%	119,927	-13.9%
FY17	2,244,485	83,745	31,430	115,175	-17.3%	49.72	103.7%	99.0%	117,936	-15.3%
FY18	2,244,485	97,297	30,707	128,004	-8.1%	46.66	95.1%	100.4%	123,346	-11.4%
FY19	2,244,485	106,967	31,515	138,482	-0.5%	45.87	93.6%	100.2%	131,678	-5.4%
FY20	2,132,462	101,145	31,117	132,262	-5.0%	48.08	100.7%	99.3%	132,744	-4.6%
FY21	2,132,462	91,863	30,764	122,627	-11.9%	47.61	97.8%	98.8%	120,264	-13.6%
FY22	2,134,293	97,387	33,271	130,658	-6.1%	48.04	98.2%	99.2%	128,667	-7.6%
FY23	2,233,502	98,727	28,810	127,537	-8.4%	48.63	101.5%	99.4%	128,871	-7.4%
FY24	2,233,502	91,970	28,340	120,310	-13.6%	50.95	108.5%	98.1%	127,608	-8.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

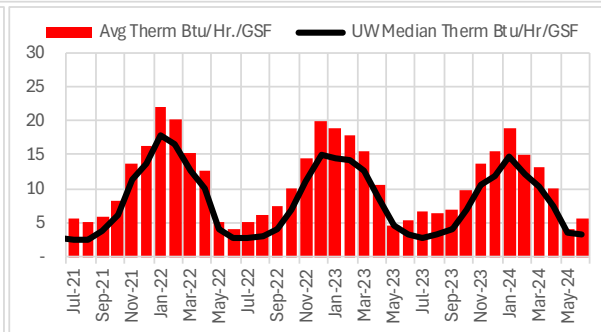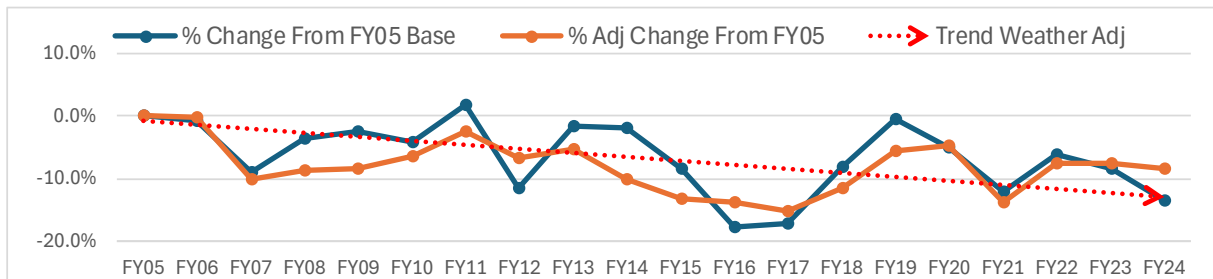

FY2024 UW-River Falls State Facilities Energy Report

FY24 Electric kwh/GSF= 3.36			FY24 Therm/GSF = 0.79			FY24 Total Btu/GSF= 90,567			05-24 Thm -5.7%	
FY24 Electric \$/GSF= \$ 0.32			FY24 Thermal \$/GSF= \$ 0.41			FY24 Energy \$/GSF= \$ 0.73			05-24 kwh -64.7%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,493,198	92,456	32,102	124,558	0.0%	45.85	100.0%	100.0%	124,558	0.0%
FY06	1,539,790	89,293	31,876	121,169	-2.7%	47.80	104.5%	99.7%	125,125	0.5%
FY07	1,685,846	87,694	30,484	118,178	-5.1%	46.32	99.2%	100.1%	117,508	-5.7%
FY08	1,683,720	91,485	29,871	121,356	-2.6%	43.27	90.8%	100.6%	113,074	-9.2%
FY09	1,686,708	85,604	28,108	113,712	-8.7%	42.97	90.2%	101.3%	105,715	-15.1%
FY10	1,686,708	78,074	26,846	104,920	-15.8%	45.29	97.2%	100.1%	102,773	-17.5%
FY11	1,686,708	82,623	26,635	109,259	-12.3%	43.68	89.7%	101.2%	101,077	-18.9%
FY12	1,766,458	66,615	25,643	92,258	-25.9%	49.02	105.8%	99.4%	95,949	-23.0%
FY13	1,769,312	77,503	25,774	103,277	-17.1%	43.85	91.7%	100.4%	96,988	-22.1%
FY14	1,769,312	81,313	25,204	106,516	-14.5%	41.37	83.0%	101.3%	93,017	-25.3%
FY15	1,769,312	78,935	24,038	102,973	-17.3%	43.42	91.2%	100.5%	96,165	-22.8%
FY16	1,769,312	72,883	23,530	96,413	-22.6%	47.61	105.6%	99.6%	100,387	-19.4%
FY17	1,769,312	73,501	24,119	97,620	-21.6%	47.07	103.2%	99.8%	99,938	-19.8%
FY18	1,769,312	83,619	23,740	107,358	-13.8%	43.54	90.8%	101.3%	99,958	-19.7%
FY19	1,769,312	83,694	23,365	107,058	-14.0%	42.23	88.6%	100.6%	97,650	-21.6%
FY20	1,684,447	81,171	22,708	103,879	-16.6%	45.42	98.0%	99.6%	102,166	-18.0%
FY21	1,684,447	72,399	11,596	83,995	-32.6%	46.01	97.4%	99.3%	82,068	-34.1%
FY22	1,684,447	79,487	11,926	91,413	-26.6%	44.82	95.0%	100.5%	87,520	-29.7%
FY23	1,684,447	85,658	11,501	97,159	-22.0%	45.82	98.3%	100.4%	95,733	-23.1%
FY24	1,684,447	79,094	11,473	90,567	-27.3%	49.00	110.2%	98.8%	98,490	-20.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

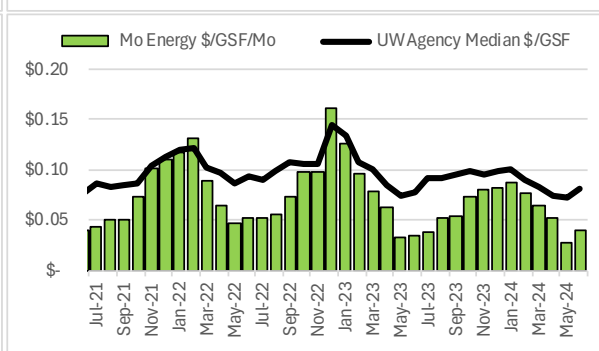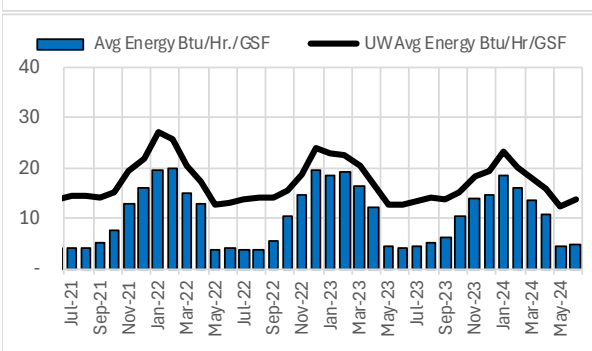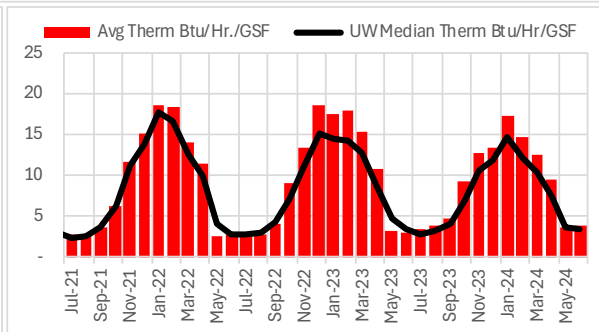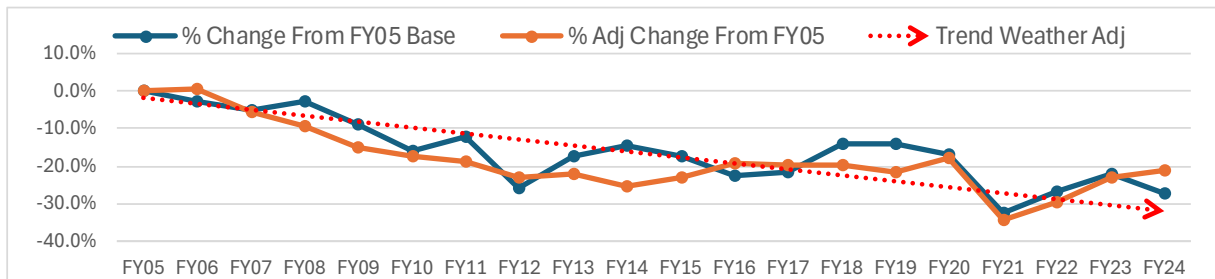

FY2024 UW-Stevens Point State Facilities Energy Report

FY24 Electric kwh/GSF= 7.55			FY24 Therm/GSF = 1.13			FY24 Total Btu/GSF= 138,774			05-24 Thm -2.0%	
FY24 Electric \$/GSF= \$ 0.68			FY24 Thermal \$/GSF= \$ 0.41			FY24 Energy \$/GSF= \$ 1.09			05-24 kwh -29.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,335,965	128,082	36,054	164,136	0.0%	44.50	100.0%	100.0%	164,136	0.0%
FY06	2,460,496	119,379	35,690	155,069	-5.5%	46.21	103.9%	99.6%	159,644	-2.7%
FY07	2,460,496	113,304	34,134	147,438	-10.2%	44.70	99.9%	100.0%	147,302	-10.3%
FY08	2,493,729	118,947	34,919	153,866	-6.3%	42.68	94.4%	100.4%	147,378	-10.2%
FY09	2,493,729	119,936	33,824	153,759	-6.3%	42.20	94.0%	100.8%	146,845	-10.5%
FY10	2,453,362	111,437	34,311	145,749	-11.2%	45.07	101.4%	99.4%	147,060	-10.4%
FY11	2,463,548	119,930	36,059	155,989	-5.0%	43.03	95.7%	100.5%	150,941	-8.0%
FY12	2,629,769	101,883	34,846	136,730	-16.7%	48.08	106.8%	98.7%	143,249	-12.7%
FY13	2,629,769	114,526	34,093	148,618	-9.5%	43.78	97.1%	100.2%	145,311	-11.5%
FY14	2,629,769	125,931	34,522	160,454	-2.2%	40.42	89.4%	100.2%	147,148	-10.3%
FY15	2,629,769	118,090	34,294	152,384	-7.2%	42.00	93.9%	100.2%	145,214	-11.5%
FY16	2,629,769	103,469	34,492	137,961	-15.9%	47.49	108.0%	98.9%	145,882	-11.1%
FY17	2,629,769	102,577	30,951	133,529	-18.6%	45.96	104.6%	99.6%	138,061	-15.9%
FY18	2,629,769	111,331	32,240	143,572	-12.5%	43.03	95.5%	100.2%	138,634	-15.5%
FY19	2,629,769	120,991	32,980	153,971	-6.2%	41.93	94.0%	100.3%	146,800	-10.6%
FY20	2,806,271	107,015	28,562	135,577	-17.4%	43.74	98.9%	100.9%	134,641	-18.0%
FY21	2,806,271	104,652	26,804	131,457	-19.9%	45.40	101.9%	98.9%	133,131	-18.9%
FY22	2,806,271	113,012	29,271	142,283	-13.3%	45.76	101.9%	98.3%	143,958	-12.3%
FY23	2,806,271	123,528	26,961	150,489	-8.3%	46.29	104.2%	99.3%	155,544	-5.2%
FY24	2,806,271	112,995	25,779	138,774	-15.5%	48.13	111.1%	98.7%	150,974	-8.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

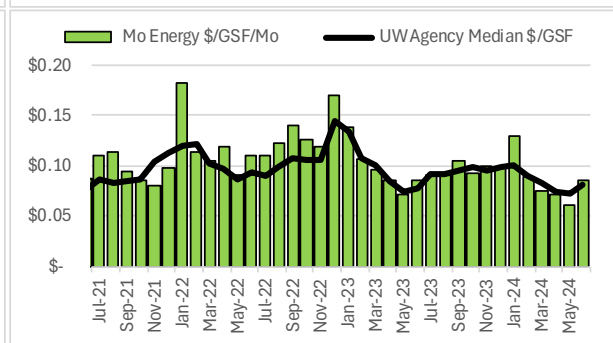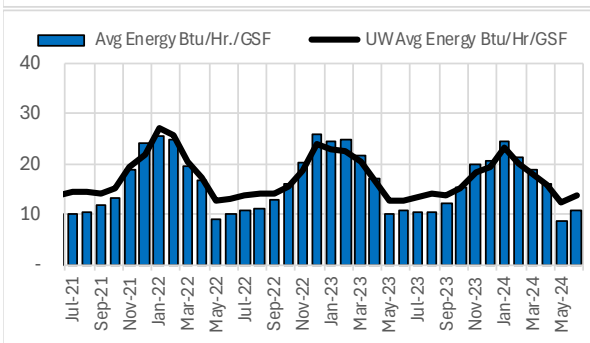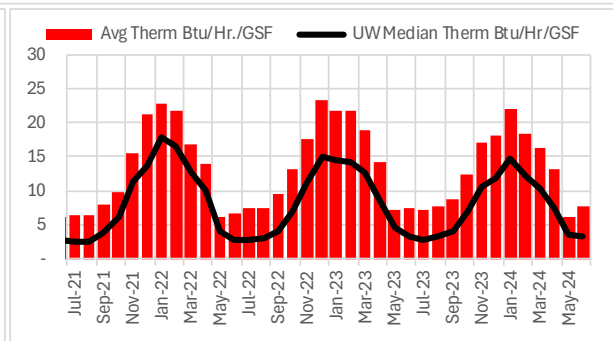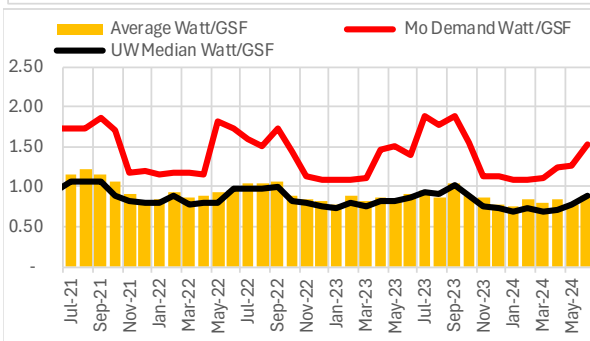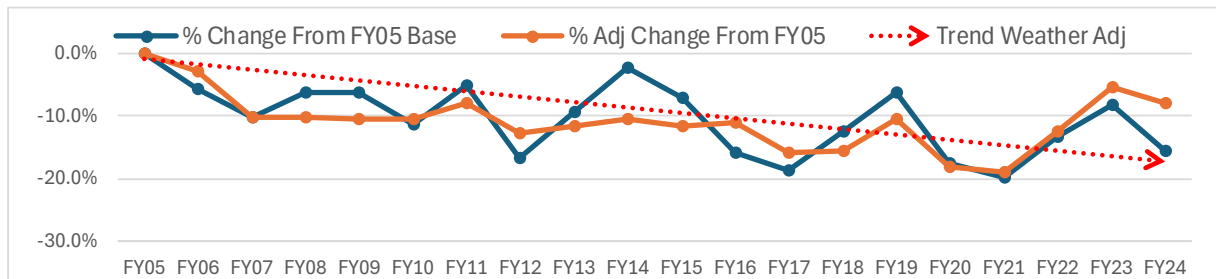

FY2024 UW-Stout State Facilities Energy Report

FY24 Electric kwh/GSF= 7.74			FY24 Therm/GSF = 0.66			FY24 Total Btu/GSF= 92,582			05-24 Thm -8.5%	
FY24 Electric \$/GSF= \$ 0.79			FY24 Thermal \$/GSF= \$ 0.32			FY24 Energy \$/GSF= \$ 1.11			05-24 kwh -20.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,162,886	80,464	32,598	113,062	0.0%	45.85	100.0%	100.0%	113,062	0.0%
FY06	2,307,775	73,849	32,191	106,040	-6.2%	47.80	104.9%	99.9%	109,587	-3.1%
FY07	2,308,975	74,375	30,537	104,912	-7.2%	46.32	98.8%	100.0%	103,975	-8.0%
FY08	2,308,426	81,706	29,957	111,663	-1.2%	43.27	88.9%	100.1%	102,672	-9.2%
FY09	2,326,439	81,821	29,965	111,787	-1.1%	42.97	89.2%	100.5%	103,130	-8.8%
FY10	2,326,439	80,831	31,640	112,471	-0.5%	45.29	97.6%	100.0%	110,502	-2.3%
FY11	2,433,320	90,058	31,345	121,403	7.4%	43.68	89.2%	100.3%	111,767	-1.1%
FY12	2,443,351	70,805	31,036	101,842	-9.9%	49.02	105.7%	100.2%	105,960	-6.3%
FY13	2,446,059	88,850	32,537	121,387	7.4%	43.85	91.0%	99.7%	113,300	0.2%
FY14	2,448,864	92,099	30,742	122,841	8.6%	41.37	82.8%	97.8%	106,346	-5.9%
FY15	2,448,864	79,516	31,070	110,586	-2.2%	43.42	90.6%	99.3%	102,926	-9.0%
FY16	2,452,414	72,518	30,781	103,300	-8.6%	47.61	106.0%	100.3%	107,718	-4.7%
FY17	2,452,414	71,777	30,180	101,957	-9.8%	47.07	104.0%	99.9%	104,791	-7.3%
FY18	2,452,414	79,516	30,432	109,948	-2.8%	43.54	90.2%	101.2%	102,528	-9.3%
FY19	2,452,414	82,878	29,133	112,011	-0.9%	42.23	87.2%	99.4%	101,194	-10.5%
FY20	2,456,060	80,284	26,666	106,951	-5.4%	45.42	98.8%	99.3%	105,800	-6.4%
FY21	2,456,060	72,940	26,400	99,340	-12.1%	46.01	98.4%	99.8%	98,127	-13.2%
FY22	2,456,060	76,388	27,921	104,309	-7.7%	44.82	95.1%	99.6%	100,440	-11.2%
FY23	2,456,060	73,999	26,852	100,851	-10.8%	45.82	98.7%	100.2%	99,925	-11.6%
FY24	2,456,060	66,149	26,433	92,582	-18.1%	49.00	111.3%	97.6%	99,418	-12.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

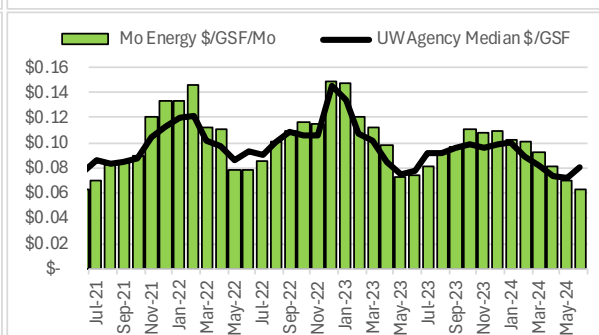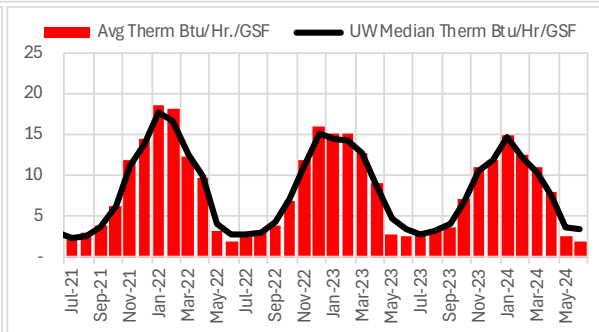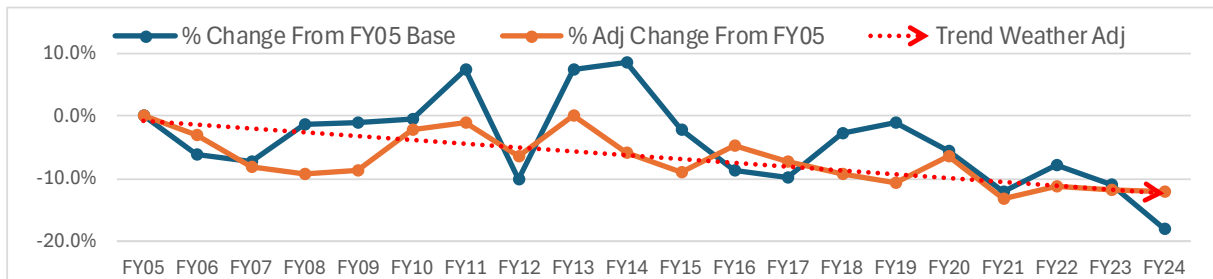

FY2024 UW-Superior State Facilities Energy Report

FY24 Electric kwh/GSF= 8.15			FY24 Therm/GSF = 1.01			FY24 Total Btu/GSF= 129,215			05-24 Thm -16.5%	
FY24 Electric \$/GSF= \$ 0.76			FY24 Thermal \$/GSF= \$ 0.52			FY24 Energy \$/GSF= \$ 1.28			05-24 kwh -9.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,076,728	131,188	30,821	162,010	0.0%	45.85	100.0%	100.0%	162,010	0.0%
FY06	1,100,416	113,499	29,731	143,231	-11.6%	47.80	103.5%	100.7%	147,463	-9.0%
FY07	1,100,416	121,638	29,318	150,955	-6.8%	46.32	99.9%	100.3%	150,898	-6.9%
FY08	1,100,416	128,998	29,891	158,890	-1.9%	43.27	92.6%	99.7%	149,235	-7.9%
FY09	1,100,416	127,933	30,306	158,239	-2.3%	42.97	92.6%	99.5%	148,585	-8.3%
FY10	1,032,741	134,981	33,276	168,257	3.9%	45.29	98.3%	99.6%	165,837	2.4%
FY11	1,032,741	142,386	32,616	175,002	8.0%	43.68	93.2%	99.6%	165,155	1.9%
FY12	1,086,193	119,692	34,618	154,310	-4.8%	49.02	104.9%	100.8%	160,409	-1.0%
FY13	1,088,749	125,807	33,202	159,009	-1.9%	43.85	92.8%	99.6%	149,765	-7.6%
FY14	1,101,473	143,147	31,176	174,323	7.6%	41.37	81.3%	99.6%	147,392	-9.0%
FY15	1,101,473	125,867	32,585	158,452	-2.2%	43.42	88.5%	99.3%	143,716	-11.3%
FY16	1,120,382	112,817	32,511	145,328	-10.3%	47.61	103.8%	100.2%	149,671	-7.6%
FY17	1,120,382	114,333	31,154	145,487	-10.2%	47.07	101.4%	100.1%	147,086	-9.2%
FY18	1,120,382	121,106	30,946	152,053	-6.1%	43.54	94.4%	99.9%	145,241	-10.4%
FY19	1,120,382	116,182	30,432	146,615	-9.5%	42.23	89.3%	99.5%	133,996	-17.3%
FY20	1,111,812	117,374	29,411	146,785	-9.4%	45.42	98.1%	99.6%	144,490	-10.8%
FY21	1,107,876	97,013	24,807	121,821	-24.8%	46.01	99.8%	99.8%	121,587	-25.0%
FY22	1,107,876	108,795	27,195	135,990	-16.1%	44.82	96.0%	98.9%	131,291	-19.0%
FY23	1,107,876	107,919	27,327	135,247	-16.5%	45.82	99.8%	100.2%	135,114	-16.6%
FY24	1,107,876	101,390	27,825	129,215	-20.2%	49.00	108.0%	100.7%	137,561	-15.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

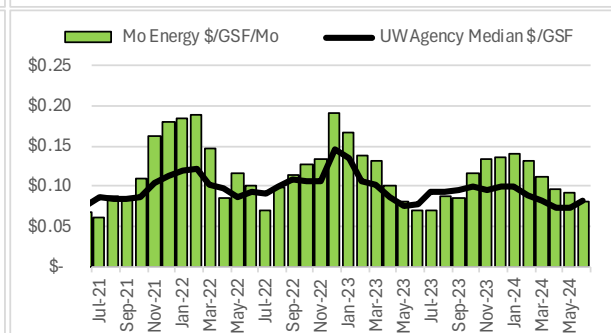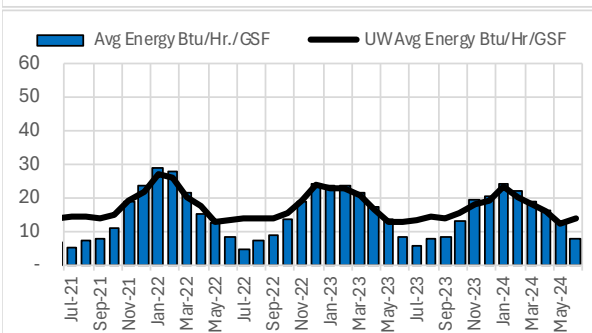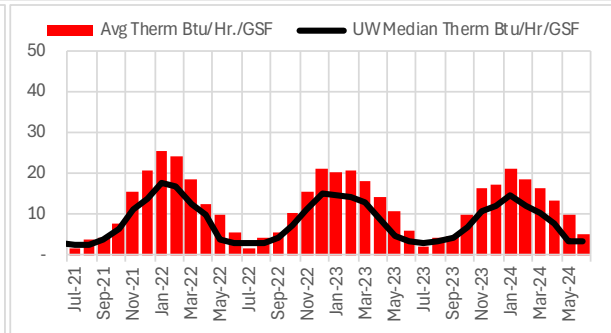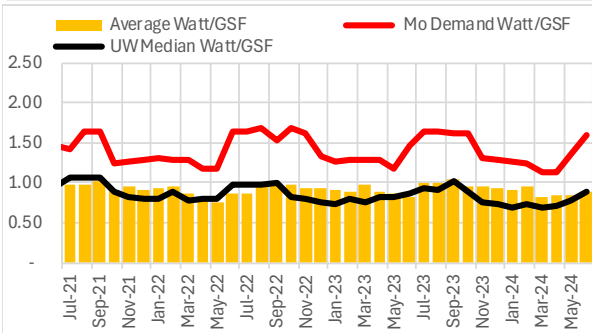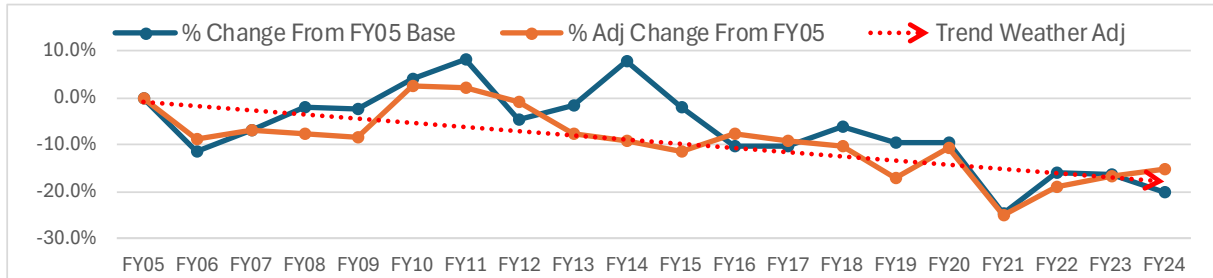

FY2024 UW-Whitewater State Facilities Energy Report

FY24 Electric kwh/GSF= 10.93			FY24 Therm/GSF = 0.95			FY24 Total Btu/GSF= 132,627		05-24 Thm -7.4%		
FY24 Electric \$/GSF= \$ 1.12			FY24 Thermal \$/GSF= \$ 0.35			FY24 Energy \$/GSF= \$ 1.48		05-24 kwh 2.4%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,558,663	110,212	35,656	145,867	0.0%	48.12	100.0%	100.0%	145,867	0.0%
FY06	2,642,094	108,536	35,654	144,190	-1.2%	48.65	96.5%	100.1%	140,438	-3.7%
FY07	2,531,040	94,691	38,580	133,272	-8.6%	47.46	98.1%	100.1%	131,540	-9.8%
FY08	2,535,623	88,592	38,164	126,756	-13.1%	46.19	92.5%	99.6%	119,961	-17.8%
FY09	2,535,623	95,991	37,999	133,991	-8.1%	45.66	93.6%	100.0%	127,822	-12.4%
FY10	2,714,423	90,988	38,106	129,094	-11.5%	47.10	98.0%	100.4%	127,399	-12.7%
FY11	2,922,323	93,720	38,257	131,976	-9.5%	46.81	94.2%	99.9%	126,471	-13.3%
FY12	2,930,608	85,675	37,935	123,611	-15.3%	51.51	103.9%	98.7%	126,465	-13.3%
FY13	2,942,875	98,566	37,566	136,132	-6.7%	47.29	96.6%	100.1%	132,851	-8.9%
FY14	2,942,875	109,922	38,307	148,229	1.6%	44.58	90.2%	99.6%	137,322	-5.9%
FY15	2,942,875	96,322	38,031	134,352	-7.9%	45.84	95.1%	100.1%	129,655	-11.1%
FY16	2,942,875	87,999	38,941	126,940	-13.0%	49.68	101.9%	99.4%	128,363	-12.0%
FY17	2,942,875	91,167	38,386	129,553	-11.2%	49.72	100.7%	99.0%	129,791	-11.0%
FY18	2,942,875	98,838	37,666	136,504	-6.4%	46.66	95.1%	100.7%	131,927	-9.6%
FY19	2,942,875	106,284	38,144	144,428	-1.0%	45.87	97.6%	100.9%	142,242	-2.5%
FY20	2,965,821	86,145	37,581	123,726	-15.2%	48.08	99.6%	99.7%	123,251	-15.5%
FY21	3,114,162	75,731	34,169	109,900	-24.7%	47.61	98.0%	100.0%	108,372	-25.7%
FY22	3,114,162	100,127	37,812	137,939	-5.4%	48.04	98.3%	99.1%	135,857	-6.9%
FY23	3,114,162	102,588	37,181	139,769	-4.2%	48.63	101.3%	99.6%	140,932	-3.4%
FY24	3,114,162	95,339	37,288	132,627	-9.1%	50.95	107.0%	97.9%	138,557	-5.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

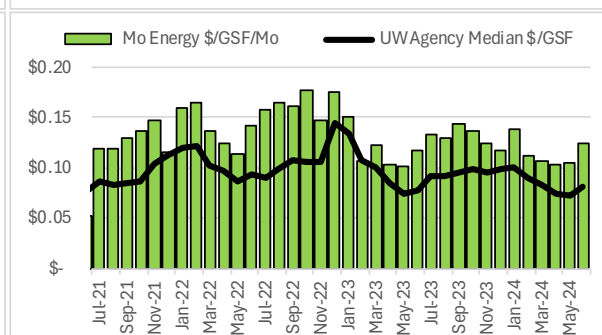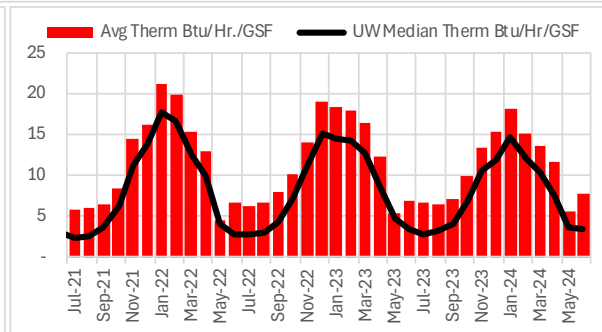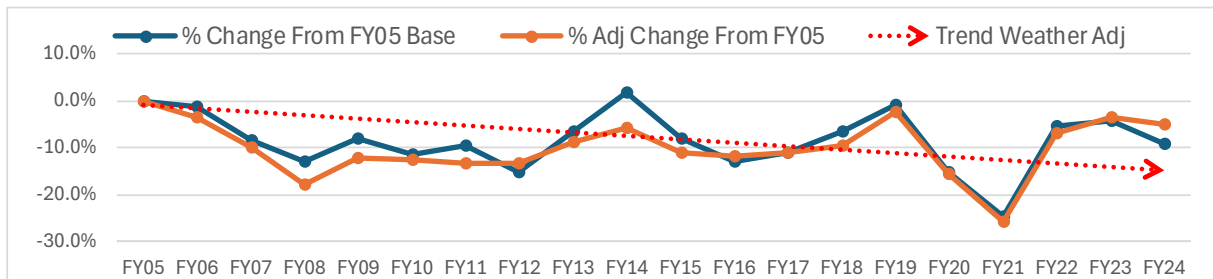

FY2024 UW-Platteville, Baraboo State Facilities Energy Report

FY24 Electric kwh/GSF= 6.17			FY24 Therm/GSF = 0.42			FY24 Total Btu/GSF= 63,221			05-24 Thm -25.1%	
FY24 Electric \$/GSF= \$ 0.68			FY24 Thermal \$/GSF= \$ 0.27			FY24 Energy \$/GSF= \$ 0.95			05-24 kwh -27.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	150,015	60,075	28,748	88,823	0.0%	48.12	100.0%	100.0%	88,823	0.0%
FY06	150,015	54,757	28,857	83,615	-5.9%	48.65	100.6%	99.2%	83,699	-5.8%
FY07	150,015	57,135	27,415	84,550	-4.8%	47.46	93.1%	99.7%	80,539	-9.3%
FY08	150,015	48,670	29,922	78,592	-11.5%	46.19	86.9%	99.9%	72,201	-18.7%
FY09	150,015	56,230	30,295	86,525	-2.6%	45.66	87.1%	100.2%	79,343	-10.7%
FY10	151,015	52,354	29,593	81,947	-7.7%	47.10	96.4%	100.1%	80,085	-9.8%
FY11	151,015	55,820	33,110	88,929	0.1%	46.81	84.7%	98.3%	79,805	-10.2%
FY12	151,015	52,615	34,488	87,103	-1.9%	51.51	108.5%	98.9%	91,185	2.7%
FY13	151,015	53,076	29,661	82,736	-6.9%	47.29	92.6%	98.9%	78,479	-11.6%
FY14	151,015	65,370	25,787	91,157	2.6%	44.58	86.3%	100.0%	82,195	-7.5%
FY15	151,015	65,936	25,972	91,909	3.5%	45.84	88.2%	99.2%	83,905	-5.5%
FY16	165,615	51,856	24,668	76,524	-13.8%	49.68	105.5%	99.5%	79,236	-10.8%
FY17	165,615	59,758	23,864	83,623	-5.9%	49.72	103.9%	98.6%	85,623	-3.6%
FY18	165,615	64,858	24,239	89,097	0.3%	46.66	93.7%	100.1%	85,040	-4.3%
FY19	165,615	71,254	25,068	96,321	8.4%	45.87	88.4%	99.9%	88,028	-0.9%
FY20	179,291	60,692	23,864	84,555	-4.8%	48.08	99.3%	99.4%	84,006	-5.4%
FY21	179,291	54,207	20,810	75,018	-15.5%	47.61	95.9%	98.3%	72,414	-18.5%
FY22	179,291	53,666	21,130	74,796	-15.8%	48.04	96.7%	98.8%	72,783	-18.1%
FY23	179,291	61,232	23,512	84,744	-4.6%	48.63	99.9%	99.8%	84,624	-4.7%
FY24	179,291	42,151	21,070	63,221	-28.8%	50.95	106.8%	98.9%	65,852	-25.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

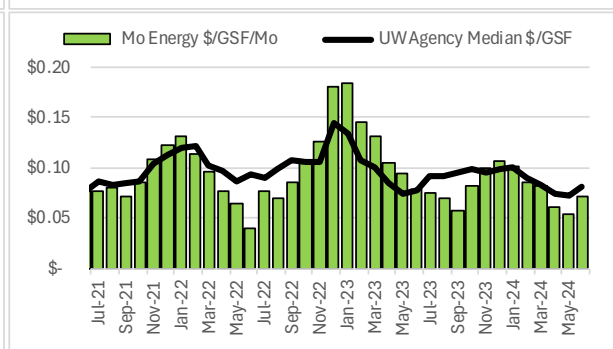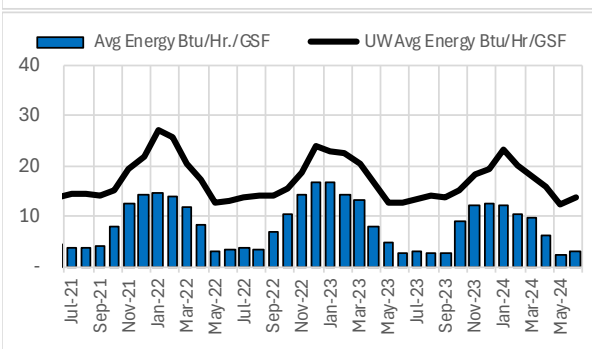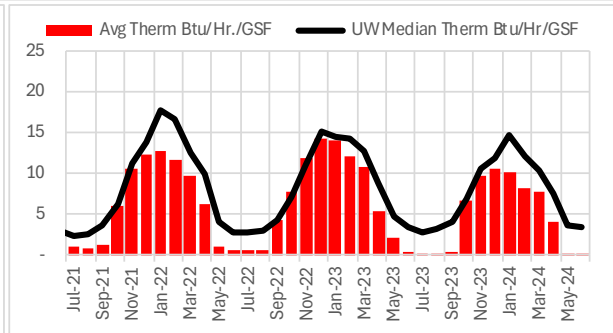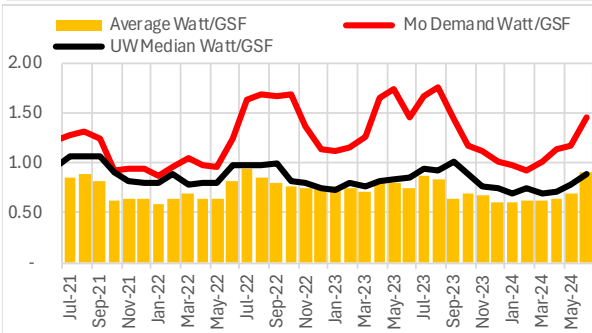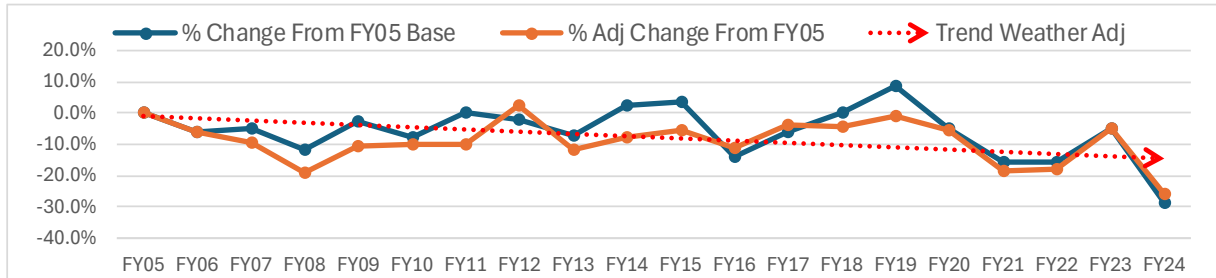

FY2024 UW-Eau Claire, Barron State Facilities Energy Report *FY24Mo Elec = FY23Mo Elec

FY24 Electric kwh/GSF= 6.31			FY24 Therm/GSF = 0.70			FY24 Total Btu/GSF= 91,357			05-24 Thm 14.5%	
FY24 Electric \$/GSF= \$ 0.61			FY24 Thermal \$/GSF= \$ 0.40			FY24 Energy \$/GSF= \$ 1.01			05-24 kwh -13.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	146,683	68,961	24,959	93,920	0.0%	45.85	100.0%	100.0%	93,920	0.0%
FY06	146,683	50,219	24,449	74,668	-20.5%	47.80	104.1%	101.8%	77,166	-17.8%
FY07	146,683	59,577	28,442	88,019	-6.3%	46.32	98.6%	100.7%	87,395	-6.9%
FY08	146,683	62,206	26,231	88,437	-5.8%	43.27	83.5%	101.4%	78,501	-16.4%
FY09	146,683	60,882	25,582	86,463	-7.9%	42.97	84.7%	100.5%	77,248	-17.8%
FY10	146,683	55,335	24,564	79,899	-14.9%	45.29	98.7%	99.8%	79,114	-15.8%
FY11	146,683	65,691	25,032	90,723	-3.4%	43.68	86.5%	99.8%	81,767	-12.9%
FY12	146,683	50,835	23,808	74,642	-20.5%	49.02	107.4%	100.6%	78,537	-16.4%
FY13	146,683	69,539	22,747	92,286	-1.7%	43.85	91.7%	99.6%	86,387	-8.0%
FY14	146,683	68,763	22,880	91,642	-2.4%	41.37	76.9%	100.5%	75,845	-19.2%
FY15	146,683	64,978	25,062	90,040	-4.1%	43.42	92.0%	99.3%	84,648	-9.9%
FY16	146,683	60,959	22,912	83,872	-10.7%	47.61	105.2%	99.6%	86,983	-7.4%
FY17	146,683	63,058	17,913	80,971	-13.8%	47.07	102.7%	99.9%	82,635	-12.0%
FY18	146,683	71,792	19,729	91,521	-2.6%	43.54	86.1%	99.4%	81,388	-13.3%
FY19	146,683	75,451	19,621	95,072	1.2%	42.23	82.5%	98.7%	81,645	-13.1%
FY20	146,683	67,954	19,888	87,842	-6.5%	45.42	96.6%	99.8%	85,474	-9.0%
FY21	146,683	71,797	21,565	93,361	-0.6%	46.01	98.3%	99.1%	91,976	-2.1%
FY22	146,683	79,668	23,465	103,133	9.8%	44.82	94.5%	97.1%	98,104	4.5%
FY23	146,683	75,377	21,551	96,928	3.2%	45.82	99.9%	99.3%	96,746	3.0%
FY24	146,683	69,806	21,551	91,357	-2.7%	49.00	113.1%	100.4%	100,575	7.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

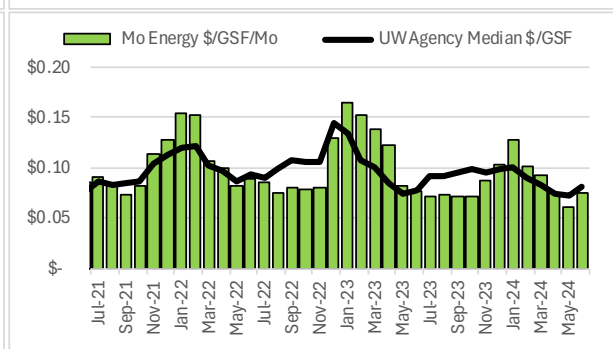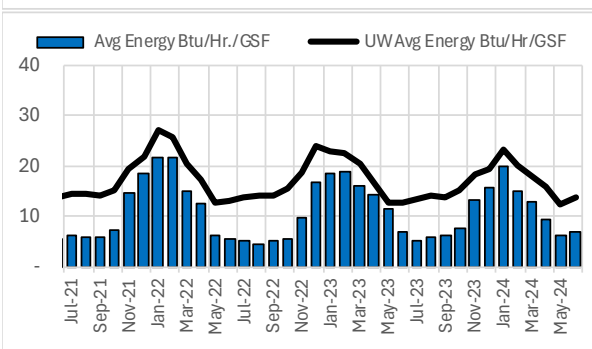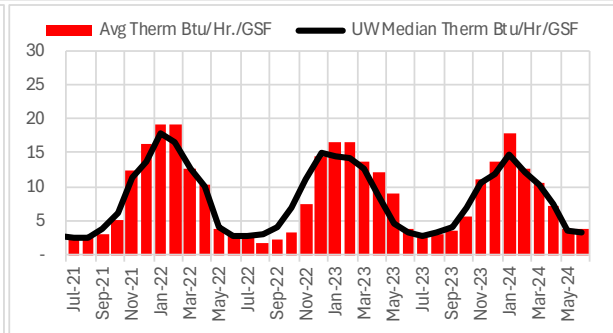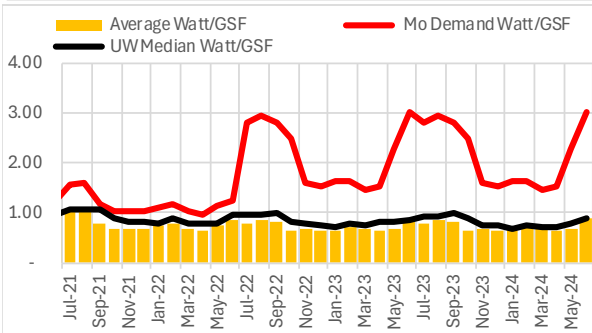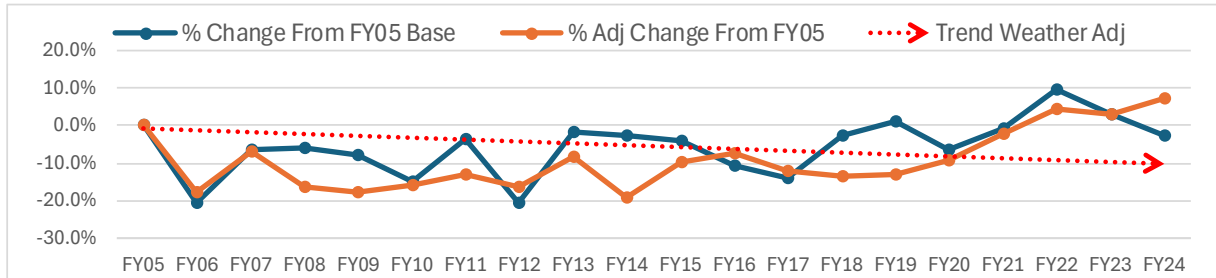

FY2024 UW-Oshkosh, Fond du Lac State Facilities Energy Report

FY24 Electric kwh/GSF= 4.91			FY24 Therm/GSF = 0.34			FY24 Total Btu/GSF= 50,742			05-24 Thm -32.1%	
FY24 Electric \$/GSF= \$ 0.31			FY24 Thermal \$/GSF= \$ 0.22			FY24 Energy \$/GSF= \$ 0.52			05-24 kwh -55.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	194,077	57,697	36,356	94,053	0.0%	45.94	100.0%	100.0%	94,053	0.0%
FY06	194,077	44,930	30,608	75,537	-19.7%	47.26	102.2%	98.9%	76,193	-19.0%
FY07	194,077	36,836	24,766	61,603	-34.5%	46.64	102.0%	100.2%	62,366	-33.7%
FY08	194,077	41,626	25,281	66,908	-28.9%	45.02	91.8%	99.7%	63,412	-32.6%
FY09	194,077	42,786	25,535	68,320	-27.4%	43.47	87.6%	99.5%	62,898	-33.1%
FY10	194,077	36,351	20,926	57,277	-39.1%	45.98	101.4%	99.7%	57,698	-38.7%
FY11	194,077	39,422	21,010	60,433	-35.7%	44.58	91.7%	99.9%	57,159	-39.2%
FY12	194,077	31,245	19,651	50,896	-45.9%	49.86	114.4%	99.0%	55,210	-41.3%
FY13	194,077	40,447	19,644	60,091	-36.1%	45.29	95.5%	99.7%	58,208	-38.1%
FY14	194,077	44,739	19,695	64,434	-31.5%	41.95	85.7%	101.2%	58,263	-38.1%
FY15	194,077	44,074	18,942	63,016	-33.0%	43.98	94.9%	99.4%	60,646	-35.5%
FY16	194,077	39,516	17,317	56,833	-39.6%	48.11	106.5%	99.6%	59,338	-36.9%
FY17	194,077	42,762	18,639	61,401	-34.7%	48.65	114.1%	100.7%	67,561	-28.2%
FY18	194,077	50,729	18,106	68,835	-26.8%	45.41	95.4%	99.4%	66,381	-29.4%
FY19	194,077	53,974	18,275	72,249	-23.2%	44.90	96.9%	99.3%	70,428	-25.1%
FY20	194,077	41,080	16,604	57,684	-38.7%	46.40	99.9%	99.8%	57,621	-38.7%
FY21	194,077	38,621	13,573	52,194	-44.5%	47.28	103.1%	99.2%	53,267	-43.4%
FY22	194,077	42,531	15,464	57,995	-38.3%	46.76	100.2%	99.7%	58,040	-38.3%
FY23	194,077	38,716	15,119	53,835	-42.8%	47.58	104.9%	99.3%	55,632	-40.9%
FY24	194,077	33,986	16,756	50,742	-46.0%	49.93	115.2%	96.5%	55,327	-41.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

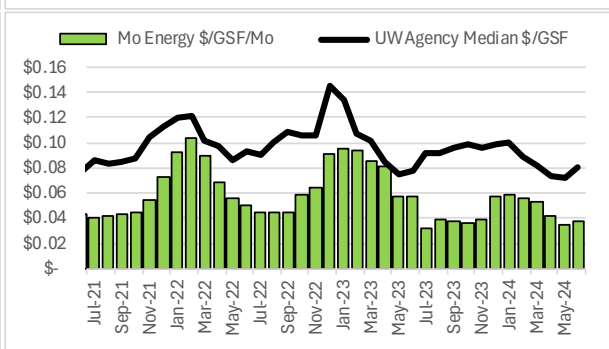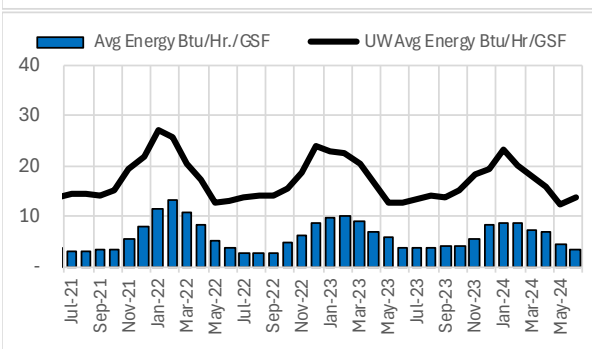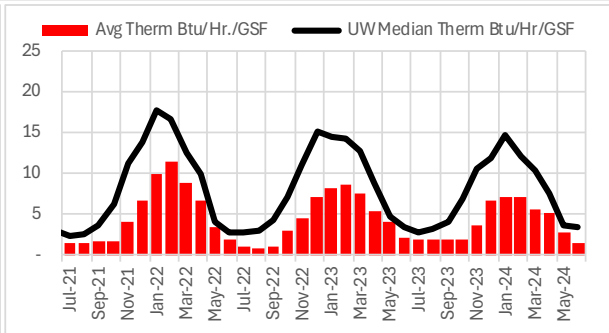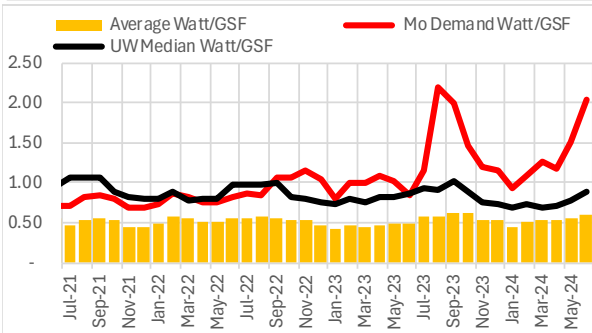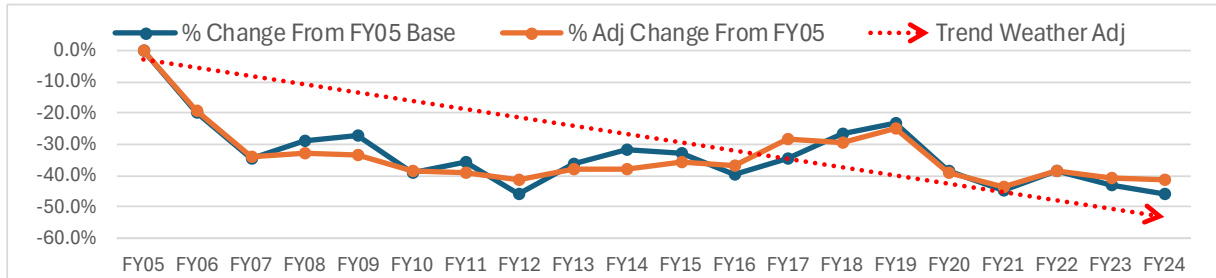

FY2024 UW-Oshkosh, Fox Cities State Facilities Energy Report

FY24 Electric kwh/GSF= 7.03			FY24 Therm/GSF = 0.20			FY24 Total Btu/GSF= 43,726			05-24 Thm -71.5%	
FY24 Electric \$/GSF= \$ 0.84			FY24 Thermal \$/GSF= \$ 0.10			FY24 Energy \$/GSF= \$ 0.93			05-24 kwh -28.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	203,270	80,764	33,160	113,923	0.0%	45.94	100.0%	100.0%	113,923	0.0%
FY06	203,270	65,846	39,731	105,577	-7.3%	47.26	102.6%	99.2%	106,933	-6.1%
FY07	203,270	68,865	39,388	108,253	-5.0%	46.64	101.6%	99.9%	109,305	-4.1%
FY08	202,478	74,578	42,567	117,146	2.8%	45.02	94.2%	100.2%	112,900	-0.9%
FY09	272,978	59,785	36,633	96,419	-15.4%	43.47	90.4%	101.4%	91,179	-20.0%
FY10	274,078	56,536	41,976	98,513	-13.5%	45.98	100.1%	100.4%	98,734	-13.3%
FY11	274,078	57,431	42,594	100,025	-12.2%	44.58	93.5%	99.6%	96,106	-15.6%
FY12	274,078	54,816	44,063	98,879	-13.2%	49.86	110.6%	98.0%	103,786	-8.9%
FY13	274,078	65,656	46,393	112,049	-1.6%	45.29	98.2%	100.0%	110,814	-2.7%
FY14	274,078	69,664	47,498	117,161	2.8%	41.95	90.6%	99.5%	110,384	-3.1%
FY15	274,078	53,826	41,276	95,102	-16.5%	43.98	95.4%	100.0%	92,631	-18.7%
FY16	274,078	35,864	34,150	70,014	-38.5%	48.11	107.4%	99.6%	72,528	-36.3%
FY17	274,078	22,230	31,080	53,310	-53.2%	48.65	113.2%	99.3%	56,026	-50.8%
FY18	274,078	40,306	32,886	73,192	-35.8%	45.41	94.4%	100.0%	70,935	-37.7%
FY19	274,078	39,969	37,308	77,277	-32.2%	44.90	92.5%	99.9%	74,218	-34.9%
FY20	277,988	39,363	32,504	71,867	-36.9%	46.40	100.1%	99.9%	71,881	-36.9%
FY21	277,988	40,571	26,488	67,058	-41.1%	47.28	103.4%	99.0%	68,174	-40.2%
FY22	277,988	42,031	28,245	70,275	-38.3%	46.76	99.4%	98.6%	69,634	-38.9%
FY23	277,988	57,470	26,728	84,198	-26.1%	47.58	106.8%	98.7%	87,735	-23.0%
FY24	277,988	19,726	24,000	43,726	-61.6%	49.93	116.8%	98.3%	46,637	-59.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

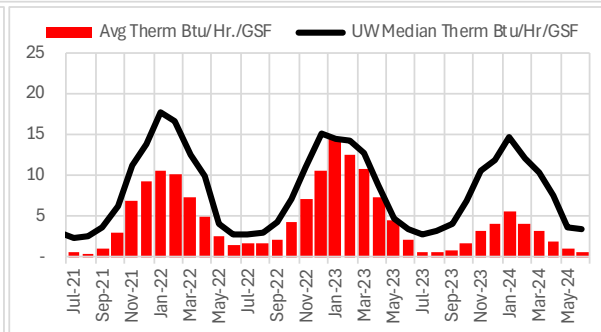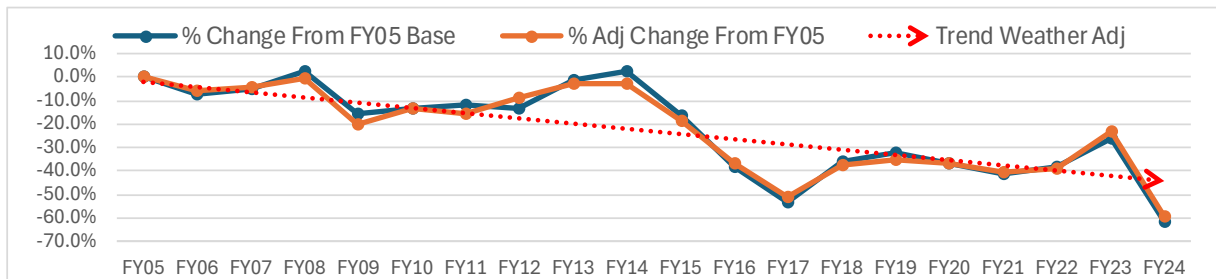

FY2024 UW-Green Bay, Manitowoc State Facilities Energy Report

FY24 Electric kwh/GSF= 5.03			FY24 Therm/GSF = 0.40			FY24 Total Btu/GSF= 56,980			05-24 Thm -6.3%	
FY24 Electric \$/GSF= \$ 0.44			FY24 Thermal \$/GSF= \$ 0.23			FY24 Energy \$/GSF= \$ 0.68			05-24 kwh -34.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	125,045	48,682	26,306	74,988	0.0%	45.94	100.0%	100.0%	74,988	0.0%
FY06	125,045	42,486	24,105	66,591	-11.2%	47.26	102.3%	100.1%	67,576	-9.9%
FY07	125,045	40,784	21,881	62,665	-16.4%	46.64	101.4%	100.2%	63,296	-15.6%
FY08	125,045	41,371	22,197	63,568	-15.2%	45.02	92.0%	101.2%	60,537	-19.3%
FY09	125,045	44,475	22,531	67,006	-10.6%	43.47	88.0%	100.4%	61,753	-17.6%
FY10	125,045	38,761	21,552	60,313	-19.6%	45.98	102.5%	98.8%	61,011	-18.6%
FY11	125,045	43,806	23,147	66,953	-10.7%	44.58	91.2%	101.0%	63,341	-15.5%
FY12	125,045	35,601	23,632	59,232	-21.0%	49.86	114.3%	100.2%	64,384	-14.1%
FY13	125,045	48,234	23,881	72,115	-3.8%	45.29	93.9%	99.8%	69,108	-7.8%
FY14	125,045	52,936	23,815	76,751	2.4%	41.95	80.8%	99.6%	66,526	-11.3%
FY15	125,045	45,771	22,589	68,359	-8.8%	43.98	95.0%	99.7%	66,023	-12.0%
FY16	125,045	41,535	22,980	64,516	-14.0%	48.11	106.5%	99.7%	67,131	-10.5%
FY17	125,045	41,189	24,019	65,208	-13.0%	48.65	111.8%	100.6%	70,234	-6.3%
FY18	125,045	45,726	19,342	65,068	-13.2%	45.41	93.9%	99.8%	62,225	-17.0%
FY19	125,045	52,954	20,681	73,635	-1.8%	44.90	94.9%	100.2%	70,976	-5.4%
FY20	125,045	44,385	17,513	61,898	-17.5%	46.40	100.7%	100.1%	62,240	-17.0%
FY21	125,045	47,080	16,032	63,112	-15.8%	47.28	103.9%	100.2%	64,980	-13.3%
FY22	125,045	48,500	18,004	66,504	-11.3%	46.76	97.5%	99.2%	65,153	-13.1%
FY23	125,045	52,269	18,004	70,273	-6.3%	47.58	105.7%	100.3%	73,293	-2.3%
FY24	125,045	39,800	17,180	56,980	-24.0%	49.93	114.6%	100.2%	62,846	-16.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

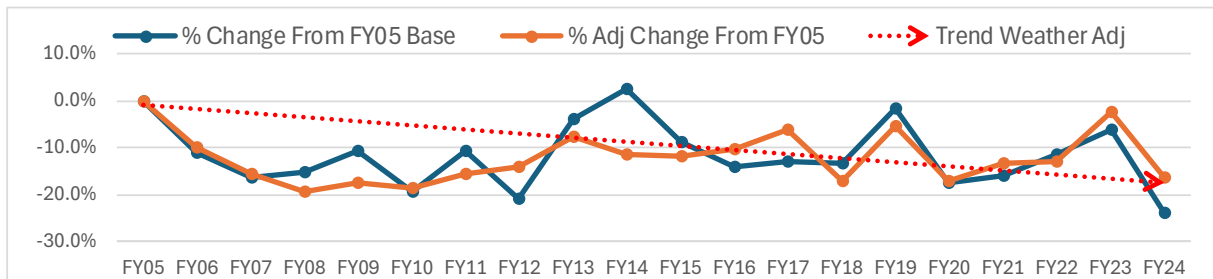

FY2024 UW-Stevens Point, Wausau State Facilities Energy Report

FY24 Electric kwh/GSF= 5.43			FY24 Therm/GSF = 0.51			FY24 Total Btu/GSF= 69,962			05-24 Thm -29.4%	
FY24 Electric \$/GSF= \$ 0.61			FY24 Thermal \$/GSF= \$ 0.21			FY24 Energy \$/GSF= \$ 0.83			05-24 kwh -48.7%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	286,421	83,471	36,007	119,478	0.0%	44.50	100.0%	100.0%	119,478	0.0%
FY06	286,421	75,819	35,945	111,764	-6.5%	46.21	103.7%	99.3%	114,354	-4.3%
FY07	286,421	82,286	42,725	125,011	4.6%	44.70	98.7%	99.6%	123,762	3.6%
FY08	290,650	98,146	35,457	133,604	11.8%	42.68	96.6%	100.7%	130,531	9.3%
FY09	290,650	79,697	33,568	113,265	-5.2%	42.20	93.7%	99.5%	108,029	-9.6%
FY10	327,695	66,441	31,002	97,443	-18.4%	45.07	102.4%	99.9%	99,030	-17.1%
FY11	327,695	69,285	30,634	99,919	-16.4%	43.03	94.8%	100.9%	96,564	-19.2%
FY12	327,695	59,969	31,194	91,164	-23.7%	48.08	110.8%	98.4%	97,116	-18.7%
FY13	327,695	64,326	26,851	91,177	-23.7%	43.78	96.5%	99.9%	88,873	-25.6%
FY14	327,695	62,455	26,642	89,097	-25.4%	40.42	83.0%	99.5%	78,340	-34.4%
FY15	327,695	66,883	27,637	94,520	-20.9%	42.00	92.9%	99.3%	89,593	-25.0%
FY16	327,695	49,833	25,793	75,626	-36.7%	47.49	110.0%	98.2%	80,151	-32.9%
FY17	327,695	52,758	24,624	77,383	-35.2%	45.96	103.7%	99.9%	79,331	-33.6%
FY18	327,695	50,451	24,061	74,512	-37.6%	43.03	91.2%	99.6%	69,981	-41.4%
FY19	327,695	63,910	23,627	87,537	-26.7%	41.93	89.3%	99.2%	80,543	-32.6%
FY20	327,695	61,484	20,329	81,813	-31.5%	43.74	98.2%	100.7%	80,840	-32.3%
FY21	327,695	53,211	19,522	72,733	-39.1%	45.40	101.5%	99.2%	73,358	-38.6%
FY22	327,695	58,661	19,583	78,244	-34.5%	45.76	97.2%	97.9%	76,222	-36.2%
FY23	327,695	63,783	19,113	82,896	-30.6%	46.29	105.1%	99.4%	86,012	-28.0%
FY24	327,695	51,418	18,544	69,962	-41.4%	48.13	114.6%	99.6%	77,412	-35.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

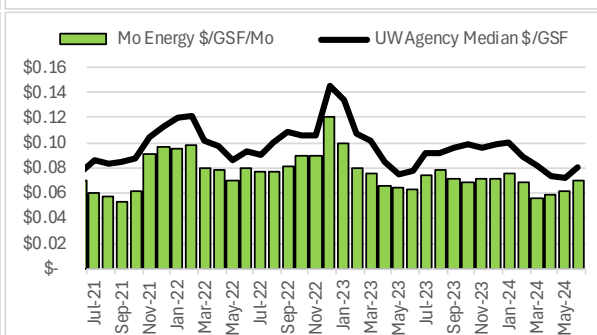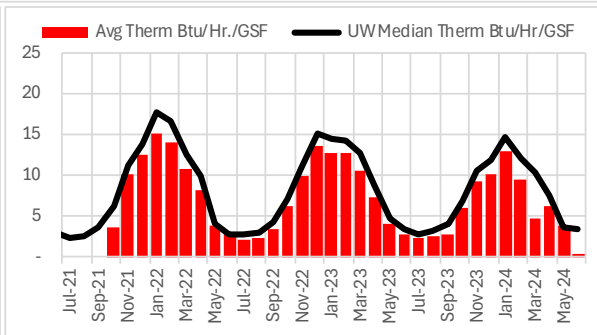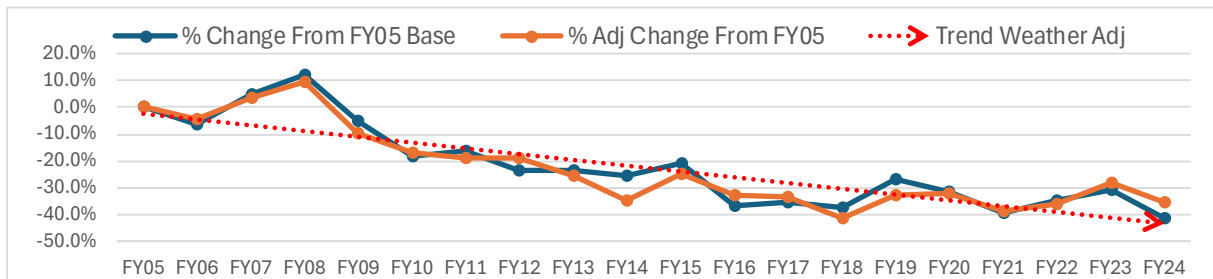

FY2024 UW-Green Bay, Marinette State Facilities Energy Report

FY24 Electric kwh/GSF= 1.09			FY24 Therm/GSF = 0.37			FY24 Total Btu/GSF= 40,296			05-24 Thm -56.7%	
FY24 Electric \$/GSF= \$ 0.14			FY24 Thermal \$/GSF= \$ 0.18			FY24 Energy \$/GSF= \$ 0.33			05-24 kwh -88.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	103,778	97,916	33,580	131,496	0.0%	45.94	100.0%	100.0%	131,496	0.0%
FY06	103,778	84,635	30,881	115,517	-12.2%	47.26	101.9%	100.2%	117,148	-10.9%
FY07	103,778	86,211	32,103	118,314	-10.0%	46.64	99.8%	100.1%	118,137	-10.2%
FY08	102,740	82,819	30,750	113,569	-13.6%	45.02	92.7%	99.4%	107,296	-18.4%
FY09	102,740	89,463	30,381	119,843	-8.9%	43.47	87.1%	99.5%	108,123	-17.8%
FY10	107,988	74,977	27,787	102,764	-21.8%	45.98	100.2%	99.2%	102,723	-21.9%
FY11	107,988	87,316	28,818	116,134	-11.7%	44.58	91.0%	99.9%	108,255	-17.7%
FY12	107,988	71,455	28,073	99,528	-24.3%	49.86	109.6%	101.7%	106,892	-18.7%
FY13	107,988	80,514	28,424	108,938	-17.2%	45.29	94.2%	99.5%	104,132	-20.8%
FY14	107,988	95,636	26,299	121,935	-7.3%	41.95	83.4%	97.9%	105,521	-19.8%
FY15	107,988	89,052	22,949	112,001	-14.8%	43.98	91.6%	100.2%	104,535	-20.5%
FY16	107,988	77,780	21,608	99,388	-24.4%	48.11	106.8%	99.9%	104,647	-20.4%
FY17	107,988	81,248	21,027	102,275	-22.2%	48.65	107.4%	100.2%	108,357	-17.6%
FY18	107,988	85,885	22,217	108,102	-17.8%	45.41	94.4%	99.2%	103,114	-21.6%
FY19	107,988	101,099	23,790	124,889	-5.0%	44.90	93.8%	99.2%	118,456	-9.9%
FY20	139,818	70,034	16,695	86,729	-34.0%	46.40	98.5%	99.8%	85,624	-34.9%
FY21	139,818	68,551	14,815	83,366	-36.6%	47.28	103.3%	101.0%	85,776	-34.8%
FY22	139,818	71,404	16,326	87,730	-33.3%	46.76	99.6%	99.6%	87,404	-33.5%
FY23	139,818	70,537	14,387	84,924	-35.4%	47.58	104.6%	99.8%	88,174	-32.9%
FY24	139,818	36,572	3,724	40,296	-69.4%	49.93	116.0%	103.3%	46,279	-64.8%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

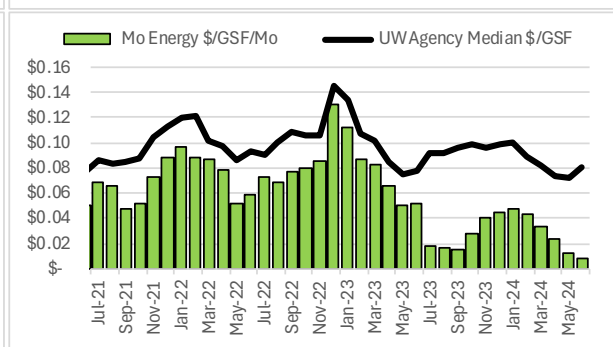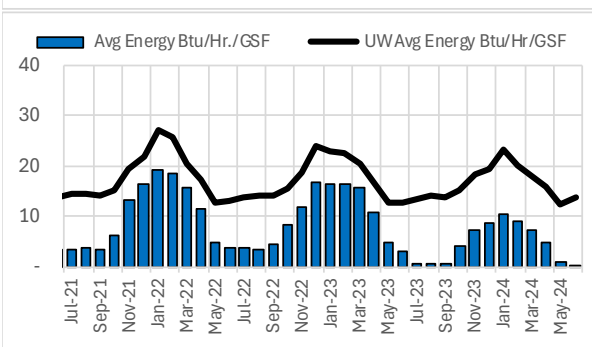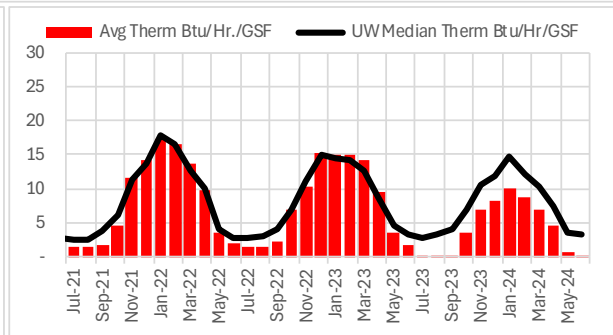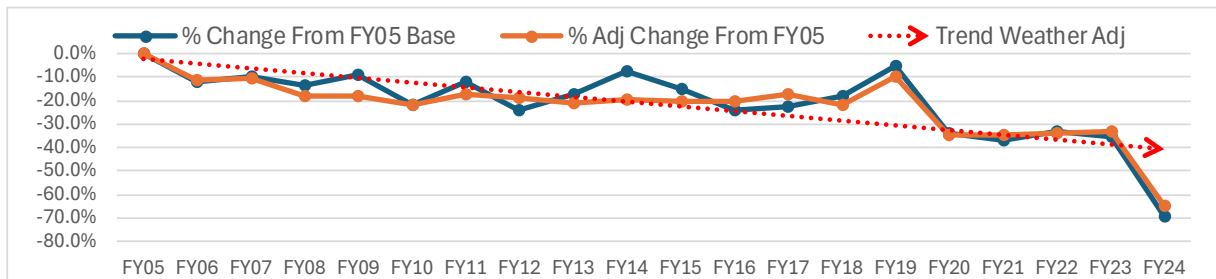

FY2024 UW-Stevens Point, Marshfield State Facilities Energy Report

FY24 Electric kwh/GSF= 8.77			FY24 Therm/GSF = 0.78			FY24 Total Btu/GSF= 107,867			05-24 Thm 18.5%	
FY24 Electric \$/GSF= \$ 0.84			FY24 Thermal \$/GSF= \$ 0.41			FY24 Energy \$/GSF= \$ 1.24			05-24 kwh 0.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	145,016	74,182	29,668	103,850	0.0%	44.50	100.0%	100.0%	103,850	0.0%
FY06	145,016	58,572	30,750	89,322	-14.0%	46.21	103.0%	99.6%	90,940	-12.4%
FY07	145,016	68,277	29,734	98,011	-5.6%	44.70	97.7%	99.9%	96,380	-7.2%
FY08	141,598	69,599	27,941	97,540	-6.1%	42.68	88.2%	100.3%	89,382	-13.9%
FY09	136,616	73,370	30,941	104,311	0.4%	42.20	86.7%	100.4%	94,657	-8.9%
FY10	149,996	59,028	27,930	86,958	-16.3%	45.07	101.1%	99.4%	87,438	-15.8%
FY11	149,996	67,684	28,222	95,906	-7.6%	43.03	90.8%	100.0%	89,674	-13.7%
FY12	149,996	54,485	27,409	81,894	-21.1%	48.08	108.2%	100.0%	86,381	-16.8%
FY13	149,996	68,181	30,344	98,525	-5.1%	43.78	94.5%	100.1%	94,830	-8.7%
FY14	149,996	81,584	30,211	111,795	7.7%	40.42	84.3%	100.3%	99,102	-4.6%
FY15	149,996	75,601	28,584	104,186	0.3%	42.00	90.5%	99.7%	96,891	-6.7%
FY16	149,996	63,764	31,491	95,255	-8.3%	47.49	108.5%	99.2%	100,387	-3.3%
FY17	149,996	69,976	32,102	102,078	-1.7%	45.96	104.4%	99.2%	104,874	1.0%
FY18	149,996	72,862	25,802	98,664	-5.0%	43.03	91.7%	99.2%	92,453	-11.0%
FY19	149,996	73,596	24,235	97,831	-5.8%	41.93	88.7%	99.6%	89,403	-13.9%
FY20	153,555	64,446	21,331	85,777	-17.4%	43.74	96.2%	101.0%	83,512	-19.6%
FY21	153,555	75,608	26,844	102,452	-1.3%	45.40	99.0%	99.4%	101,531	-2.2%
FY22	153,555	84,641	30,357	114,998	10.7%	45.76	97.7%	96.5%	112,027	7.9%
FY23	153,555	83,116	24,858	107,974	4.0%	46.29	102.3%	99.2%	109,679	5.6%
FY24	153,555	77,944	29,923	107,867	3.9%	48.13	112.8%	99.6%	117,730	13.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

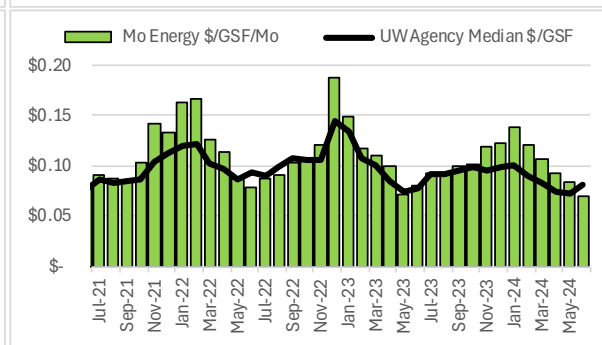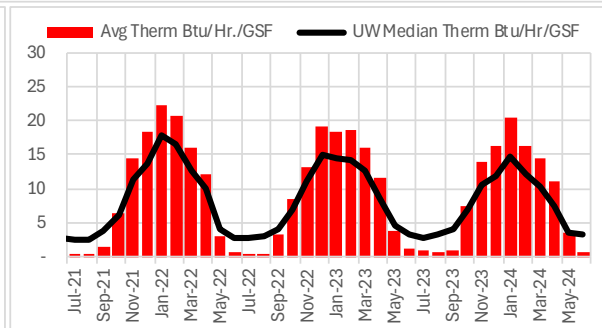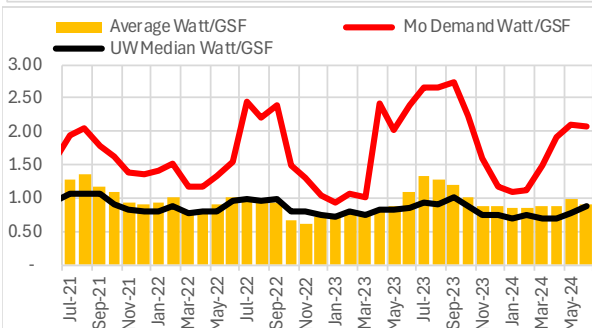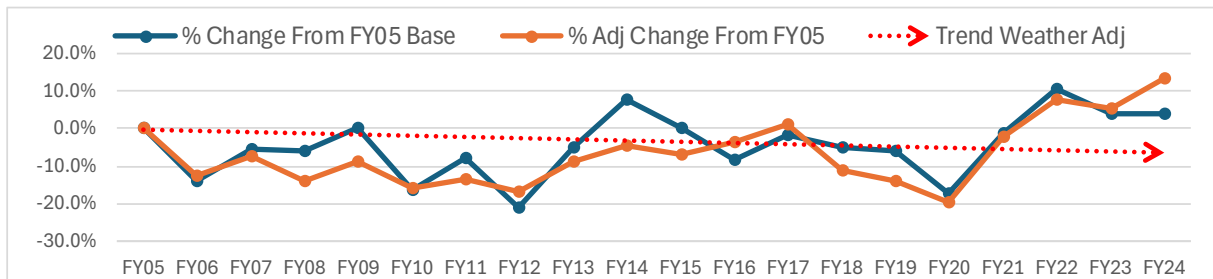

FY2024 UW-Platteville, Richland State Facilities Energy Report

FY24 Electric kwh/GSF= FY24 Electric \$/GSF=			FY24 Therm/GSF = FY24 Thermal \$/GSF=			FY24 Total Btu/GSF= FY24 Energy \$/GSF=			05-24 Thm 05-24 kwh	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	95,461	84,023	32,229	116,252	0.0%	45.85	100.0%	100.0%	116,252	0.0%
FY06	95,461	61,755	33,997	95,752	-17.6%	47.80	104.5%	99.1%	98,219	-15.5%
FY07	95,461	73,106	33,885	106,991	-8.0%	46.32	99.4%	99.1%	106,204	-8.6%
FY08	101,990	63,338	30,431	93,768	-19.3%	43.27	88.1%	98.5%	85,749	-26.2%
FY09	101,900	66,571	18,400	84,971	-26.9%	42.97	85.5%	99.0%	75,143	-35.4%
FY10	108,760	49,298	17,232	66,530	-42.8%	45.29	95.6%	100.0%	64,366	-44.6%
FY11	108,760	43,371	17,330	60,701	-47.8%	43.68	84.2%	98.8%	53,629	-53.9%
FY12	108,760	41,968	17,345	59,313	-49.0%	49.02	110.0%	100.5%	63,581	-45.3%
FY13	108,760	60,556	39,069	99,626	-14.3%	43.85	89.2%	100.0%	93,092	-19.9%
FY14	108,760	78,408	39,020	117,429	1.0%	41.37	80.1%	98.6%	101,254	-12.9%
FY15	108,760	73,526	35,442	108,968	-6.3%	43.42	91.1%	100.4%	102,575	-11.8%
FY16	108,760	56,166	36,567	92,733	-20.2%	47.61	106.9%	99.9%	96,600	-16.9%
FY17	108,760	54,662	32,340	87,002	-25.2%	47.07	106.0%	98.7%	89,852	-22.7%
FY18	108,760	55,612	29,696	85,309	-26.6%	43.54	81.9%	99.0%	74,926	-35.5%
FY19	108,760	63,218	30,657	93,875	-19.2%	42.23	81.9%	100.0%	82,416	-29.1%
FY20	104,825	77,195	28,826	106,022	-8.8%	45.42	96.1%	99.8%	102,965	-11.4%
FY21	104,825	92,018	26,709	118,727	2.1%	46.01	94.5%	98.5%	113,223	-2.6%
FY22	104,825	74,001	25,845	99,847	-14.1%	44.82	92.3%	98.6%	93,756	-19.4%
FY23	104,825	60,314	25,638	85,952	-26.1%	45.82	94.9%	100.2%	82,898	-28.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

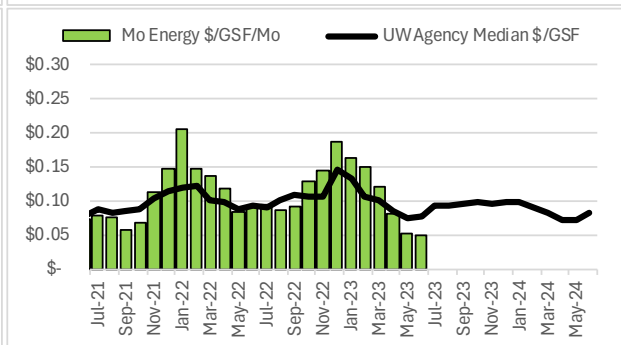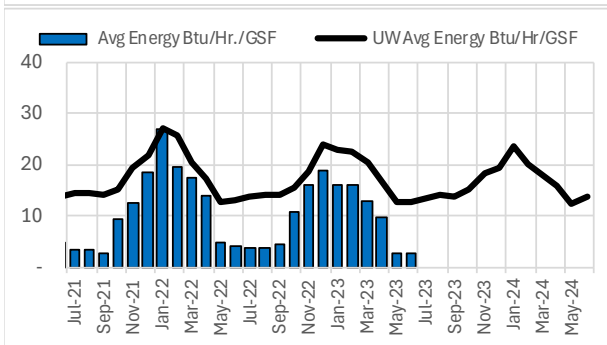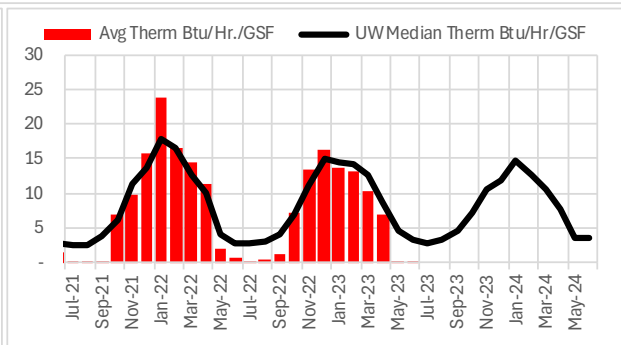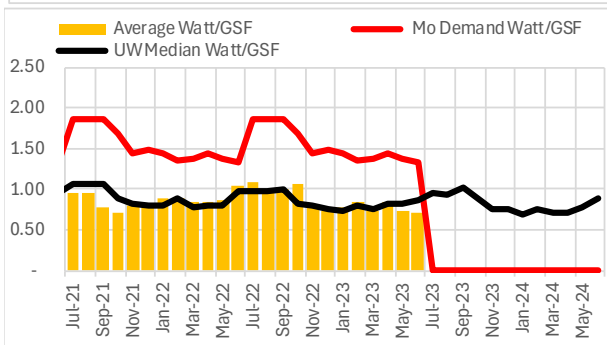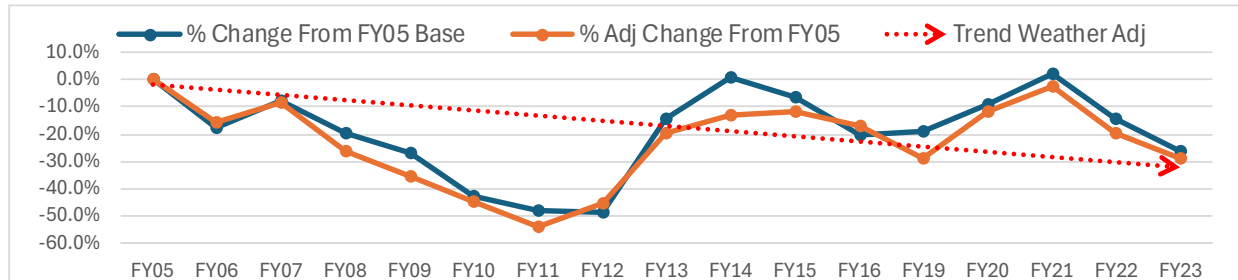

FY2024 UW-Whitewater, Rock State Facilities Energy Report

FY24 Electric kwh/GSF= 5.09			FY24 Therm/GSF = 0.43			FY24 Total Btu/GSF= 59,940			05-24 Thm -2.7%	
FY24 Electric \$/GSF= \$ 0.66			FY24 Thermal \$/GSF= \$ 0.21			FY24 Energy \$/GSF= \$ 0.87			05-24 kwh -31.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	145,560	48,489	24,956	73,445	0.0%	48.12	100.0%	100.0%	73,445	0.0%
FY06	145,560	43,901	24,404	68,306	-7.0%	48.65	98.5%	99.4%	67,513	-8.1%
FY07	145,560	45,778	24,629	70,407	-4.1%	47.46	94.9%	99.6%	67,974	-7.4%
FY08	185,625	48,518	21,252	69,770	-5.0%	46.19	84.2%	98.0%	61,713	-16.0%
FY09	185,625	61,813	19,134	80,947	10.2%	45.66	87.4%	100.6%	73,247	-0.3%
FY10	191,592	53,702	19,567	73,268	-0.2%	47.10	94.3%	101.0%	70,388	-4.2%
FY11	191,592	55,115	18,398	73,513	0.1%	46.81	93.3%	99.0%	69,616	-5.2%
FY12	191,592	49,687	19,441	69,128	-5.9%	51.51	107.5%	97.5%	72,383	-1.4%
FY13	191,592	52,582	18,632	71,214	-3.0%	47.29	93.7%	99.1%	67,730	-7.8%
FY14	191,592	56,742	18,717	75,459	2.7%	44.58	80.2%	99.5%	64,148	-12.7%
FY15	191,592	55,612	18,293	73,905	0.6%	45.84	91.3%	101.0%	69,265	-5.7%
FY16	191,592	46,394	18,347	64,741	-11.9%	49.68	106.0%	98.5%	67,271	-8.4%
FY17	191,592	48,164	16,112	64,276	-12.5%	49.72	105.7%	96.9%	66,539	-9.4%
FY18	191,592	49,771	16,013	65,783	-10.4%	46.66	92.6%	100.5%	62,172	-15.3%
FY19	191,592	58,569	15,608	74,177	1.0%	45.87	92.9%	99.9%	69,996	-4.7%
FY20	191,592	53,489	14,263	67,751	-7.8%	48.08	99.8%	99.1%	67,499	-8.1%
FY21	191,592	40,889	10,760	51,649	-29.7%	47.61	96.0%	98.0%	49,788	-32.2%
FY22	191,592	40,915	11,407	52,322	-28.8%	48.04	93.5%	98.0%	49,454	-32.7%
FY23	191,592	45,174	17,377	62,550	-14.8%	48.63	101.8%	99.7%	63,314	-13.8%
FY24	191,592	42,552	17,387	59,940	-18.4%	50.95	110.8%	98.8%	64,349	-12.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

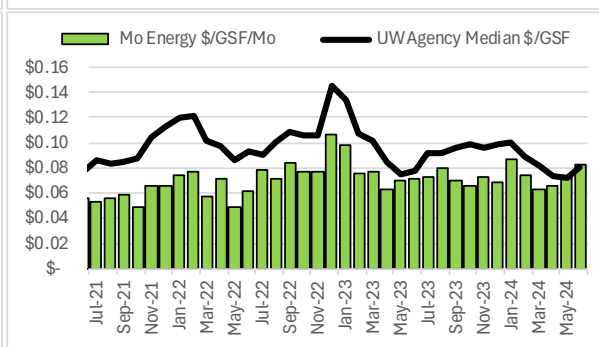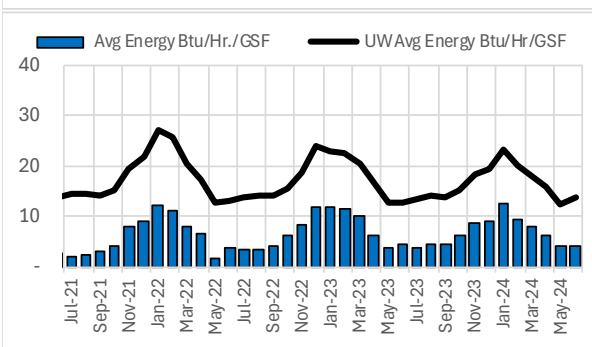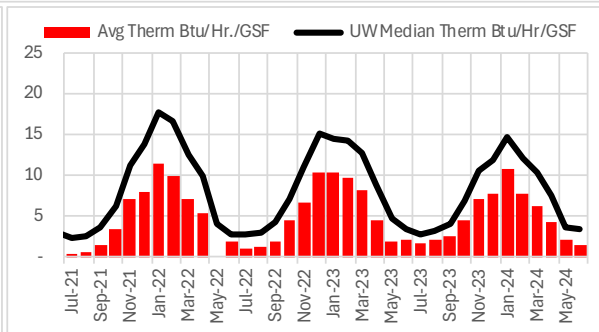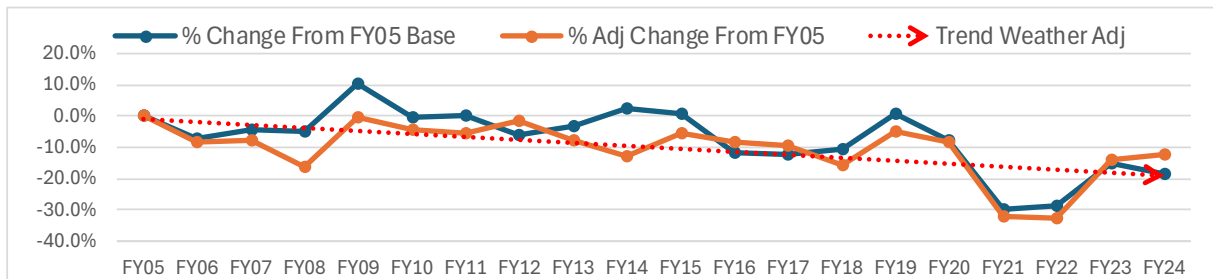

FY2024 UW-Green Bay, Sheboygan State Facilities Energy Report

FY24 Electric kwh/GSF= 7.60			FY24 Therm/GSF = 0.41			FY24 Total Btu/GSF= 67,219			05-24 Thm -35.3%	
FY24 Electric \$/GSF= \$ 0.92			FY24 Thermal \$/GSF= \$ 0.21			FY24 Energy \$/GSF= \$ 1.13			05-24 kwh -14.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	170,927	72,172	30,582	102,754	0.0%	45.94	100.0%	100.0%	102,754	0.0%
FY06	170,927	52,365	27,815	80,180	-22.0%	47.26	103.5%	99.3%	81,820	-20.4%
FY07	170,927	58,093	33,114	91,207	-11.2%	46.64	101.1%	100.2%	91,933	-10.5%
FY08	197,727	64,566	29,819	94,385	-8.1%	45.02	93.8%	99.0%	90,073	-12.3%
FY09	197,727	74,774	33,178	107,952	5.1%	43.47	93.5%	100.0%	103,117	0.4%
FY10	200,918	73,373	37,387	110,760	7.8%	45.98	100.9%	100.6%	111,655	8.7%
FY11	200,918	77,654	34,410	112,065	9.1%	44.58	95.0%	98.3%	107,607	4.7%
FY12	200,918	63,854	32,782	96,637	-6.0%	49.86	111.9%	99.6%	104,074	1.3%
FY13	200,918	74,154	34,185	108,339	5.4%	45.29	96.1%	99.8%	105,343	2.5%
FY14	200,918	83,874	32,470	116,345	13.2%	41.95	87.6%	98.0%	105,306	2.5%
FY15	200,918	84,688	35,146	119,834	16.6%	43.98	96.4%	100.4%	116,940	13.8%
FY16	200,918	51,512	35,961	87,473	-14.9%	48.11	105.8%	99.1%	90,138	-12.3%
FY17	200,918	68,854	36,730	105,584	2.8%	48.65	109.6%	99.2%	111,900	8.9%
FY18	200,918	49,284	34,318	83,602	-18.6%	45.41	97.5%	99.9%	82,325	-19.9%
FY19	200,918	51,780	33,309	85,089	-17.2%	44.90	96.6%	98.9%	83,002	-19.2%
FY20	228,544	41,923	25,695	67,618	-34.2%	46.40	99.7%	100.1%	67,508	-34.3%
FY21	228,544	32,677	25,758	58,435	-43.1%	47.28	101.9%	99.3%	58,888	-42.7%
FY22	228,544	37,742	26,198	63,941	-37.8%	46.76	100.3%	97.5%	63,407	-38.3%
FY23	228,544	55,863	27,168	83,031	-19.2%	47.58	105.1%	99.1%	85,627	-16.7%
FY24	228,544	41,264	25,955	67,219	-34.6%	49.93	113.2%	100.2%	72,733	-29.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

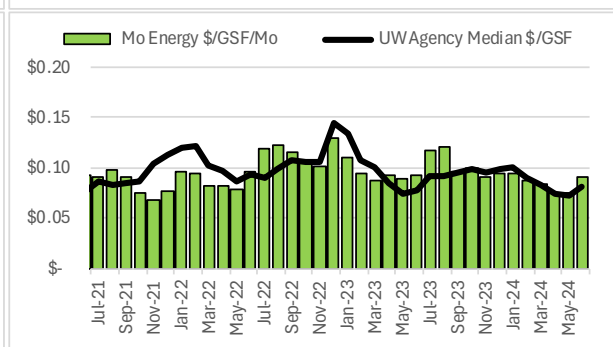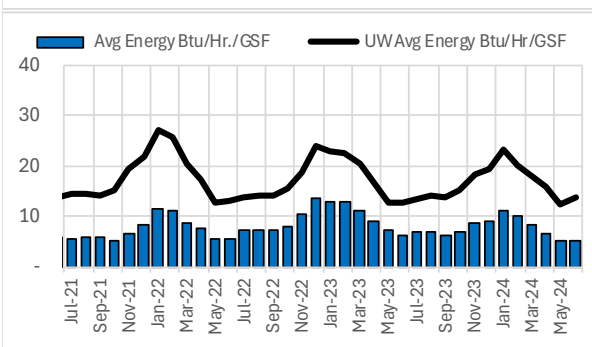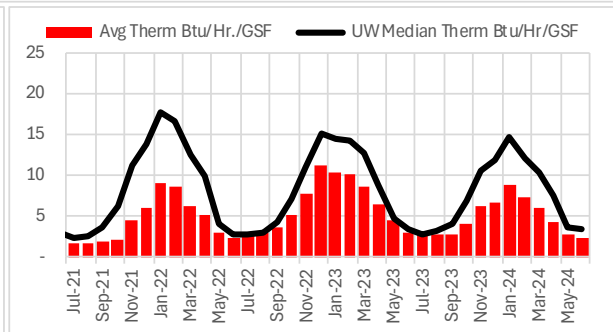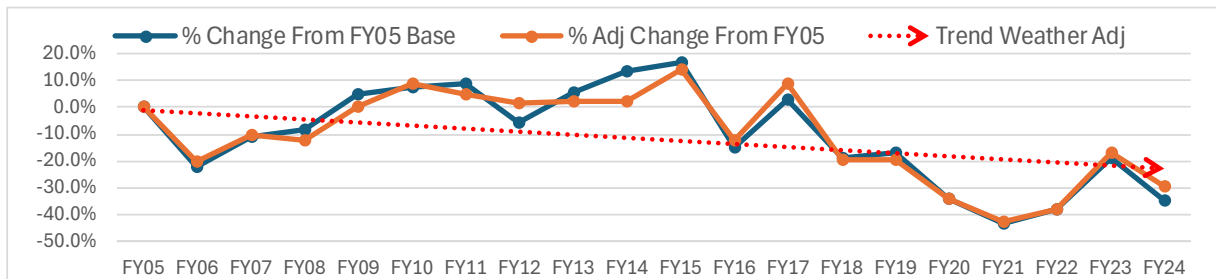

FY2024 UW-Milwaukee, Washington State Facilities Energy Report

FY24 Electric kwh/GSF= 4.91			FY24 Therm/GSF = 0.35			FY24 Total Btu/GSF= 51,276			05-24 Thm -4.1%	
FY24 Electric \$/GSF= \$ 0.70			FY24 Thermal \$/GSF= \$ 0.19			FY24 Energy \$/GSF= \$ 0.89			05-24 kwh -51.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	169,454	42,195	33,126	75,321	0.0%	48.47	100.0%	100.0%	75,321	0.0%
FY06	169,454	46,780	34,158	80,938	7.5%	50.11	102.0%	98.1%	81,226	7.8%
FY07	169,454	50,861	34,547	85,408	13.4%	48.88	99.1%	99.0%	84,618	12.3%
FY08	198,558	42,876	29,150	72,025	-4.4%	47.87	94.4%	99.7%	69,542	-7.7%
FY09	198,558	44,340	29,522	73,862	-1.9%	47.26	91.2%	100.7%	70,142	-6.9%
FY10	199,038	40,945	27,554	68,499	-9.1%	49.10	100.7%	99.9%	68,772	-8.7%
FY11	199,038	41,534	27,541	69,075	-8.3%	48.17	93.1%	99.8%	66,177	-12.1%
FY12	199,038	30,582	27,342	57,924	-23.1%	52.24	112.2%	99.1%	61,409	-18.5%
FY13	199,038	38,382	27,744	66,127	-12.2%	48.26	94.5%	100.0%	64,002	-15.0%
FY14	199,038	41,719	20,034	61,753	-18.0%	45.20	83.9%	98.7%	54,761	-27.3%
FY15	199,038	34,038	19,362	53,400	-29.1%	46.08	89.5%	99.9%	49,794	-33.9%
FY16	199,038	25,957	19,679	45,636	-39.4%	50.51	107.0%	99.0%	47,270	-37.2%
FY17	199,038	31,220	19,507	50,727	-32.7%	51.99	114.6%	96.7%	54,651	-27.4%
FY18	199,038	34,018	18,802	52,820	-29.9%	48.79	98.6%	99.6%	52,253	-30.6%
FY19	199,038	31,956	17,491	49,448	-34.4%	47.88	94.1%	99.6%	47,495	-36.9%
FY20	199,117	32,724	16,949	49,673	-34.1%	49.85	102.5%	100.0%	50,481	-33.0%
FY21	199,117	28,832	15,447	44,279	-41.2%	50.84	106.1%	98.3%	45,788	-39.2%
FY22	199,117	31,082	15,622	46,705	-38.0%	50.91	103.5%	98.3%	47,532	-36.9%
FY23	199,117	35,235	15,854	51,088	-32.2%	51.08	111.2%	98.7%	54,832	-27.2%
FY24	199,117	34,520	16,755	51,276	-31.9%	53.15	117.2%	96.6%	56,643	-24.8%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

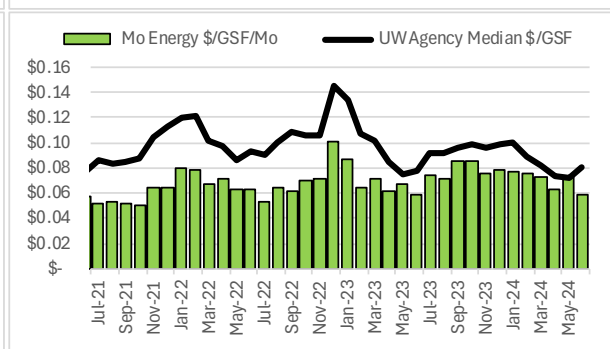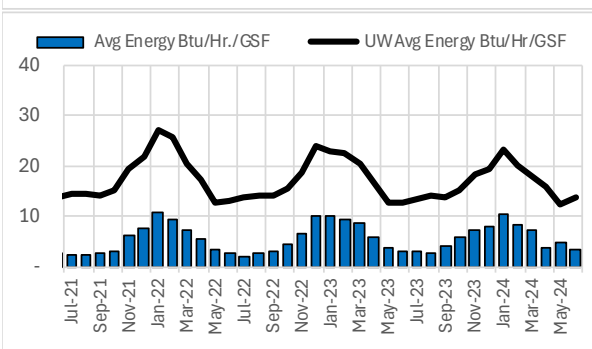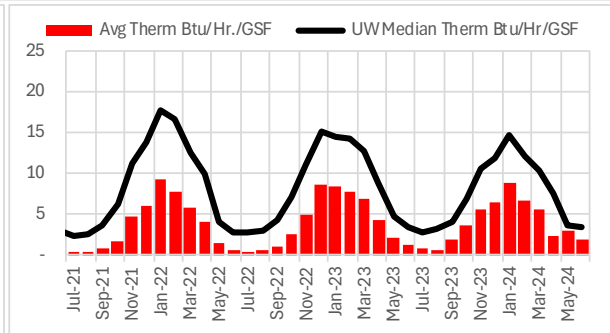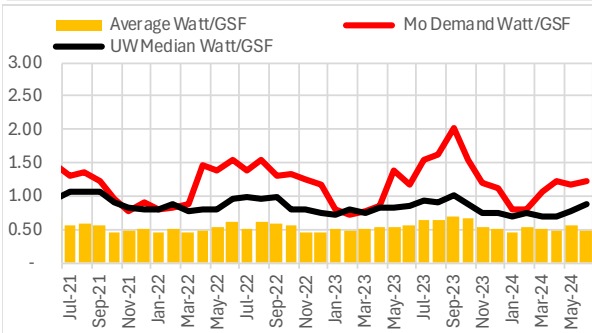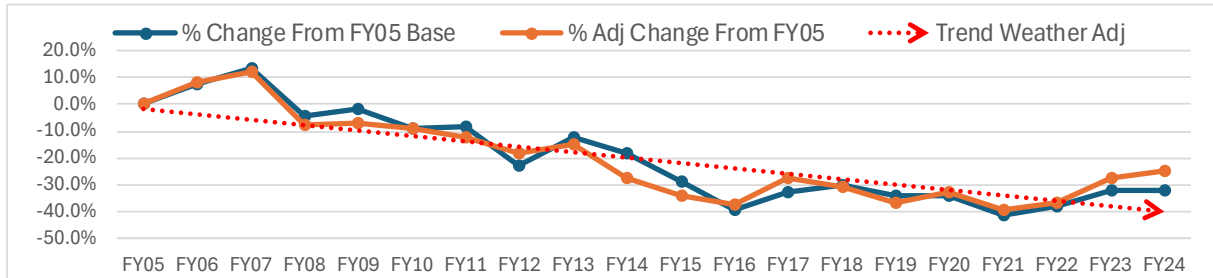

FY2024 UW-Milwaukee, Waukesha State Facilities Energy Report

FY24 Electric kwh/GSF= 6.38			FY24 Therm/GSF = 0.58			FY24 Total Btu/GSF= 79,409			05-24 Thm 5.5%	
FY24 Electric \$/GSF= \$ 0.84			FY24 Thermal \$/GSF= \$ 0.24			FY24 Energy \$/GSF= \$ 1.08			05-24 kwh -38.8%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	263,050	59,760	34,992	94,752	0.0%	48.12	100.0%	100.0%	94,752	0.0%
FY06	263,050	52,661	33,092	85,753	-9.5%	48.65	99.8%	99.2%	85,402	-9.9%
FY07	263,050	55,815	36,245	92,059	-2.8%	47.46	95.7%	99.9%	89,646	-5.4%
FY08	272,406	58,675	36,652	95,326	0.6%	46.19	94.6%	101.1%	92,564	-2.3%
FY09	272,406	53,629	35,933	89,562	-5.5%	45.66	88.4%	100.1%	83,384	-12.0%
FY10	277,016	45,765	32,703	78,468	-17.2%	47.10	98.1%	100.3%	77,718	-18.0%
FY11	277,016	49,128	32,983	82,111	-13.3%	46.81	90.6%	99.3%	77,253	-18.5%
FY12	277,016	42,752	33,404	76,156	-19.6%	51.51	108.8%	99.1%	79,603	-16.0%
FY13	277,016	53,059	35,698	88,757	-6.3%	47.29	91.8%	99.0%	84,072	-11.3%
FY14	277,016	59,934	28,837	88,771	-6.3%	44.58	84.0%	98.9%	78,860	-16.8%
FY15	277,016	44,801	23,490	68,292	-27.9%	45.84	89.5%	99.5%	63,491	-33.0%
FY16	277,016	52,792	26,213	79,005	-16.6%	49.68	102.8%	99.4%	80,347	-15.2%
FY17	277,016	66,802	26,902	93,704	-1.1%	49.72	103.9%	98.3%	95,831	1.1%
FY18	277,016	65,532	25,295	90,827	-4.1%	46.66	95.4%	100.2%	87,907	-7.2%
FY19	277,016	64,831	23,859	88,690	-6.4%	45.87	93.4%	99.5%	84,263	-11.1%
FY20	277,016	63,592	21,444	85,036	-10.3%	48.08	100.0%	99.0%	84,814	-10.5%
FY21	277,016	61,022	20,424	81,446	-14.0%	47.61	98.3%	98.3%	80,074	-15.5%
FY22	277,016	62,866	23,043	85,909	-9.3%	48.04	98.3%	99.7%	84,780	-10.5%
FY23	277,016	64,963	21,920	86,883	-8.3%	48.63	101.6%	99.7%	87,825	-7.3%
FY24	277,016	57,637	21,772	79,409	-16.2%	50.95	109.4%	98.3%	84,452	-10.9%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

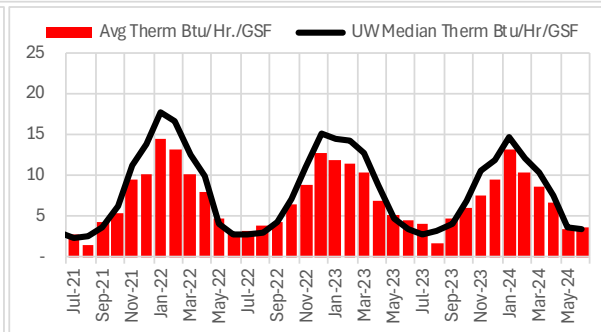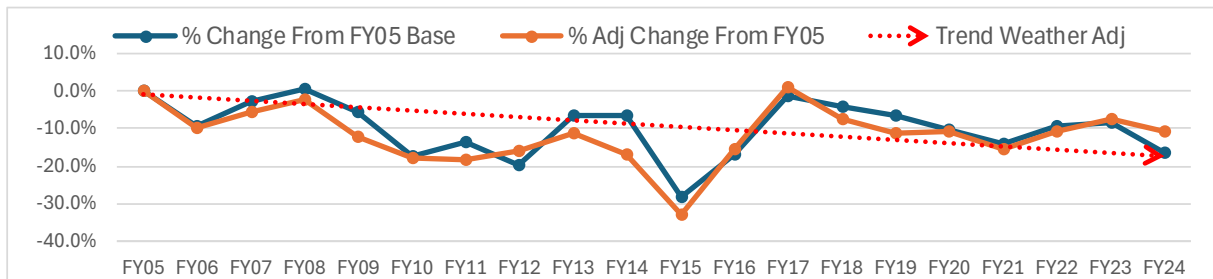

Agency Energy Use Summary



State of Wisconsin

Department of Administration

SCOPE

CAPITOL COMPLEX - Capitol Heat & Power Plant, Dept. of Administration Office Building; Dept. of Health Services Office Building; Risser Justice Center; GEF 1, 2 and 3; and Wisconsin State Capitol.

HILL FARMS COMPLEX - Hill Farms D/E/L; and State Transportation Building

SEPARATED FACILITIES - Badger Road Office Building; Eau Claire Office Building; Green Bay Office Building; La Crosse Office Building; Milwaukee Office Building; Milwaukee SE Crime Lab; State Agriculture Building; State Revenue Building; Milwaukee, Waukesha Office Building; Wisconsin Public Broadcasting Center Building; Wisconsin Rapids Office Building; Air Services; Executive Residence; FY23/FY24 Thompson Center & Archive & Preservation.

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 20.5 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 3.6 percent increase

Energy use (BTU/GSF/Yr) for FY24 increase 3.6 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 1.1 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 1.1 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: 12.8 percent increase.



Gross square footage (GSF) has increased 12.8% from the base fiscal year, FY05.

Consumption Change from Base: 10.7 percent decrease.

Total consumption was 10.7 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 4.1 percent less than in the base year when adjusted for weather compared to FY05.


Administration, Department of

Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024	
Electricity	\$	10,888,394	\$	10,155,840	\$	9,940,881	\$	10,946,500	\$	11,464,793
Coal	\$	3,108,358	\$	2,514	\$	-	\$	-	\$	-
Natural Gas	\$	24,689,024	\$	27,653,934	\$	52,406,728	\$	55,655,180	\$	27,012,629
Fuel Oil	\$	70,110	\$	2,754,871	\$	185,511	\$	1,173,352	\$	580,947
Other Fuels	\$	57,938	\$	3,005	\$	12,614	\$	8,783	\$	7,339
Steam/Heat	\$	81,480	\$	107,080	\$	129,706	\$	119,752	\$	132,150
Chilled Water	\$	-	\$	-	\$	-	\$	-	\$	-
Water & Sewage	\$	810,239	\$	579,560	\$	782,487	\$	889,588	\$	809,917
Total Utilities	\$	39,705,545	\$	41,256,804	\$	63,457,927	\$	68,793,155	\$	40,007,774

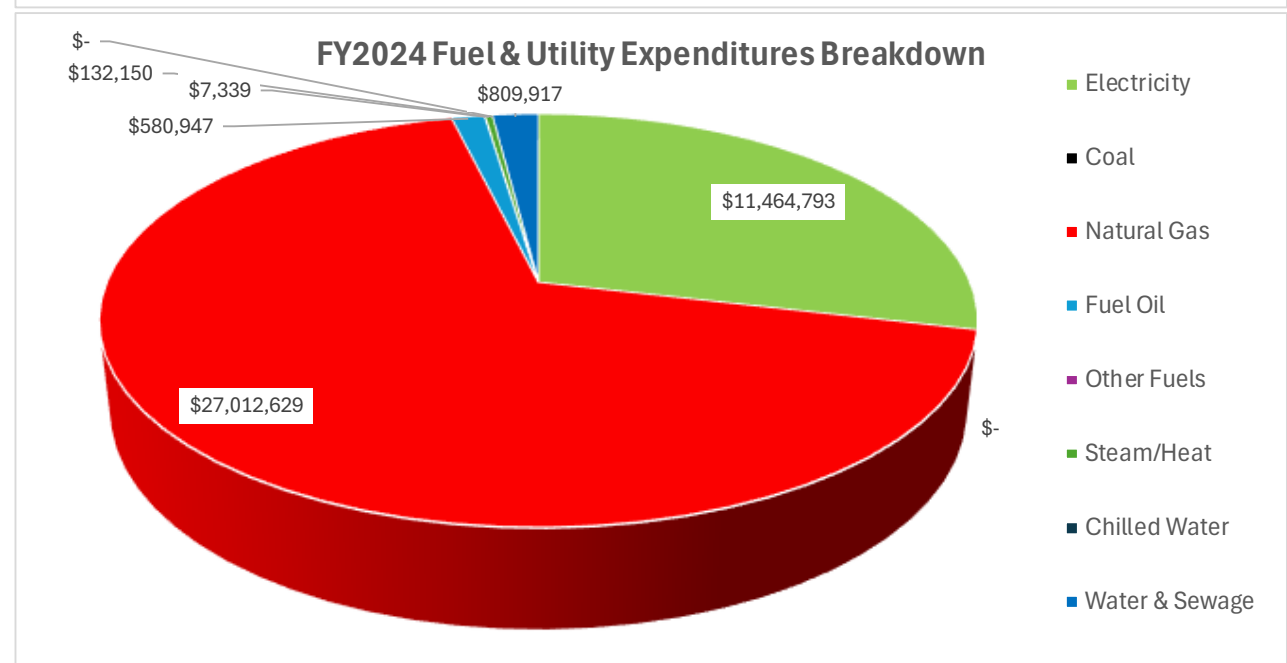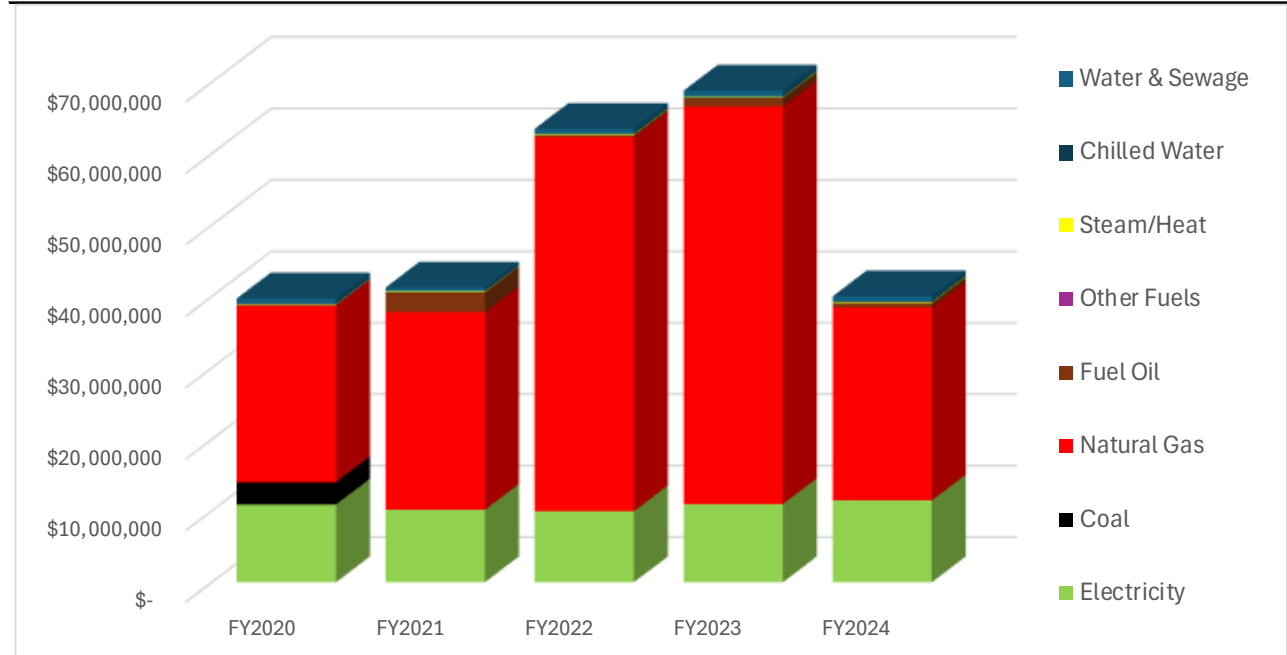

DOA Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	4,027,132	99,221	58,619	157,840	0.0%	48.03	100.0%	100.0%	157,840	0.0%
FY06	4,027,132	97,337	59,097	156,433	-0.9%	48.69	97.0%	99.2%	153,020	-3.1%
FY07	4,084,119	92,767	59,943	152,710	-3.3%	47.49	98.2%	99.7%	150,818	-4.4%
FY08	4,084,119	93,655	60,610	154,265	-2.3%	46.19	91.8%	99.0%	146,015	-7.5%
FY09	4,084,119	84,493	58,124	142,617	-9.6%	45.64	92.3%	99.2%	135,624	-14.1%
FY10	4,084,119	76,185	55,782	131,967	-16.4%	47.16	98.4%	100.3%	130,921	-17.1%
FY11	4,084,119	74,014	54,937	128,951	-18.3%	46.76	92.4%	98.9%	122,723	-22.2%
FY12	4,084,119	52,651	54,928	107,579	-31.8%	51.45	107.6%	98.3%	110,665	-29.9%
FY13	4,084,119	61,282	53,710	114,992	-27.1%	47.21	95.5%	99.3%	111,873	-29.1%
FY14	4,166,958	70,189	53,524	123,713	-21.6%	44.48	86.1%	99.2%	113,562	-28.1%
FY15	4,019,258	65,725	53,965	119,689	-24.2%	45.75	94.0%	100.2%	115,856	-26.6%
FY16	4,019,258	58,978	53,698	112,676	-28.6%	49.66	104.6%	99.2%	114,965	-27.2%
FY17	4,019,258	66,010	53,444	119,454	-24.3%	49.78	103.8%	98.2%	120,980	-23.4%
FY18	3,968,416	70,801	51,303	122,103	-22.6%	46.70	94.2%	99.4%	117,670	-25.4%
FY19	4,202,931	55,998	46,168	102,167	-35.3%	45.88	93.3%	99.7%	98,303	-37.7%
FY20	4,202,931	61,855	43,941	105,796	-33.0%	48.08	99.8%	99.4%	105,381	-33.2%
FY21	4,202,931	61,322	39,961	101,283	-35.8%	47.76	97.2%	98.4%	98,937	-37.3%
FY22	4,202,931	66,677	42,184	108,861	-31.0%	48.13	98.1%	97.7%	106,660	-32.4%
FY23	4,541,557	76,895	43,300	120,196	-23.8%	48.70	101.5%	99.6%	121,190	-23.2%
FY24	4,541,557	79,065	40,988	120,052	-23.9%	51.01	107.7%	98.5%	125,542	-20.5%

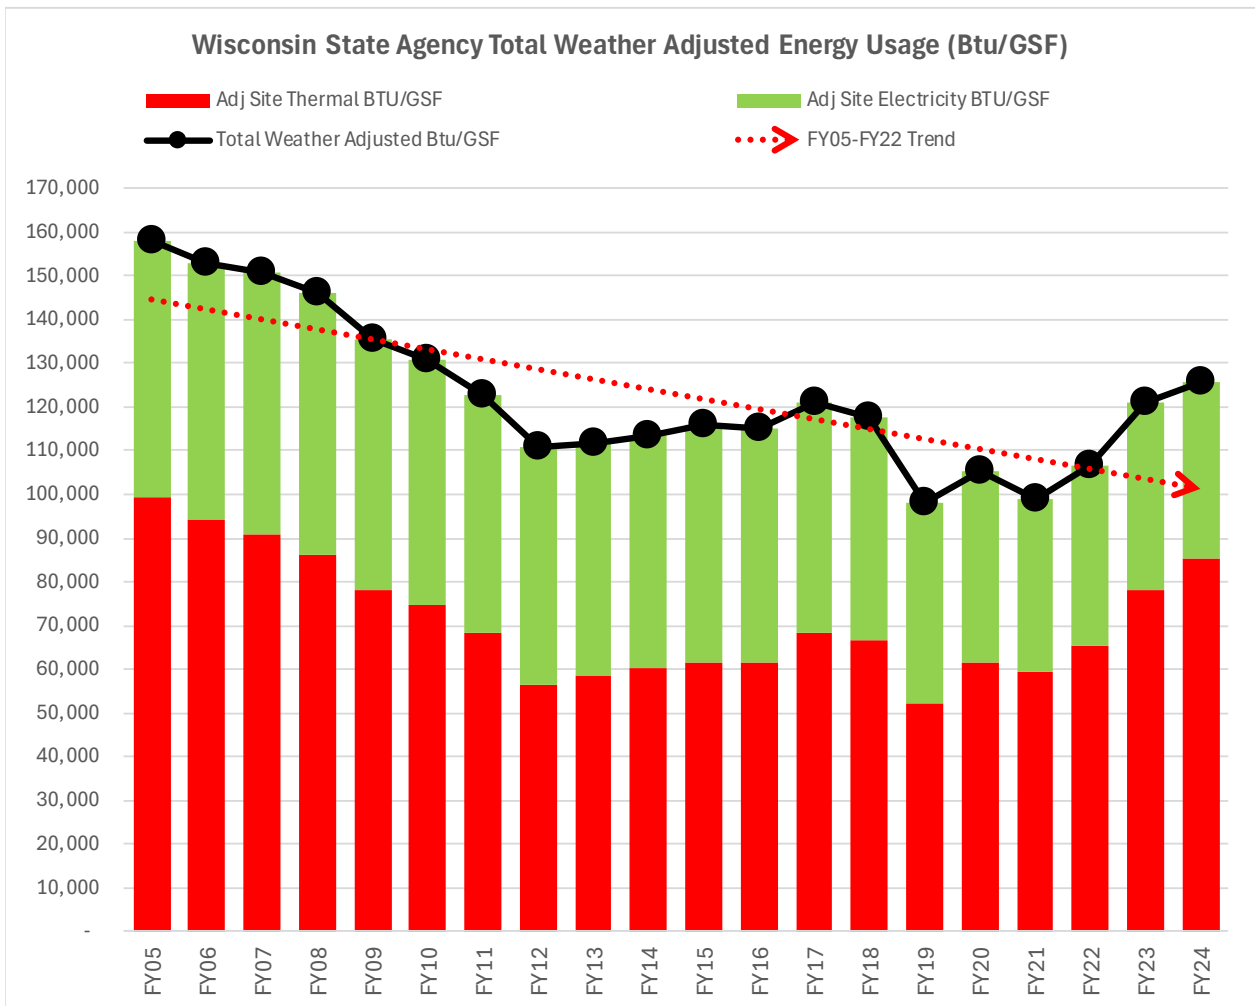

DOA Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 12.01			FY24 Therm/GSF = 0.79			FY24 Total Btu/GSF = 120,052			05-24 Thm -14.2%	
FY24 Electric \$/GSF = \$ 1.57			FY24 Thermal \$/GSF = \$ 0.33			FY24 Energy \$/GSF = \$ 1.90			05-24 kwh -31.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	4,027,132	99,221	58,619	157,840	0.0%	48.03	100.0%	100.0%	157,840	0.0%
FY06	4,027,132	97,337	59,097	156,433	-0.9%	48.69	97.0%	99.2%	153,020	-3.1%
FY07	4,084,119	92,767	59,943	152,710	-3.3%	47.49	98.2%	99.7%	150,818	-4.4%
FY08	4,084,119	93,655	60,610	154,265	-2.3%	46.19	91.8%	99.0%	146,015	-7.5%
FY09	4,084,119	84,493	58,124	142,617	-9.6%	45.64	92.3%	99.2%	135,624	-14.1%
FY10	4,084,119	76,185	55,782	131,967	-16.4%	47.16	98.4%	100.3%	130,921	-17.1%
FY11	4,084,119	74,014	54,937	128,951	-18.3%	46.76	92.4%	98.9%	122,723	-22.2%
FY12	4,084,119	52,651	54,928	107,579	-31.8%	51.45	107.6%	98.3%	110,665	-29.9%
FY13	4,084,119	61,282	53,710	114,992	-27.1%	47.21	95.5%	99.3%	111,873	-29.1%
FY14	4,166,958	70,189	53,524	123,713	-21.6%	44.48	86.1%	99.2%	113,562	-28.1%
FY15	4,019,258	65,725	53,965	119,689	-24.2%	45.75	94.0%	100.2%	115,856	-26.6%
FY16	4,019,258	58,978	53,698	112,676	-28.6%	49.66	104.6%	99.2%	114,965	-27.2%
FY17	4,019,258	66,010	53,444	119,454	-24.3%	49.78	103.8%	98.2%	120,980	-23.4%
FY18	3,968,416	70,801	51,303	122,103	-22.6%	46.70	94.2%	99.4%	117,670	-25.4%
FY19	4,202,931	55,998	46,168	102,167	-35.3%	45.88	93.3%	99.7%	98,303	-37.7%
FY20	4,202,931	61,855	43,941	105,796	-33.0%	48.08	99.8%	99.4%	105,381	-33.2%
FY21	4,202,931	61,322	39,961	101,283	-35.8%	47.76	97.2%	98.4%	98,937	-37.3%
FY22	4,202,931	66,677	42,184	108,861	-31.0%	48.13	98.1%	97.7%	106,660	-32.4%
FY23	4,541,557	76,895	43,300	120,196	-23.8%	48.70	101.5%	99.6%	121,190	-23.2%
FY24	4,541,557	79,065	40,988	120,052	-23.9%	51.01	107.7%	98.5%	125,542	-20.5%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

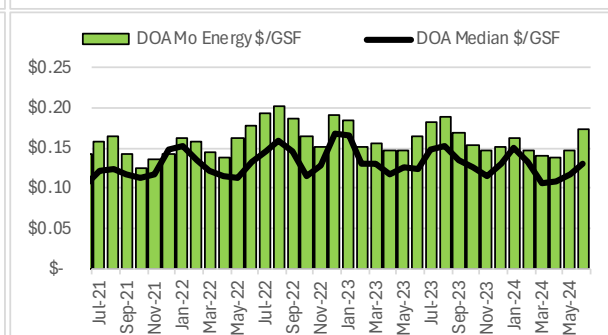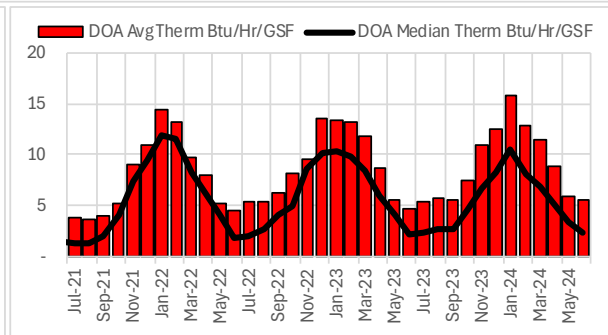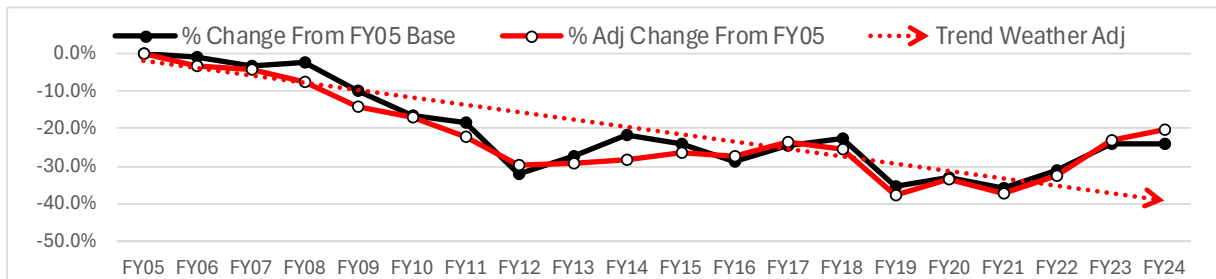

FY2024 DOA-Capitol Complex State Facilities Energy Report

FY24 Electric kwh/GSF= 9.20			FY24 Therm/GSF = 1.03			FY24 Total Btu/GSF= 134,297		05-24 Thm -2.0%		
FY24 Electric \$/GSF= \$ 1.20			FY24 Thermal \$/GSF= \$ 0.35			FY24 Energy \$/GSF= \$ 1.55		05-24 kwh -45.8%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	2,013,307	112,981	56,846	169,826	0.0%	48.12	100.0%	100.0%	169,826	0.0%
FY06	2,013,307	116,427	57,203	173,630	2.2%	48.65	94.5%	99.5%	167,012	-1.7%
FY07	2,013,307	109,507	56,231	165,738	-2.4%	47.46	98.6%	99.8%	164,101	-3.4%
FY08	2,013,307	110,539	53,818	164,357	-3.2%	46.19	93.0%	99.3%	156,242	-8.0%
FY09	2,013,307	89,085	48,538	137,622	-19.0%	45.66	92.9%	99.1%	130,886	-22.9%
FY10	2,013,307	82,641	47,512	130,154	-23.4%	47.10	99.5%	100.2%	129,829	-23.6%
FY11	2,013,307	73,324	45,361	118,686	-30.1%	46.81	93.1%	98.9%	113,107	-33.4%
FY12	2,013,307	38,392	46,699	85,091	-49.9%	51.51	105.8%	98.3%	86,537	-49.0%
FY13	2,013,307	45,317	45,833	91,150	-46.3%	47.29	97.1%	99.0%	89,393	-47.4%
FY14	2,013,307	51,410	46,061	97,471	-42.6%	44.58	90.4%	99.2%	92,154	-45.7%
FY15	2,013,307	49,116	45,383	94,499	-44.4%	45.84	96.2%	100.3%	92,785	-45.4%
FY16	2,013,307	46,596	45,379	91,975	-45.8%	49.68	104.3%	99.1%	93,576	-44.9%
FY17	2,013,307	56,361	44,406	100,766	-40.7%	49.72	102.5%	98.2%	101,373	-40.3%
FY18	2,013,307	57,578	42,755	100,333	-40.9%	46.66	94.9%	99.8%	97,311	-42.7%
FY19	2,013,307	46,296	41,505	87,801	-48.3%	45.87	95.3%	100.0%	85,614	-49.6%
FY20	2,013,307	63,783	39,561	103,344	-39.1%	48.08	99.7%	99.3%	102,879	-39.4%
FY21	2,013,307	61,055	35,155	96,210	-43.3%	47.61	97.4%	98.0%	93,902	-44.7%
FY22	2,013,307	71,543	37,080	108,623	-36.0%	48.04	98.5%	97.6%	106,683	-37.2%
FY23	2,013,307	88,659	35,551	124,209	-26.9%	48.63	101.2%	99.5%	125,059	-26.4%
FY24	2,013,307	102,914	31,383	134,297	-20.9%	50.95	107.6%	98.2%	141,577	-16.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

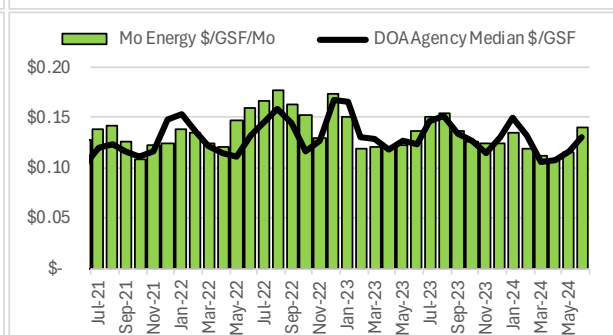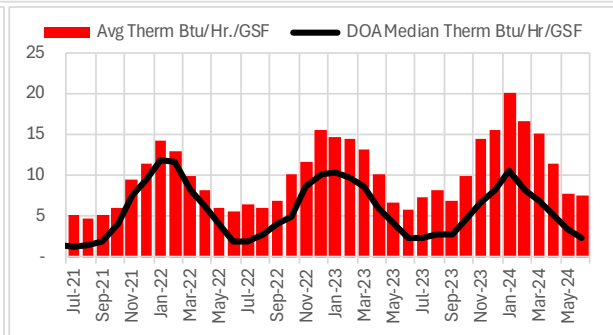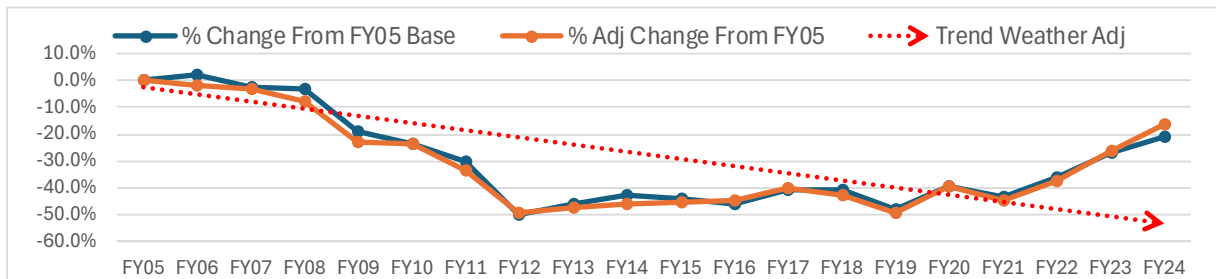

FY2024 DOA-Hill Farms State Facilities Energy Report

FY24 Electric kwh/GSF= 7.32			FY24 Therm/GSF = 0.50			FY24 Total Btu/GSF= 74,680			05-24 Thm -55.7%	
FY24 Electric \$/GSF= \$ 1.01			FY24 Thermal \$/GSF= \$ 0.22			FY24 Energy \$/GSF= \$ 1.23			05-24 kwh -62.6%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	644,904	119,925	65,950	185,875	0.0%	48.12	100.0%	100.0%	185,875	0.0%
FY06	644,904	113,539	66,474	180,014	-3.2%	48.65	101.0%	99.0%	180,497	-2.9%
FY07	644,904	124,466	63,980	188,446	1.4%	47.46	97.9%	99.8%	185,769	-0.1%
FY08	644,904	128,346	66,554	194,900	4.9%	46.19	89.8%	98.3%	180,704	-2.8%
FY09	644,904	130,840	65,380	196,219	5.6%	45.66	92.8%	99.0%	186,096	0.1%
FY10	644,904	114,947	59,120	174,068	-6.4%	47.10	96.7%	100.5%	170,540	-8.3%
FY11	644,904	117,923	62,926	180,849	-2.7%	46.81	90.9%	97.9%	168,848	-9.2%
FY12	644,904	102,704	62,968	165,671	-10.9%	51.51	108.8%	98.3%	173,635	-6.6%
FY13	644,904	112,742	59,692	172,434	-7.2%	47.29	94.8%	99.2%	166,088	-10.6%
FY14	644,904	131,537	57,500	189,038	1.7%	44.58	84.4%	99.8%	168,462	-9.4%
FY15	644,904	103,574	53,048	156,622	-15.7%	45.84	92.1%	100.1%	148,464	-20.1%
FY16	644,904	102,309	52,849	155,158	-16.5%	49.68	104.8%	99.3%	159,663	-14.1%
FY17	644,904	110,360	52,804	163,164	-12.2%	49.72	104.5%	97.9%	167,072	-10.1%
FY18	644,904	120,425	45,121	165,546	-10.9%	46.66	93.3%	98.0%	156,569	-15.8%
FY19	879,419	60,690	28,019	88,709	-52.3%	45.87	93.9%	100.0%	85,023	-54.3%
FY20	879,419	62,017	27,790	89,807	-51.7%	48.08	99.8%	99.4%	89,517	-51.8%
FY21	879,419	63,010	26,270	89,280	-52.0%	47.61	96.2%	98.7%	86,552	-53.4%
FY22	879,419	55,913	25,636	81,549	-56.1%	48.04	97.8%	97.9%	79,772	-57.1%
FY23	879,419	54,810	26,190	81,000	-56.4%	48.63	101.6%	99.6%	81,750	-56.0%
FY24	879,419	49,698	24,982	74,680	-59.8%	50.95	106.9%	98.8%	77,810	-58.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

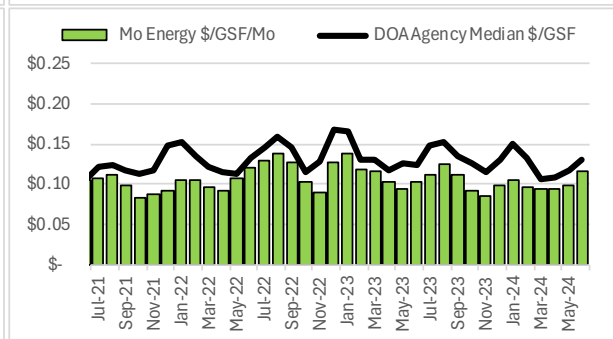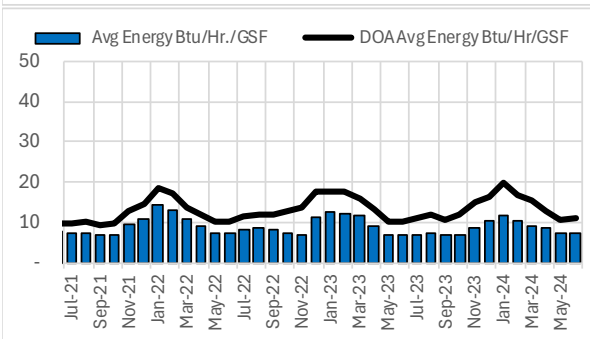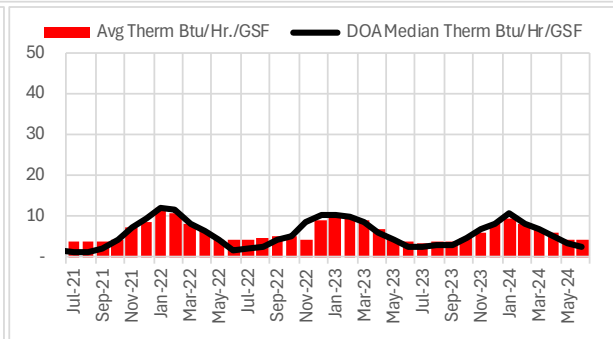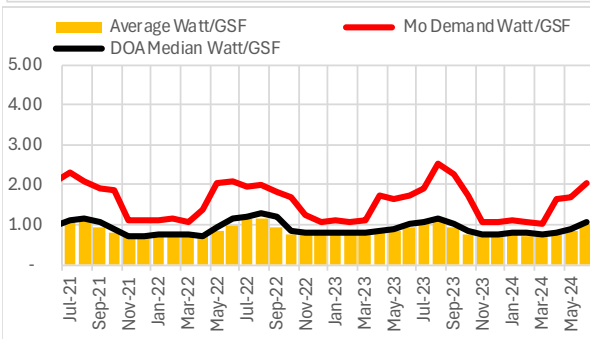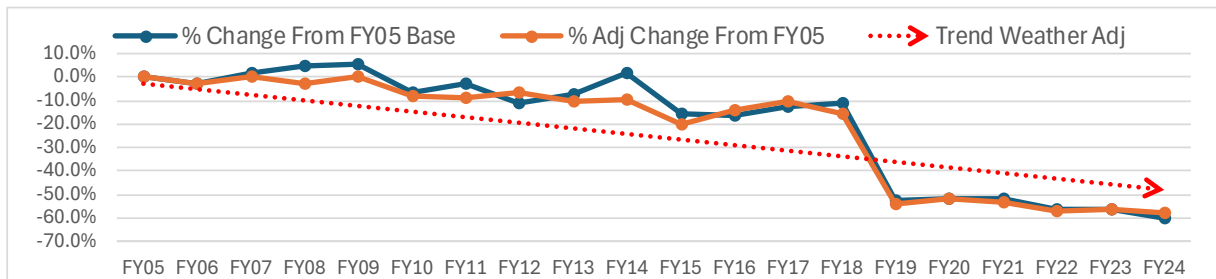

FY2024 DOA-Air Services State Facilities Energy Report

FY24 Electric kwh/GSF= 3.04			FY24 Therm/GSF = 0.70			FY24 Total Btu/GSF= 80,134			05-24 Thm -18.2%	
FY24 Electric \$/GSF= \$ 0.53			FY24 Thermal \$/GSF= \$ 0.51			FY24 Energy \$/GSF= \$ 1.04			05-24 kwh -42.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	17,898	96,324	18,938	115,262	0.0%	48.12	100.0%	100.0%	115,262	0.0%
FY06	17,898	84,250	18,673	102,922	-10.7%	48.65	98.3%	100.1%	101,470	-12.0%
FY07	17,898	98,195	18,172	116,368	1.0%	47.46	94.7%	99.5%	111,101	-3.6%
FY08	17,898	90,479	18,641	109,121	-5.3%	46.19	78.8%	98.7%	89,727	-22.2%
FY09	17,898	101,235	17,950	119,184	3.4%	45.66	83.0%	98.7%	101,694	-11.8%
FY10	17,898	90,703	17,575	108,277	-6.1%	47.10	95.0%	99.6%	103,694	-10.0%
FY11	17,898	99,598	18,691	118,289	2.6%	46.81	84.0%	98.6%	102,070	-11.4%
FY12	17,898	73,394	17,939	91,332	-20.8%	51.51	113.4%	101.4%	101,395	-12.0%
FY13	17,898	99,302	18,995	118,297	2.6%	47.29	88.9%	99.1%	107,060	-7.1%
FY14	17,898	119,835	17,712	137,547	19.3%	44.58	77.2%	99.4%	110,118	-4.5%
FY15	17,898	110,975	15,412	126,387	9.7%	45.84	90.4%	98.9%	115,594	0.3%
FY16	17,898	93,582	15,871	109,453	-5.0%	49.68	104.0%	100.6%	113,323	-1.7%
FY17	17,898	77,491	15,881	93,372	-19.0%	49.72	107.1%	100.2%	98,938	-14.2%
FY18	17,898	74,451	15,959	90,410	-21.6%	46.66	84.1%	98.8%	78,361	-32.0%
FY19	17,898	98,276	14,596	112,872	-2.1%	45.87	87.6%	97.7%	100,326	-13.0%
FY20	17,898	64,133	10,348	74,481	-35.4%	48.08	98.1%	99.6%	73,205	-36.5%
FY21	17,898	48,952	11,897	60,850	-47.2%	47.61	93.2%	98.8%	57,398	-50.2%
FY22	17,898	88,439	13,172	101,611	-11.8%	48.04	93.0%	98.5%	95,254	-17.4%
FY23	17,898	90,615	12,423	103,038	-10.6%	48.63	102.2%	100.9%	105,135	-8.8%
FY24	17,898	69,773	10,361	80,134	-30.5%	50.95	112.9%	105.3%	89,711	-22.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

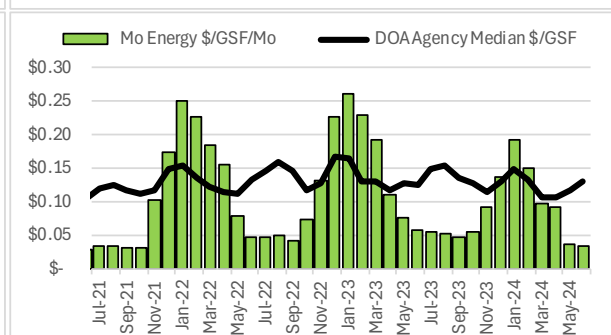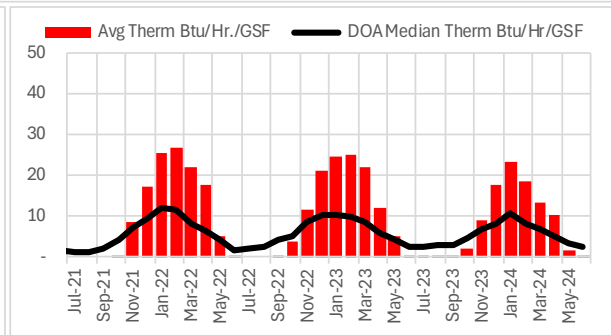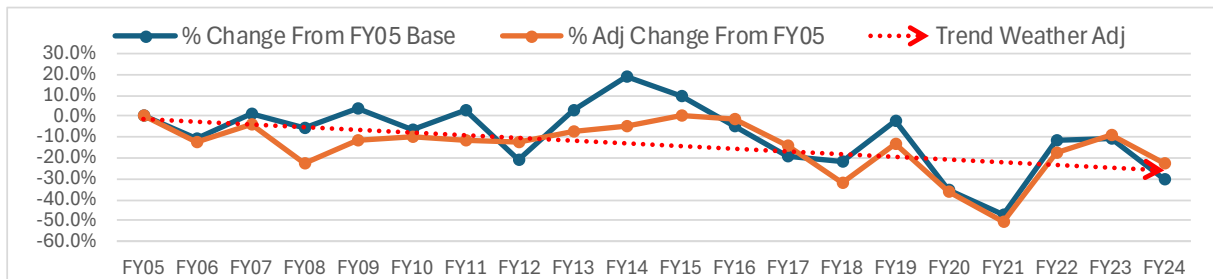

FY2024 DOA-Eau Claire SOB State Facilities Energy Report

FY24 Electric kwh/GSF= 6.12			FY24 Therm/GSF = 0.43			FY24 Total Btu/GSF= 63,822			05-24 Thm 28.5%	
FY24 Electric \$/GSF= \$ 0.82			FY24 Thermal \$/GSF= \$ 0.29			FY24 Energy \$/GSF= \$ 1.11			05-24 kwh -48.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	56,206	37,587	40,349	77,936	0.0%	45.85	100.0%	100.0%	77,936	0.0%
FY06	56,206	32,196	39,397	71,593	-8.1%	47.80	104.1%	98.7%	72,403	-7.1%
FY07	56,206	34,060	38,328	72,388	-7.1%	46.32	95.2%	98.4%	70,134	-10.0%
FY08	56,206	37,252	36,735	73,987	-5.1%	43.27	84.9%	98.6%	67,848	-12.9%
FY09	56,206	37,854	35,948	73,802	-5.3%	42.97	85.4%	99.6%	68,105	-12.6%
FY10	56,206	32,479	33,179	65,658	-15.8%	45.29	97.9%	100.1%	65,020	-16.6%
FY11	56,206	37,056	31,790	68,846	-11.7%	43.68	86.0%	98.9%	63,298	-18.8%
FY12	56,206	31,945	32,305	64,250	-17.6%	49.02	106.5%	99.4%	66,140	-15.1%
FY13	56,206	45,261	31,187	76,448	-1.9%	43.85	90.9%	99.2%	72,077	-7.5%
FY14	56,206	49,631	30,410	80,041	2.7%	41.37	81.3%	98.0%	70,175	-10.0%
FY15	56,206	49,416	27,443	76,858	-1.4%	43.42	95.7%	99.8%	74,686	-4.2%
FY16	56,206	39,969	25,508	65,476	-16.0%	47.61	106.0%	100.4%	67,980	-12.8%
FY17	56,206	37,120	21,455	58,575	-24.8%	47.07	104.5%	99.5%	60,130	-22.8%
FY18	56,206	33,704	21,513	55,218	-29.2%	43.54	87.3%	98.8%	50,700	-34.9%
FY19	56,206	49,565	22,805	72,370	-7.1%	42.23	79.1%	99.9%	61,988	-20.5%
FY20	56,206	43,247	19,261	62,508	-19.8%	45.42	96.2%	99.5%	60,778	-22.0%
FY21	56,206	42,297	17,166	59,463	-23.7%	46.01	95.9%	98.4%	57,466	-26.3%
FY22	56,206	50,513	20,915	71,427	-8.4%	44.82	92.7%	98.9%	67,521	-13.4%
FY23	56,206	51,198	22,149	73,347	-5.9%	45.82	97.1%	99.0%	71,643	-8.1%
FY24	56,206	42,946	20,877	63,822	-18.1%	49.00	112.5%	100.4%	69,280	-11.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

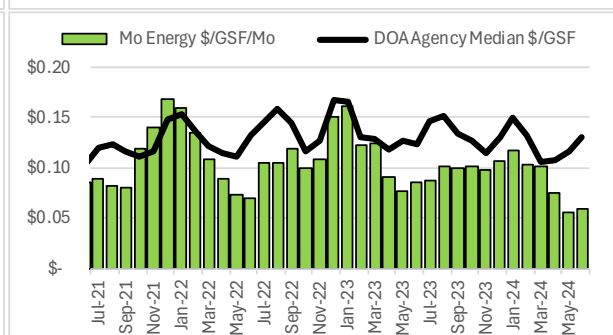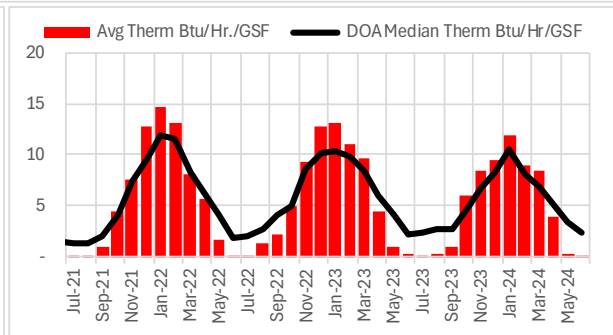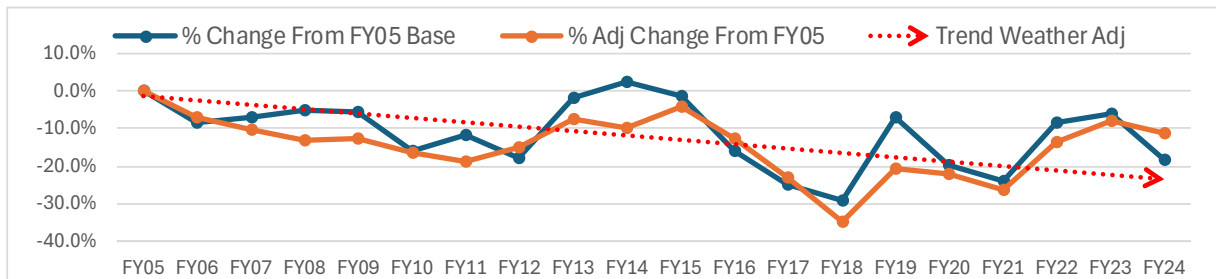

FY2024 DOA-Executive Residence State Facilities Energy Report

FY24 Electric kwh/GSF= 9.41			FY24 Therm/GSF = 0.54			FY24 Total Btu/GSF= 86,052			05-24 Thm -34.7%	
FY24 Electric \$/GSF= \$ 1.58			FY24 Thermal \$/GSF= \$ 0.36			FY24 Energy \$/GSF= \$ 1.93			05-24 kwh -4.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	23,455	89,090	33,078	122,168	0.0%	48.12	100.0%	100.0%	122,168	0.0%
FY06	23,455	74,824	32,752	107,576	-11.9%	48.65	102.3%	99.1%	108,965	-10.8%
FY07	23,455	55,242	31,175	86,417	-29.3%	47.46	98.8%	99.8%	85,709	-29.8%
FY08	23,455	56,001	30,866	86,867	-28.9%	46.19	93.8%	98.7%	82,972	-32.1%
FY09	23,455	54,509	29,463	83,972	-31.3%	45.66	93.2%	99.2%	80,006	-34.5%
FY10	23,455	56,321	30,779	87,099	-28.7%	47.10	98.7%	100.8%	86,639	-29.1%
FY11	23,455	57,779	31,877	89,656	-26.6%	46.81	95.0%	99.3%	86,552	-29.2%
FY12	23,455	49,196	33,081	82,277	-32.7%	51.51	106.4%	98.1%	84,782	-30.6%
FY13	23,455	52,147	36,166	88,313	-27.7%	47.29	95.3%	98.3%	85,261	-30.2%
FY14	23,455	58,460	37,178	95,637	-21.7%	44.58	89.0%	96.3%	87,834	-28.1%
FY15	23,455	60,392	35,975	96,367	-21.1%	45.84	93.2%	100.0%	92,243	-24.5%
FY16	23,455	50,278	35,617	85,895	-29.7%	49.68	104.4%	98.8%	87,704	-28.2%
FY17	23,455	58,521	37,258	95,780	-21.6%	49.72	102.7%	98.3%	96,724	-20.8%
FY18	23,455	76,796	36,593	113,389	-7.2%	46.66	94.7%	98.9%	108,930	-10.8%
FY19	23,455	72,267	33,781	106,048	-13.2%	45.87	93.2%	100.2%	101,225	-17.1%
FY20	23,455	63,201	29,340	92,542	-24.3%	48.08	100.9%	99.5%	92,994	-23.9%
FY21	23,455	56,844	27,947	84,791	-30.6%	47.61	97.7%	98.1%	82,951	-32.1%
FY22	23,455	56,472	29,998	86,470	-29.2%	48.04	97.0%	96.9%	83,845	-31.4%
FY23	23,455	54,588	31,507	86,095	-29.5%	48.63	101.4%	99.5%	86,676	-29.1%
FY24	23,455	53,930	32,121	86,052	-29.6%	50.95	107.8%	98.0%	89,611	-26.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

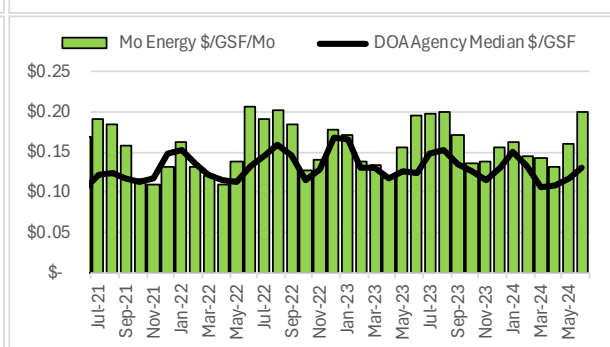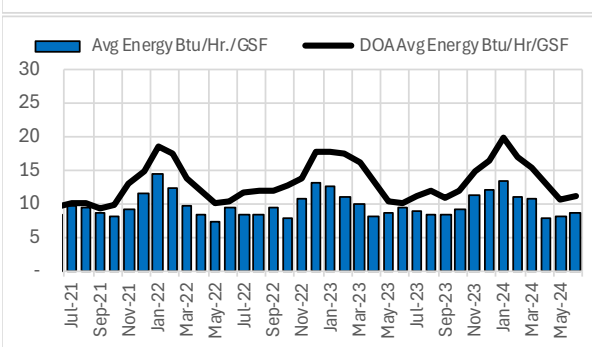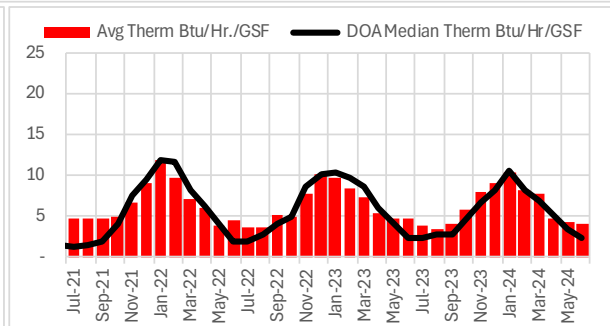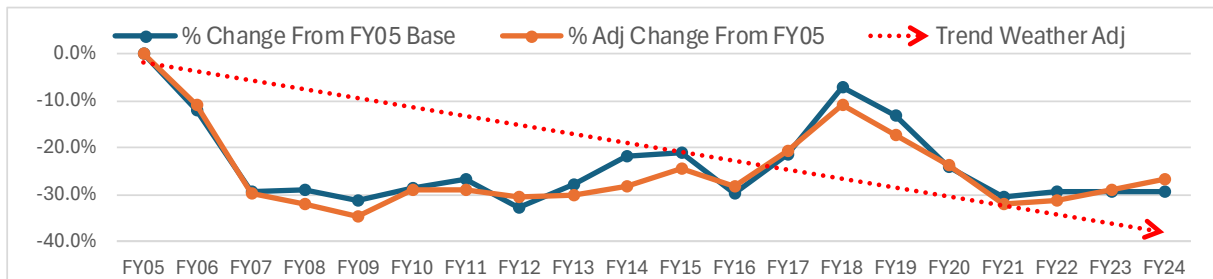

FY2024 DOA-Green Bay SOB State Facilities Energy Report

FY24 Electric kwh/GSF= 4.13			FY24 Therm/GSF = 0.29			FY24 Total Btu/GSF= 43,009			05-24 Thm 32.9%	
FY24 Electric \$/GSF= \$ 0.54			FY24 Thermal \$/GSF= \$ 0.17			FY24 Energy \$/GSF= \$ 0.71			05-24 kwh -56.2%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	69,206	25,116	31,967	57,083	0.0%	45.94	100.0%	100.0%	57,083	0.0%
FY06	69,206	17,639	34,117	51,756	-9.3%	47.26	102.9%	99.5%	52,084	-8.8%
FY07	69,206	22,474	30,409	52,883	-7.4%	46.64	102.8%	100.1%	53,553	-6.2%
FY08	69,206	19,469	30,073	49,542	-13.2%	45.02	87.7%	98.4%	46,674	-18.2%
FY09	69,206	22,037	27,430	49,467	-13.3%	43.47	85.9%	98.5%	45,951	-19.5%
FY10	69,206	18,068	27,351	45,419	-20.4%	45.98	105.1%	100.9%	46,589	-18.4%
FY11	69,206	20,849	27,519	48,368	-15.3%	44.58	90.4%	98.4%	45,938	-19.5%
FY12	69,206	16,866	26,453	43,320	-24.1%	49.86	115.7%	101.9%	46,467	-18.6%
FY13	69,206	20,019	27,095	47,114	-17.5%	45.29	93.5%	99.5%	45,671	-20.0%
FY14	69,206	25,164	26,603	51,767	-9.3%	41.95	82.1%	97.6%	46,648	-18.3%
FY15	69,206	22,995	24,819	47,814	-16.2%	43.98	97.2%	99.8%	47,124	-17.4%
FY16	69,206	19,149	24,227	43,375	-24.0%	48.11	103.9%	100.8%	44,321	-22.4%
FY17	69,206	18,101	23,416	41,518	-27.3%	48.65	117.3%	100.2%	44,687	-21.7%
FY18	69,206	30,079	21,551	51,631	-9.6%	45.41	92.9%	99.9%	49,493	-13.3%
FY19	69,206	29,576	21,541	51,118	-10.4%	44.90	92.8%	100.0%	48,981	-14.2%
FY20	69,206	31,489	14,856	46,345	-18.8%	46.40	101.6%	99.8%	46,833	-18.0%
FY21	69,206	33,062	11,850	44,912	-21.3%	47.28	105.8%	99.3%	46,735	-18.1%
FY22	69,206	36,388	13,561	49,948	-12.5%	46.76	97.5%	98.5%	48,830	-14.5%
FY23	69,206	35,959	14,319	50,278	-11.9%	47.58	107.4%	99.6%	52,859	-7.4%
FY24	69,206	28,917	14,092	43,009	-24.7%	49.93	115.5%	99.3%	47,374	-17.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

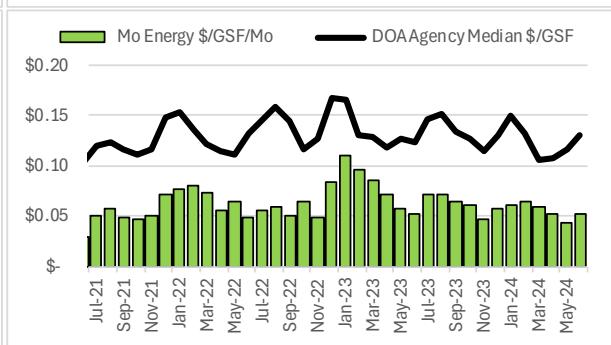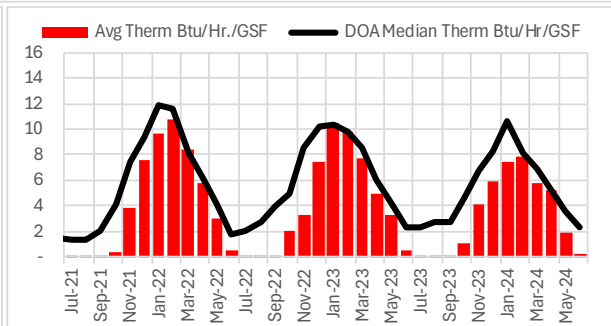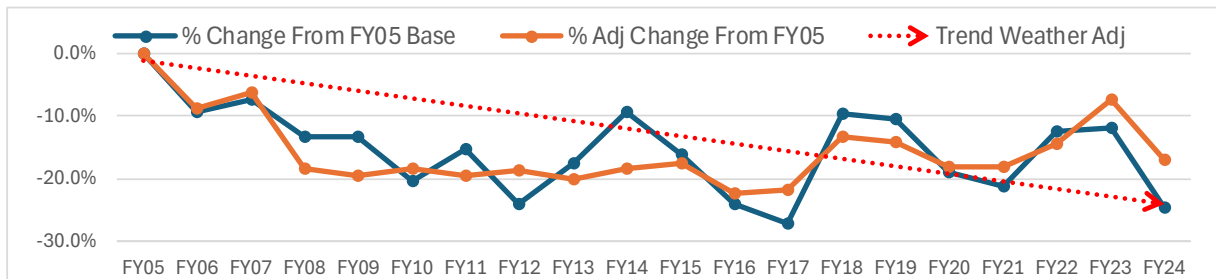

FY2024 DOA-La Crosse SOB State Facilities Energy Report

FY24 Electric kwh/GSF= 5.51			FY24 Therm/GSF = 0.28			FY24 Total Btu/GSF= 46,332			05-24 Thm -10.0%	
FY24 Electric \$/GSF= \$ 0.72			FY24 Thermal \$/GSF= \$ 0.19			FY24 Energy \$/GSF= \$ 0.90			05-24 kwh -41.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	45,965	34,964	32,505	67,468	0.0%	48.43	100.0%	100.0%	67,468	0.0%
FY06	45,965	28,585	35,819	64,404	-4.5%	49.77	99.2%	98.9%	63,788	-5.5%
FY07	45,965	29,512	35,552	65,064	-3.6%	48.68	99.0%	99.2%	64,500	-4.4%
FY08	45,965	30,993	35,730	66,723	-1.1%	46.15	85.5%	97.3%	61,238	-9.2%
FY09	45,965	29,773	32,487	62,259	-7.7%	45.86	86.8%	99.0%	58,008	-14.0%
FY10	45,965	27,401	31,435	58,837	-12.8%	47.43	94.1%	99.8%	57,141	-15.3%
FY11	45,965	30,778	30,972	61,750	-8.5%	46.70	86.9%	97.9%	57,076	-15.4%
FY12	45,965	23,611	31,222	54,833	-18.7%	51.77	111.4%	99.7%	57,442	-14.9%
FY13	45,965	45,670	32,309	77,978	15.6%	46.71	89.0%	99.2%	72,668	7.7%
FY14	45,965	51,560	32,126	83,685	24.0%	44.97	81.6%	96.5%	73,100	8.3%
FY15	45,965	40,100	30,047	70,147	4.0%	47.28	93.6%	98.5%	67,126	-0.5%
FY16	45,965	35,412	27,296	62,708	-7.1%	51.01	107.8%	98.1%	64,962	-3.7%
FY17	45,965	42,211	28,041	70,252	4.1%	51.62	109.5%	97.1%	73,436	8.8%
FY18	45,965	51,148	28,475	79,623	18.0%	48.61	94.7%	95.3%	75,605	12.1%
FY19	45,965	42,732	23,829	66,561	-1.3%	46.76	89.8%	97.3%	61,555	-8.8%
FY20	45,965	36,370	20,750	57,120	-15.3%	49.35	100.2%	96.9%	56,555	-16.2%
FY21	45,965	42,247	15,809	58,056	-14.0%	49.59	99.6%	94.7%	57,039	-15.5%
FY22	45,965	56,429	21,009	77,437	14.8%	48.90	97.1%	96.3%	74,995	11.2%
FY23	45,965	33,522	20,249	53,771	-20.3%	49.35	101.3%	97.0%	53,612	-20.5%
FY24	45,965	27,518	18,814	46,332	-31.3%	52.02	114.4%	100.3%	50,360	-25.4%


Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

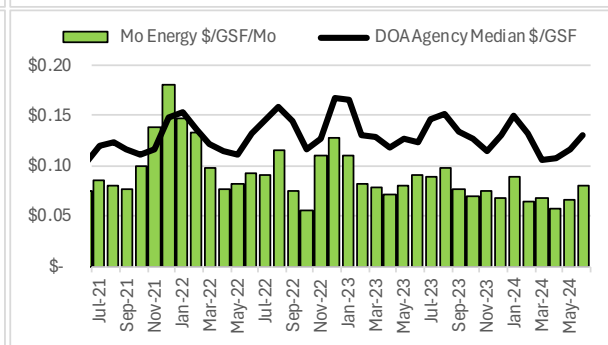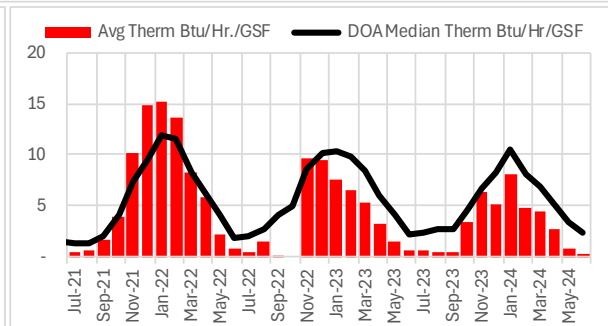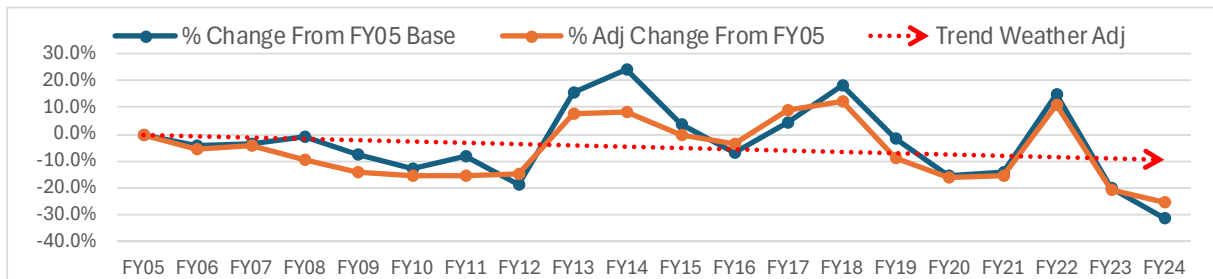

FY2024 DOA-Milwaukee SOB State Facilities Energy Report

FY24 Electric kwh/GSF= 8.42			FY24 Therm/GSF = 0.28			FY24 Total Btu/GSF= 56,277			05-24 Thm -13.6%	
FY24 Electric \$/GSF= \$ 1.26			FY24 Thermal \$/GSF= \$ 0.45			FY24 Energy \$/GSF= \$ 1.71			05-24 kwh -26.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	201,200	37,712	38,403	76,115	0.0%	48.47	100.0%	100.0%	76,115	0.0%
FY06	201,200	30,068	36,524	66,591	-12.5%	50.11	101.4%	98.3%	66,387	-12.8%
FY07	201,200	26,487	37,372	63,859	-16.1%	48.88	99.5%	98.9%	63,313	-16.8%
FY08	201,200	33,774	34,693	68,467	-10.0%	47.87	91.7%	98.2%	65,058	-14.5%
FY09	201,200	29,957	35,221	65,178	-14.4%	47.26	90.4%	98.8%	61,868	-18.7%
FY10	201,200	24,808	31,817	56,624	-25.6%	49.10	99.9%	99.9%	56,562	-25.7%
FY11	201,200	32,655	35,188	67,844	-10.9%	48.17	94.5%	99.5%	65,851	-13.5%
FY12	201,200	29,479	36,783	66,263	-12.9%	52.24	113.7%	99.1%	69,983	-8.1%
FY13	201,200	34,379	36,228	70,607	-7.2%	48.26	94.3%	99.1%	68,306	-10.3%
FY14	201,200	46,853	36,023	82,875	8.9%	45.20	82.0%	97.4%	73,499	-3.4%
FY15	201,200	43,010	34,206	77,216	1.4%	46.08	91.8%	100.4%	73,804	-3.0%
FY16	201,200	26,727	35,157	61,884	-18.7%	50.51	108.3%	99.4%	63,867	-16.1%
FY17	201,200	30,714	37,405	68,120	-10.5%	51.99	114.9%	97.2%	71,638	-5.9%
FY18	201,200	34,985	36,106	71,091	-6.6%	48.79	97.2%	97.9%	69,338	-8.9%
FY19	201,200	32,393	33,477	65,870	-13.5%	47.88	91.9%	98.2%	62,654	-17.7%
FY20	201,200	32,747	32,416	65,162	-14.4%	49.85	102.6%	99.6%	65,879	-13.4%
FY21	201,200	33,565	28,663	62,228	-18.2%	50.84	104.6%	99.3%	63,561	-16.5%
FY22	201,200	36,786	32,693	69,479	-8.7%	50.91	101.9%	98.2%	69,589	-8.6%
FY23	201,200	32,520	29,028	61,548	-19.1%	51.08	113.4%	99.8%	65,827	-13.5%
FY24	201,200	27,548	28,729	56,277	-26.1%	53.15	118.3%	98.9%	61,011	-19.8%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

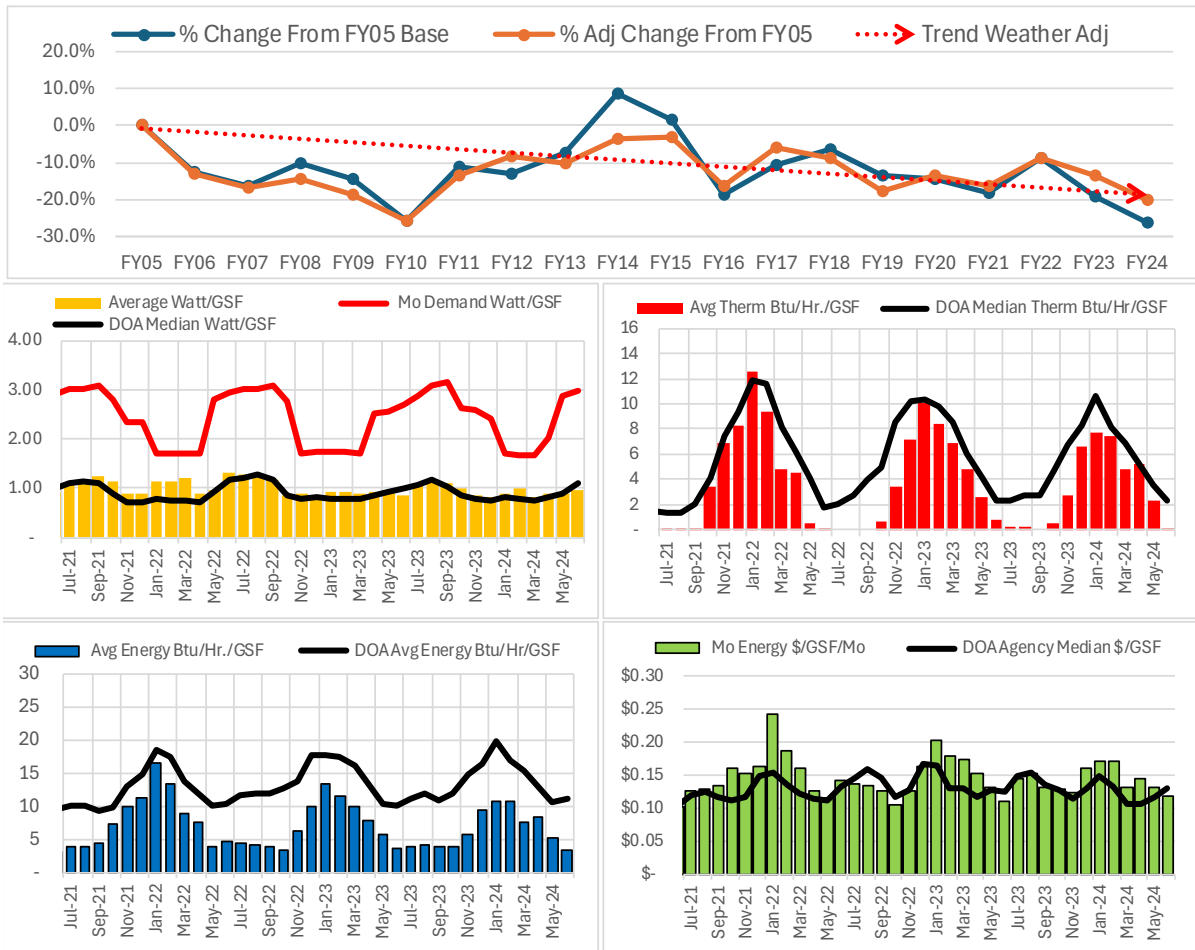

FY2024 DOA-Public Broadcasting State Facilities Energy Report

FY24 Electric kwh/GSF= 26.19			FY24 Therm/GSF = 0.89			FY24 Total Btu/GSF= 178,749			05-24 Thm -30.2%	
FY24 Electric \$/GSF= \$ 3.24			FY24 Thermal \$/GSF= \$ 0.50			FY24 Energy \$/GSF= \$ 3.74			05-24 kwh -31.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	48,246	128,605	129,746	258,351	0.0%	48.12	100.0%	100.0%	258,351	0.0%
FY06	48,246	98,018	123,853	221,871	-14.1%	48.65	99.0%	98.7%	219,256	-15.1%
FY07	48,246	95,086	100,630	195,716	-24.2%	47.46	98.1%	99.3%	193,211	-25.2%
FY08	48,246	97,915	102,515	200,430	-22.4%	46.19	91.1%	96.3%	187,903	-27.3%
FY09	48,246	105,107	105,091	210,198	-18.6%	45.66	97.1%	98.5%	205,538	-20.4%
FY10	48,246	107,512	104,616	212,128	-17.9%	47.10	97.9%	100.0%	209,887	-18.8%
FY11	48,246	111,323	102,905	214,228	-17.1%	46.81	100.6%	97.7%	212,489	-17.8%
FY12	48,246	122,323	103,573	225,896	-12.6%	51.51	102.3%	99.6%	228,273	-11.6%
FY13	48,246	112,353	104,457	216,810	-16.1%	47.29	100.0%	97.7%	214,410	-17.0%
FY14	48,246	84,388	95,518	179,907	-30.4%	44.58	95.0%	94.2%	170,143	-34.1%
FY15	48,246	111,889	103,084	214,973	-16.8%	45.84	99.3%	99.5%	213,681	-17.3%
FY16	48,246	122,171	110,776	232,947	-9.8%	49.68	100.1%	99.5%	232,508	-10.0%
FY17	48,246	114,796	108,685	223,480	-13.5%	49.72	99.4%	99.4%	222,145	-14.0%
FY18	48,246	102,700	96,114	198,814	-23.0%	46.66	99.2%	99.4%	197,486	-23.6%
FY19	48,246	101,667	98,377	200,044	-22.6%	45.87	99.1%	98.6%	197,807	-23.4%
FY20	48,246	107,603	96,966	204,570	-20.8%	48.08	100.0%	99.4%	203,954	-21.1%
FY21	48,246	99,492	88,826	188,318	-27.1%	47.61	99.7%	98.6%	186,796	-27.7%
FY22	48,246	99,732	92,348	192,080	-25.7%	48.04	99.9%	98.3%	190,456	-26.3%
FY23	48,246	86,886	88,755	175,641	-32.0%	48.63	100.0%	100.0%	175,643	-32.0%
FY24	48,246	89,374	89,375	178,749	-30.8%	50.95	100.4%	100.1%	179,216	-30.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

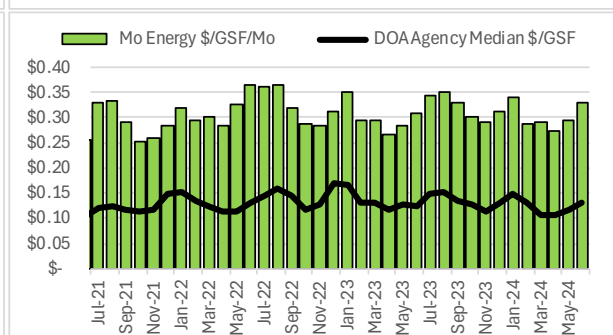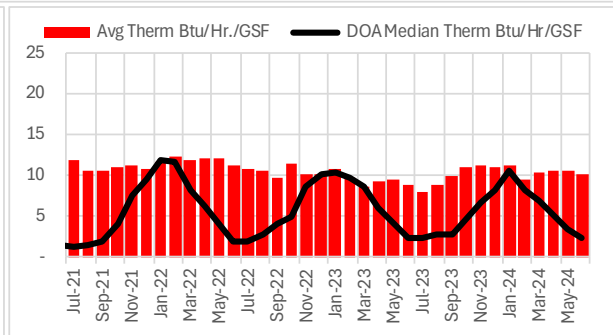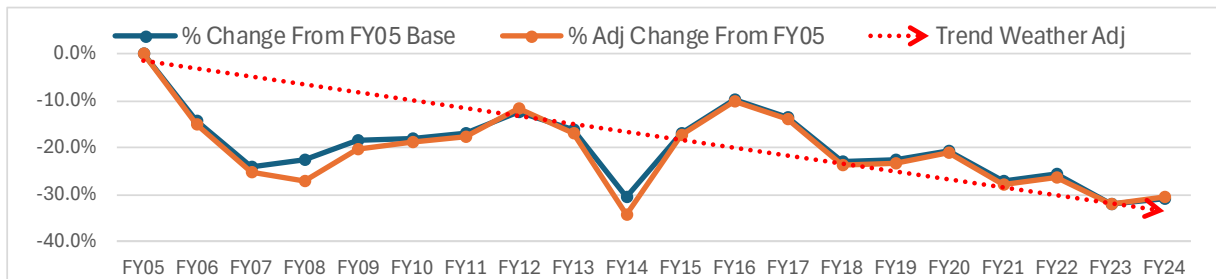

FY2024 DOA-SE Crime Lab State Facilities Energy Report

FY24 Electric kwh/GSF= 26.63			FY24 Therm/GSF = 0.87			FY24 Total Btu/GSF= 177,623		05-24 Thm 98.0%		
FY24 Electric \$/GSF= \$ 3.28			FY24 Thermal \$/GSF= \$ 0.49			FY24 Energy \$/GSF= \$ 3.77		05-24 kwh 28.6%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	43,935	51,334	69,155	120,490	0.0%	48.47	100.0%	100.0%	120,490	0.0%
FY06	43,935	52,546	69,997	122,543	1.7%	50.11	105.0%	97.5%	123,382	2.4%
FY07	43,935	54,697	66,429	121,126	0.5%	48.88	98.3%	99.0%	119,566	-0.8%
FY08	43,935	63,698	68,578	132,276	9.8%	47.87	92.5%	98.6%	126,546	5.0%
FY09	43,935	61,753	66,044	127,797	6.1%	47.26	90.0%	99.5%	121,300	0.7%
FY10	43,935	63,506	65,705	129,211	7.2%	49.10	103.1%	99.8%	131,036	8.8%
FY11	43,935	72,182	70,595	142,778	18.5%	48.17	93.1%	98.4%	136,664	13.4%
FY12	43,935	60,698	73,242	133,940	11.2%	52.24	113.4%	97.8%	140,470	16.6%
FY13	43,935	82,143	71,309	153,451	27.4%	48.26	94.7%	99.1%	148,432	23.2%
FY14	43,935	107,693	75,420	183,112	52.0%	45.20	80.5%	100.0%	162,054	34.5%
FY15	43,935	115,140	84,814	199,955	66.0%	46.08	93.4%	101.1%	193,318	60.4%
FY16	43,935	71,882	93,648	165,530	37.4%	50.51	106.0%	98.9%	168,803	40.1%
FY17	43,935	89,647	103,724	193,371	60.5%	51.99	106.1%	95.8%	194,500	61.4%
FY18	43,935	107,181	103,849	211,030	75.1%	48.79	100.7%	99.3%	211,045	75.2%
FY19	43,935	112,746	99,047	211,793	75.8%	47.88	96.3%	98.4%	206,041	71.0%
FY20	43,935	88,980	98,737	187,718	55.8%	49.85	103.7%	99.1%	190,091	57.8%
FY21	43,935	99,354	94,518	193,872	60.9%	50.84	104.8%	96.2%	195,129	61.9%
FY22	43,935	105,114	94,175	199,289	65.4%	50.91	103.0%	95.7%	198,416	64.7%
FY23	43,935	97,398	88,925	186,323	54.6%	51.08	109.9%	98.9%	194,932	61.8%
FY24	43,935	86,731	90,892	177,623	47.4%	53.15	117.2%	97.8%	190,555	58.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

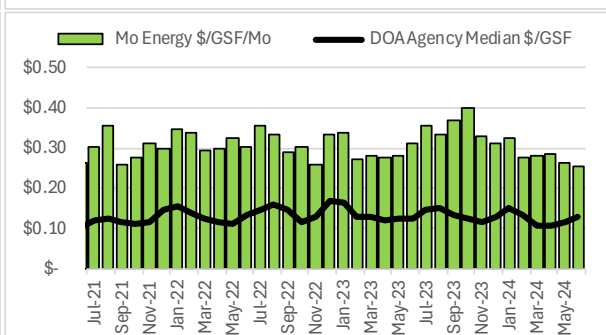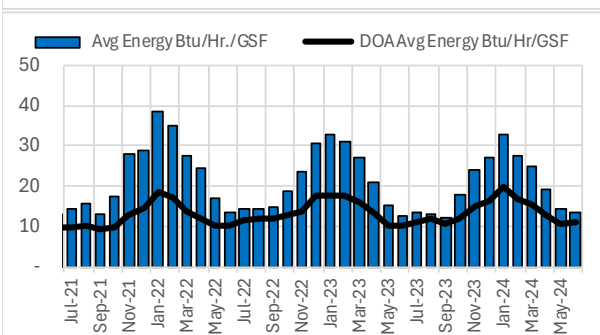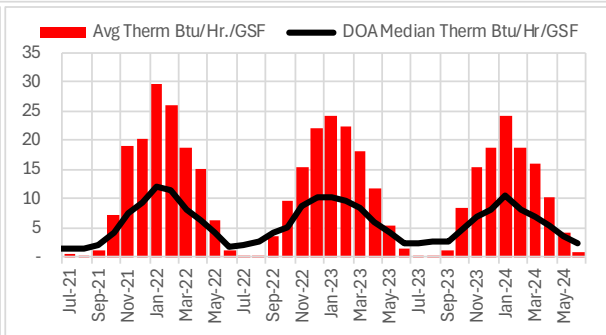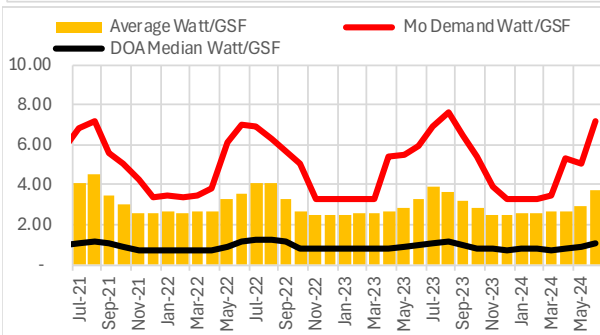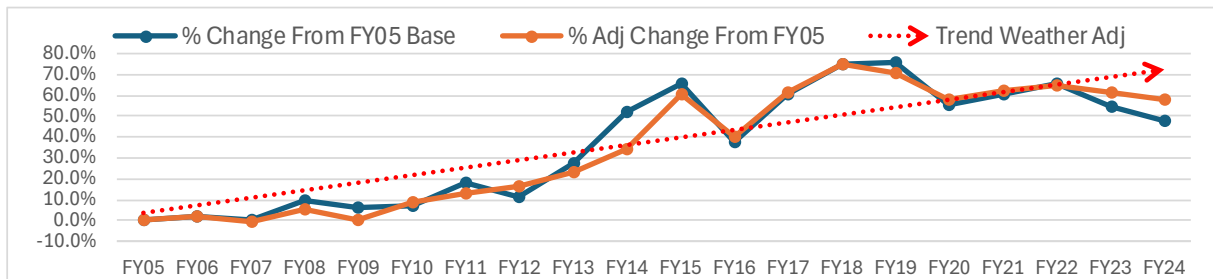

FY2024 DOA-State Ag State Facilities Energy Report

FY24 Electric kwh/GSF= 6.99			FY24 Therm/GSF = 0.38			FY24 Total Btu/GSF= 62,074			05-24 Thm -5.5%	
FY24 Electric \$/GSF= \$ 1.31			FY24 Thermal \$/GSF= \$ 0.21			FY24 Energy \$/GSF= \$ 1.52			05-24 kwh -49.2%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	118,011	44,767	45,771	90,538	0.0%	48.12	100.0%	100.0%	90,538	0.0%
FY06	118,011	46,996	47,488	94,484	4.4%	48.65	98.8%	98.8%	93,315	3.1%
FY07	118,011	45,919	45,363	91,283	0.8%	47.46	91.1%	99.3%	86,856	-4.1%
FY08	118,011	50,343	43,200	93,542	3.3%	46.19	91.6%	98.9%	88,807	-1.9%
FY09	118,011	48,159	40,397	88,556	-2.2%	45.66	86.4%	99.6%	81,864	-9.6%
FY10	118,011	39,881	39,166	79,047	-12.7%	47.10	93.2%	100.8%	76,638	-15.4%
FY11	118,011	41,563	38,225	79,788	-11.9%	46.81	88.4%	97.8%	74,144	-18.1%
FY12	118,011	31,247	35,444	66,692	-26.3%	51.51	106.8%	97.3%	67,881	-25.0%
FY13	118,011	38,563	35,237	73,799	-18.5%	47.29	92.2%	98.6%	70,333	-22.3%
FY14	118,011	49,736	35,596	85,332	-5.8%	44.58	81.2%	98.2%	75,353	-16.8%
FY15	118,011	44,184	34,587	78,771	-13.0%	45.84	88.6%	100.1%	73,760	-18.5%
FY16	118,011	37,539	33,251	70,790	-21.8%	49.68	105.4%	98.7%	72,381	-20.1%
FY17	118,011	39,363	32,764	72,127	-20.3%	49.72	104.7%	98.2%	73,402	-18.9%
FY18	118,011	42,730	32,211	74,941	-17.2%	46.66	90.6%	100.2%	70,987	-21.6%
FY19	118,011	44,521	30,019	74,540	-17.7%	45.87	88.0%	99.6%	69,076	-23.7%
FY20	118,011	38,414	25,691	64,105	-29.2%	48.08	96.8%	99.3%	62,700	-30.7%
FY21	118,011	44,160	26,862	71,022	-21.6%	47.61	93.5%	96.8%	67,277	-25.7%
FY22	118,011	47,033	30,015	77,047	-14.9%	48.04	98.4%	96.4%	75,212	-16.9%
FY23	118,011	49,803	25,308	75,110	-17.0%	48.63	102.0%	99.2%	75,912	-16.2%
FY24	118,011	38,213	23,861	62,074	-31.4%	50.95	110.7%	97.4%	65,549	-27.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

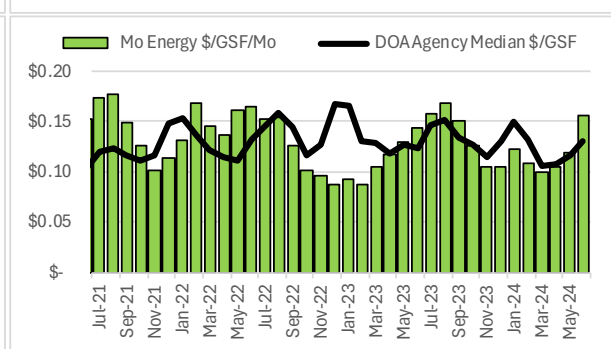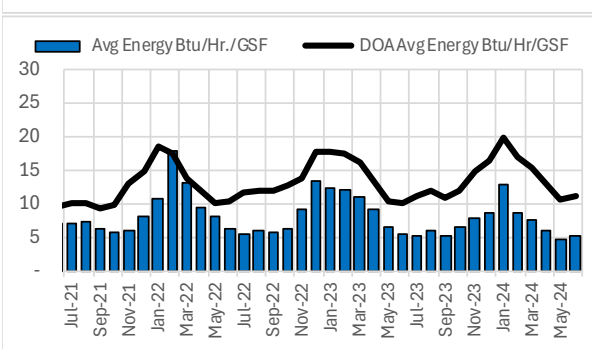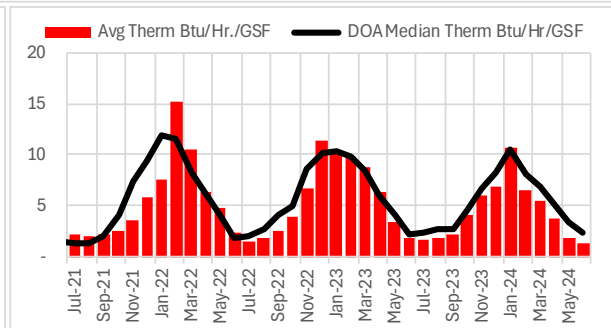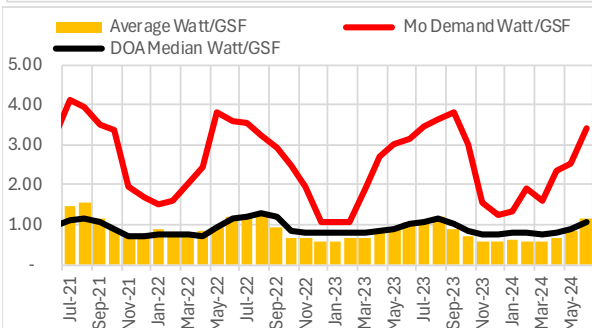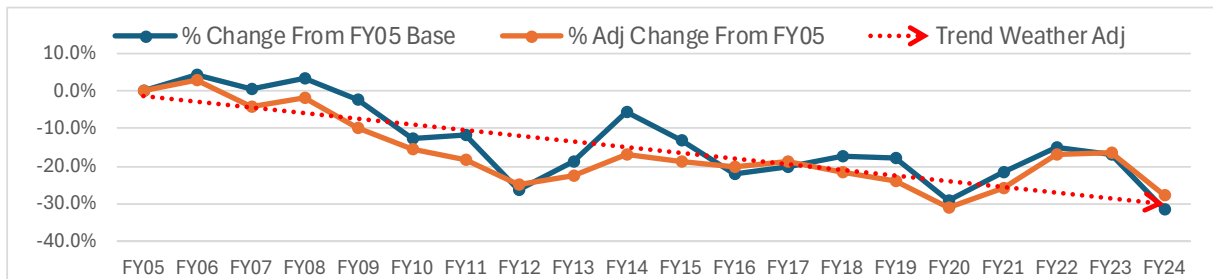

FY2024 DOA-State Hygiene Lab State Facilities Energy Report

FY24 Electric kwh/GSF= 45.46			FY24 Therm/GSF = 1.92			FY24 Total Btu/GSF= 347,567			05-24 Thm -28.0%	
FY24 Electric \$/GSF= \$ 5.91			FY24 Thermal \$/GSF= \$ 0.87			FY24 Energy \$/GSF= \$ 6.78			05-24 kwh -14.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	77,505	297,710	176,259	473,969	0.0%	48.12	100.0%	100.0%	473,969	0.0%
FY06	77,505	280,021	192,880	472,900	-0.2%	48.65	99.1%	98.9%	468,196	-1.2%
FY07	77,505	298,923	189,399	488,322	3.0%	47.46	98.3%	99.6%	482,697	1.8%
FY08	77,505	310,741	192,525	503,266	6.2%	46.19	92.3%	99.3%	477,799	0.8%
FY09	77,505	326,824	194,168	520,992	9.9%	45.66	92.6%	100.0%	496,907	4.8%
FY10	77,505	279,681	189,726	469,408	-1.0%	47.10	97.8%	100.8%	464,855	-1.9%
FY11	77,505	300,107	196,508	496,615	4.8%	46.81	94.6%	98.6%	477,472	0.7%
FY12	77,505	293,462	170,051	463,514	-2.2%	51.51	107.4%	96.9%	480,089	1.3%
FY13	77,505	345,524	175,931	521,455	10.0%	47.29	96.0%	100.1%	507,879	7.2%
FY14	160,344	229,182	132,158	361,340	-23.8%	44.58	81.9%	99.5%	319,197	-32.7%
FY15	160,344	239,461	139,247	378,709	-20.1%	45.84	91.9%	100.4%	359,828	-24.1%
FY16	160,344	196,523	139,246	335,769	-29.2%	49.68	105.4%	98.8%	344,630	-27.3%
FY17	160,344	184,987	148,451	333,438	-29.6%	49.72	103.5%	97.4%	336,202	-29.1%
FY18	160,344	237,164	150,858	388,022	-18.1%	46.66	93.1%	99.4%	370,781	-21.8%
FY19	160,344	230,466	154,710	385,177	-18.7%	45.87	90.6%	99.6%	362,989	-23.4%
FY20	160,344	193,614	156,001	349,615	-26.2%	48.08	99.8%	99.3%	348,201	-26.5%
FY21	160,344	198,491	141,324	339,814	-28.3%	47.61	96.3%	99.0%	331,152	-30.1%
FY22	160,344	224,756	162,391	387,147	-18.3%	48.04	96.6%	96.7%	374,227	-21.0%
FY23	160,344	219,087	150,676	369,764	-22.0%	48.63	101.5%	99.3%	372,071	-21.5%
FY24	160,344	192,422	155,144	347,567	-26.7%	50.95	111.4%	97.2%	365,239	-22.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

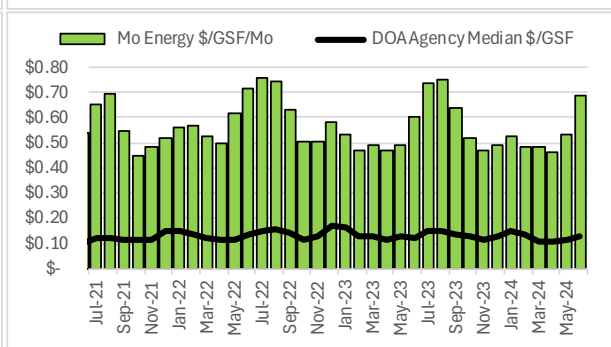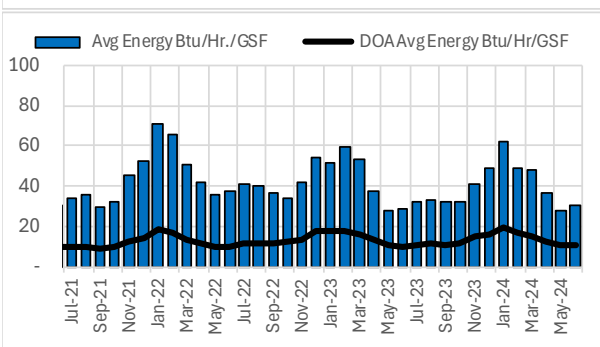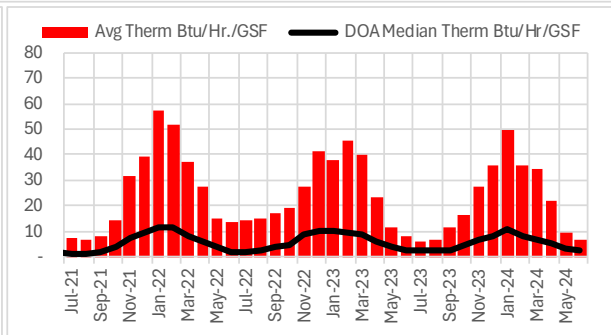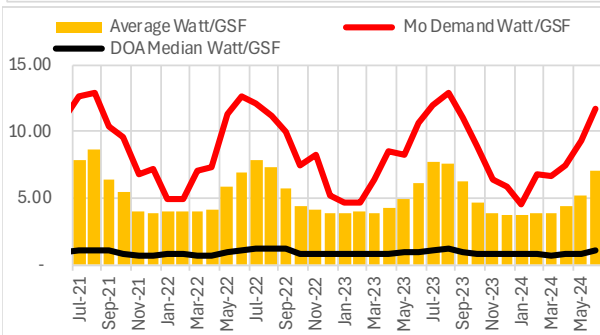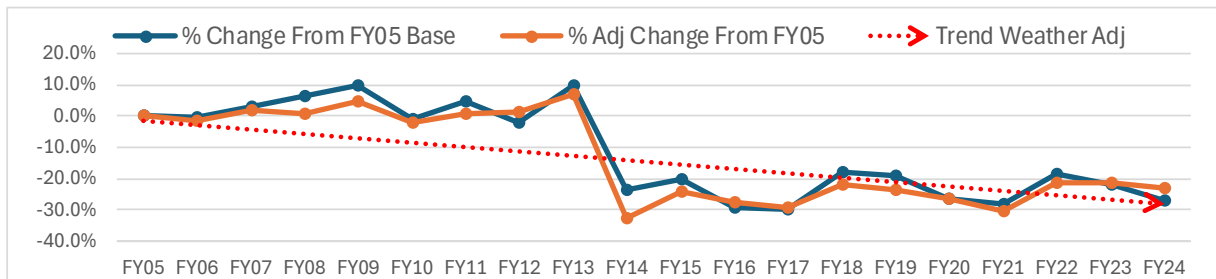

FY2024 DOA-State Revenue State Facilities Energy Report

FY24 Electric kwh/GSF= 6.55			FY24 Therm/GSF = 0.36			FY24 Total Btu/GSF= 58,722			05-24 Thm -47.9%	
FY24 Electric \$/GSF= \$ 0.98			FY24 Thermal \$/GSF= \$ 0.18			FY24 Energy \$/GSF= \$ 1.16			05-24 kwh -64.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	247,224	73,435	61,299	134,734	0.0%	48.12	100.0%	100.0%	134,734	0.0%
FY06	247,224	62,497	62,098	124,595	-7.5%	48.65	102.5%	98.7%	125,384	-6.9%
FY07	247,224	24,015	51,677	75,692	-43.8%	47.46	96.0%	100.0%	74,721	-44.5%
FY08	247,224	11,651	44,492	56,143	-58.3%	46.19	84.4%	99.5%	54,094	-59.9%
FY09	247,224	15,938	43,465	59,402	-55.9%	45.66	87.3%	99.9%	57,309	-57.5%
FY10	247,224	10,088	36,696	46,784	-65.3%	47.10	97.4%	100.6%	46,758	-65.3%
FY11	247,224	12,179	33,817	45,996	-65.9%	46.81	87.8%	101.2%	44,914	-66.7%
FY12	247,224	12,714	37,133	49,847	-63.0%	51.51	108.2%	97.9%	50,120	-62.8%
FY13	247,224	25,960	36,911	62,871	-53.3%	47.29	93.2%	99.8%	61,026	-54.7%
FY14	247,224	31,527	36,903	68,430	-49.2%	44.58	85.8%	100.4%	64,074	-52.4%
FY15	247,224	38,988	36,705	75,694	-43.8%	45.84	96.3%	100.7%	74,522	-44.7%
FY16	247,224	26,334	34,235	60,569	-55.0%	49.68	102.9%	98.8%	60,913	-54.8%
FY17	247,224	39,967	36,190	76,157	-43.5%	49.72	102.8%	98.4%	76,714	-43.1%
FY18	247,224	34,991	33,718	68,708	-49.0%	46.66	97.5%	100.2%	67,889	-49.6%
FY19	247,224	37,980	32,021	70,002	-48.0%	45.87	90.9%	100.2%	66,627	-50.5%
FY20	247,224	30,803	28,574	59,377	-55.9%	48.08	99.9%	99.5%	59,217	-56.0%
FY21	247,224	32,782	25,111	57,893	-57.0%	47.61	94.8%	99.0%	55,937	-58.5%
FY22	247,224	33,934	25,928	59,862	-55.6%	48.04	99.5%	98.0%	59,188	-56.1%
FY23	247,224	42,590	25,241	67,831	-49.7%	48.63	100.5%	99.3%	67,851	-49.6%
FY24	247,224	36,351	22,371	58,722	-56.4%	50.95	105.3%	97.4%	60,088	-55.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

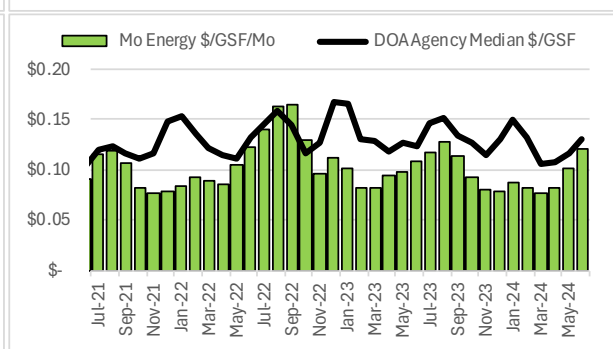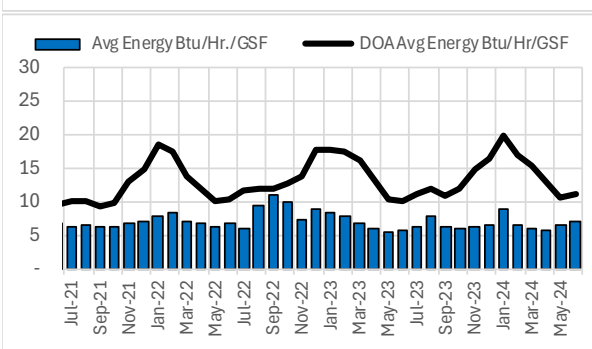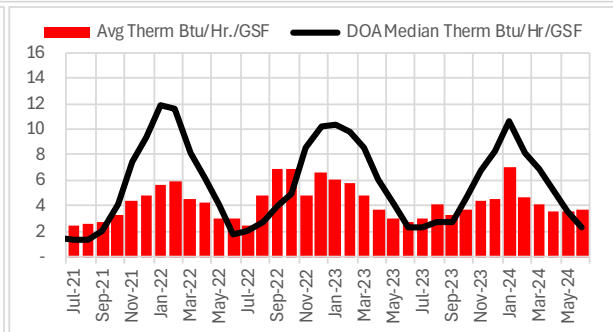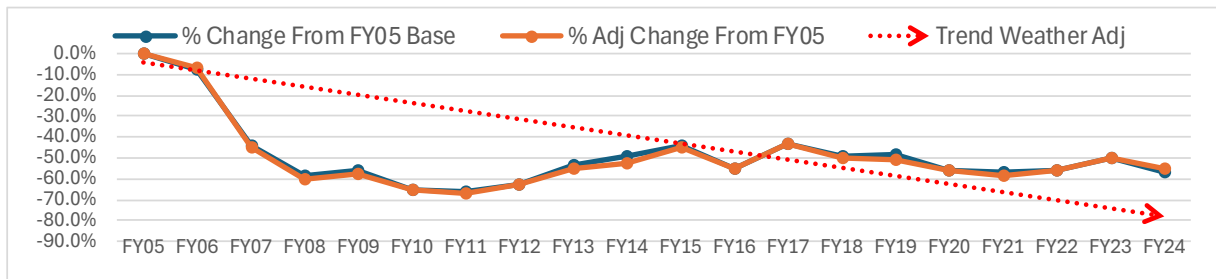

FY2024 DOA-Waukesha SOB State Facilities Energy Report

FY24 Electric kwh/GSF= 5.91			FY24 Therm/GSF = 0.21			FY24 Total Btu/GSF= 40,857			05-24 Thm -48.3%	
FY24 Electric \$/GSF= \$ 0.88			FY24 Thermal \$/GSF= \$ 0.10			FY24 Energy \$/GSF= \$ 0.98			05-24 kwh -64.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	169,976	44,800	56,937	101,737	0.0%	48.12	100.0%	100.0%	101,737	0.0%
FY06	169,976	36,390	50,590	86,981	-14.5%	48.65	97.5%	99.2%	85,665	-15.8%
FY07	169,976	32,300	50,248	82,549	-18.9%	47.46	91.7%	99.5%	79,594	-21.8%
FY08	169,976	28,465	50,841	79,306	-22.0%	46.19	86.6%	98.3%	74,600	-26.7%
FY09	169,976	28,974	49,954	78,928	-22.4%	45.66	85.4%	98.3%	73,868	-27.4%
FY10	169,976	24,756	47,896	72,652	-28.6%	47.10	92.1%	100.2%	70,782	-30.4%
FY11	169,976	28,687	47,106	75,793	-25.5%	46.81	88.6%	98.3%	71,748	-29.5%
FY12	169,976	19,840	47,771	67,611	-33.5%	51.51	107.7%	98.9%	68,618	-32.6%
FY13	169,976	27,911	51,217	79,128	-22.2%	47.29	92.3%	98.8%	76,349	-25.0%
FY14	169,976	37,456	46,445	83,901	-17.5%	44.58	80.2%	98.1%	75,597	-25.7%
FY15	169,976	52,758	50,340	103,098	1.3%	45.84	91.0%	99.7%	98,176	-3.5%
FY16	169,976	32,248	43,635	75,883	-25.4%	49.68	104.8%	99.4%	77,181	-24.1%
FY17	169,976	31,676	40,069	71,745	-29.5%	49.72	105.1%	99.0%	72,965	-28.3%
FY18	169,976	26,999	38,860	65,858	-35.3%	46.66	88.5%	98.9%	62,337	-38.7%
FY19	169,976	31,312	31,104	62,416	-38.6%	45.87	85.5%	97.6%	57,108	-43.9%
FY20	169,976	24,386	23,421	47,807	-53.0%	48.08	97.7%	99.1%	47,020	-53.8%
FY21	169,976	26,332	19,635	45,967	-54.8%	47.61	91.9%	96.7%	43,176	-57.6%
FY22	169,976	25,777	20,122	45,899	-54.9%	48.04	90.8%	98.1%	43,147	-57.6%
FY23	169,976	23,469	19,533	43,003	-57.7%	48.63	100.6%	100.2%	43,184	-57.6%
FY24	169,976	20,676	20,181	40,857	-59.8%	50.95	112.0%	100.4%	43,425	-57.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

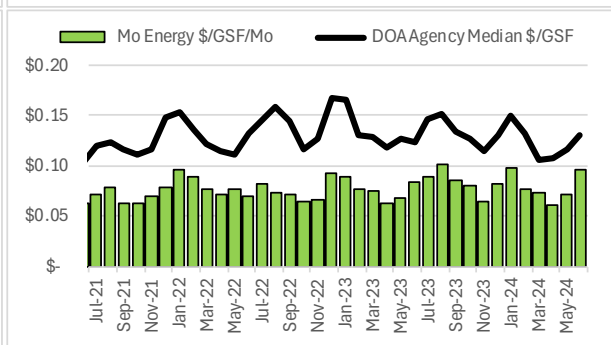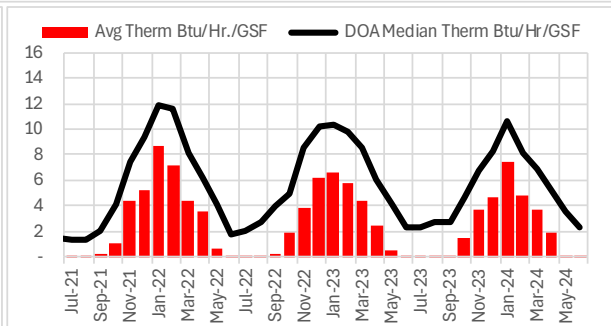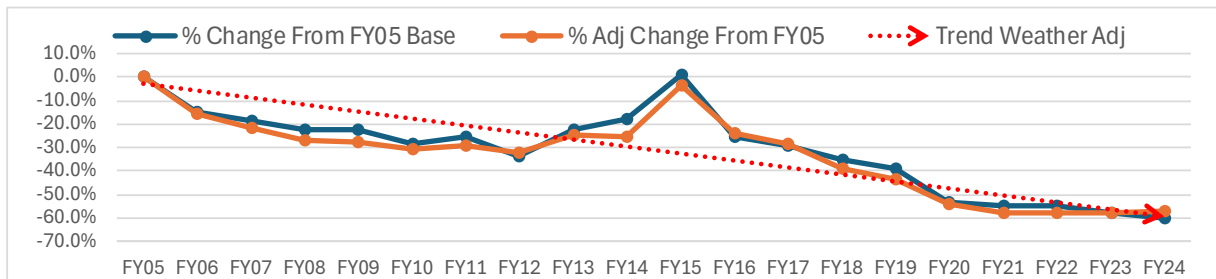

FY2024 DOA-WI Rapids SOB State Facilities Energy Report

FY24 Electric kwh/GSF= 5.39			FY24 Therm/GSF = 0.32			FY24 Total Btu/GSF= 49,928			05-24 Thm -27.8%	
FY24 Electric \$/GSF= \$ 0.72			FY24 Thermal \$/GSF= \$ 0.21			FY24 Energy \$/GSF= \$ 0.93			05-24 kwh -33.8%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	51,552	50,308	27,827	78,136	0.0%	44.50	100.0%	100.0%	78,136	0.0%
FY06	51,552	42,140	34,877	77,017	-1.4%	46.21	103.3%	99.4%	78,175	0.0%
FY07	51,552	39,279	41,063	80,342	2.8%	44.70	101.6%	99.7%	80,858	3.5%
FY08	51,552	23,935	40,359	64,294	-17.7%	42.68	83.0%	99.5%	60,026	-23.2%
FY09	51,552	42,187	40,263	82,450	5.5%	42.20	85.4%	99.0%	75,913	-2.8%
FY10	51,552	39,496	37,848	77,344	-1.0%	45.07	102.8%	101.0%	78,855	0.9%
FY11	51,552	50,138	36,280	86,418	10.6%	43.03	89.6%	99.8%	81,118	3.8%
FY12	51,552	43,331	32,525	75,856	-2.9%	48.08	110.9%	99.9%	80,557	3.1%
FY13	51,552	38,431	31,307	69,738	-10.7%	43.78	93.8%	99.5%	67,223	-14.0%
FY14	51,552	38,735	29,858	68,593	-12.2%	40.42	80.5%	98.1%	60,454	-22.6%
FY15	51,552	34,448	25,424	59,872	-23.4%	42.00	90.6%	98.8%	56,327	-27.9%
FY16	51,552	27,174	24,492	51,665	-33.9%	47.49	109.3%	101.5%	54,582	-30.1%
FY17	51,552	31,325	23,505	54,830	-29.8%	45.96	105.1%	100.7%	56,572	-27.6%
FY18	51,552	33,711	22,275	55,986	-28.3%	43.03	90.0%	98.9%	52,374	-33.0%
FY19	51,552	35,626	21,803	57,429	-26.5%	41.93	88.5%	99.6%	53,238	-31.9%
FY20	51,552	30,752	17,192	47,945	-38.6%	43.74	94.7%	100.7%	46,433	-40.6%
FY21	51,552	32,175	13,315	45,490	-41.8%	45.40	101.8%	98.3%	45,848	-41.3%
FY22	51,552	36,296	16,239	52,535	-32.8%	45.76	96.6%	96.2%	50,677	-35.1%
FY23	51,552	33,848	18,013	51,861	-33.6%	46.29	104.4%	99.0%	53,190	-31.9%
FY24	51,552	31,539	18,389	49,928	-36.1%	48.13	115.2%	100.2%	54,760	-29.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

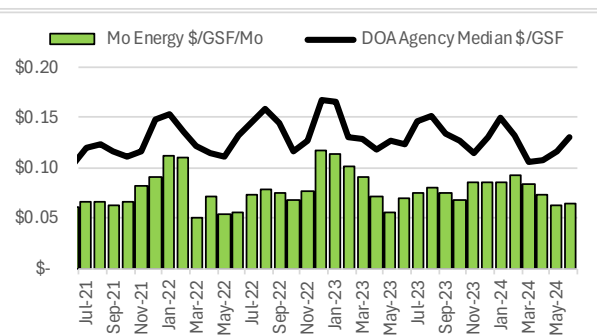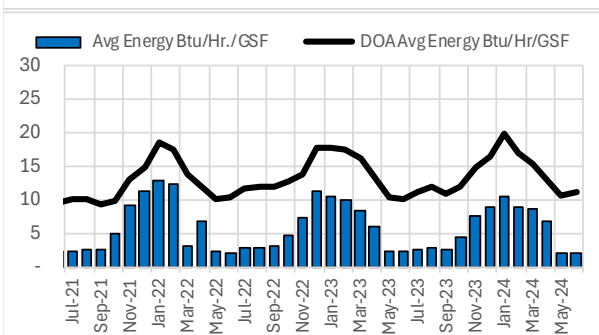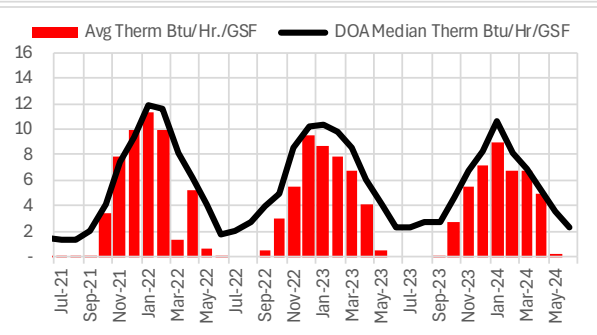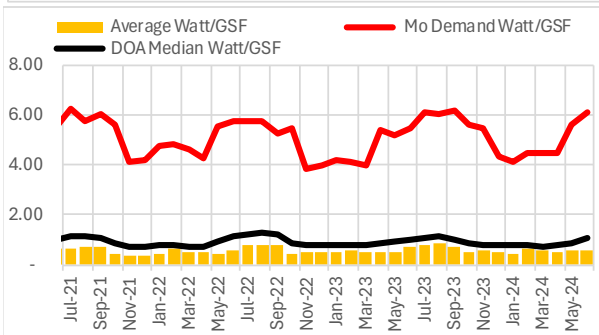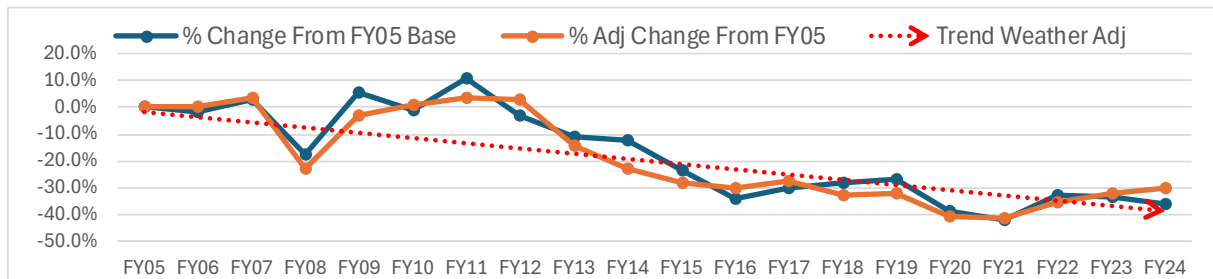

FY2024 DOA-Femrite Data Center State Facilities Energy Report

FY24 Electric kwh/GSF= 114.54			FY24 Therm/GSF = 0.53			FY24 Total Btu/GSF= 444,002			05-24 Thm	
FY24 Electric \$/GSF= \$ 13.28			FY24 Thermal \$/GSF= \$ 0.31			FY24 Energy \$/GSF= \$ 13.60			05-24 kwh	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	-									
FY06	-									
FY07	56,987	53,949	265,496	319,444	0.0%	47.46	100.0%	99.8%	318,829	0.0%
FY08	56,987	53,949	409,775	463,724	45.2%	46.19	98.1%	100.1%	463,204	45.3%
FY09	56,987	53,949	454,990	508,939	59.3%	45.66	97.3%	99.7%	505,956	58.7%
FY10	56,987	53,949	456,994	510,943	59.9%	47.10	98.9%	100.2%	511,094	60.3%
FY11	56,987	53,949	429,179	483,128	51.2%	46.81	98.2%	100.1%	482,646	51.4%
FY12	56,987	53,949	399,136	453,084	41.8%	51.51	105.7%	98.6%	450,387	41.3%
FY13	56,987	53,949	368,674	422,623	32.3%	47.29	98.8%	100.3%	422,904	32.6%
FY14	56,987	53,949	367,123	421,072	31.8%	44.58	96.2%	99.9%	418,775	31.3%
FY15	56,987	53,949	398,367	452,316	41.6%	45.84	98.4%	100.4%	453,216	42.1%
FY16	56,987	53,949	404,172	458,120	43.4%	49.68	102.5%	99.6%	457,912	43.6%
FY17	56,987	53,949	387,951	441,899	38.3%	49.72	102.3%	99.6%	441,741	38.6%
FY18	56,987	55,626	398,621	454,248	42.2%	46.66	96.3%	99.7%	451,087	41.5%
FY19	56,987	59,563	393,213	452,776	41.7%	45.87	96.7%	99.9%	450,455	41.3%
FY20	56,987	61,283	370,961	432,245	35.3%	48.08	100.1%	99.9%	431,786	35.4%
FY21	56,987	59,389	358,433	417,822	30.8%	47.61	98.5%	99.5%	415,139	30.2%
FY22	56,987	54,591	362,549	417,140	30.6%	48.04	100.2%	99.6%	415,637	30.4%
FY23	56,987	57,781	393,361	451,142	41.2%	48.63	100.8%	100.0%	451,628	41.7%
FY24	56,987	53,076	390,925	444,002	39.0%	50.95	103.8%	99.6%	444,242	39.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

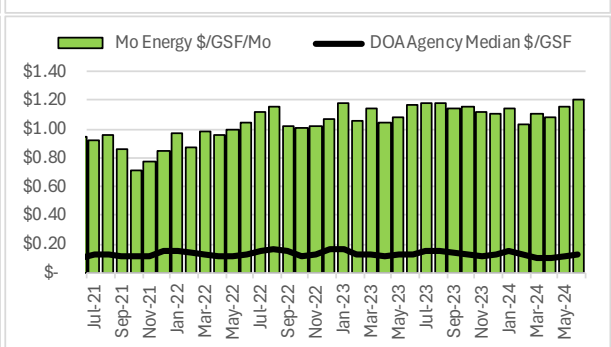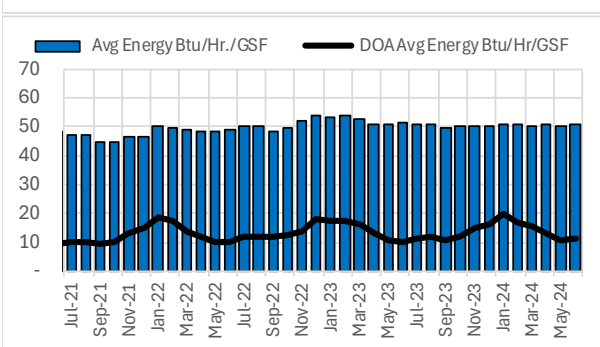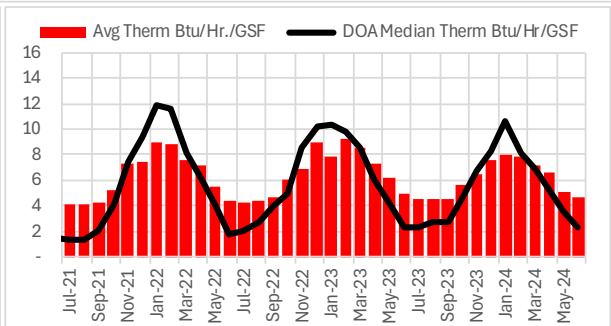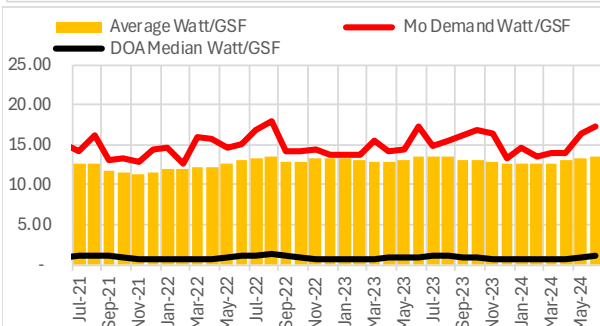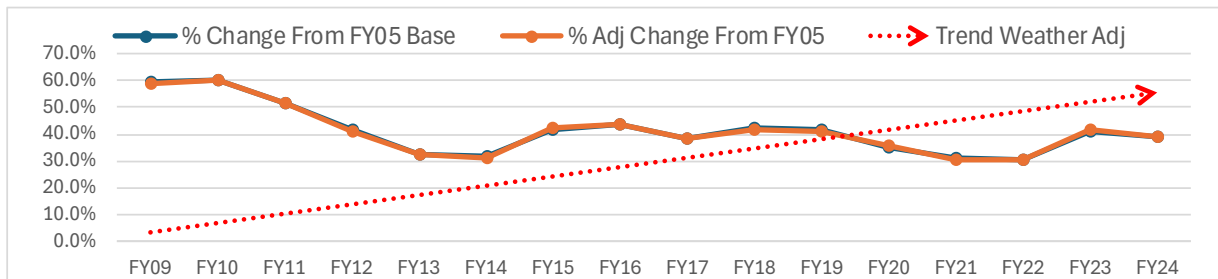

FY2024 DOA-Archive & Preservation State Facilities Energy Report

FY24 Electric kwh/GSF= 26.16			FY24 Therm/GSF = 1.41			FY24 Total Btu/GSF= 230,587			05-24 Thm	
FY24 Electric \$/GSF= \$ 3.02			FY24 Thermal \$/GSF= \$ 0.63			FY24 Energy \$/GSF= \$ 3.65			05-24 kwh	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	-									
FY06	-									
FY07	-									
FY08	-									
FY09	-									
FY10	-									
FY11	-									
FY12	-									
FY13	-									
FY14	-									
FY15	-									
FY16	-									
FY17	-									
FY18	-									
FY19	-									
FY20	-									
FY21	-									
FY22	-									
FY23	182,803	151,672	91,716	243,387	0.0%	48.63	100.2%	99.9%	243,684	0.0%
FY24	182,803	141,293	89,293	230,587	-5.3%	50.95	100.6%	99.4%	230,840	-5.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

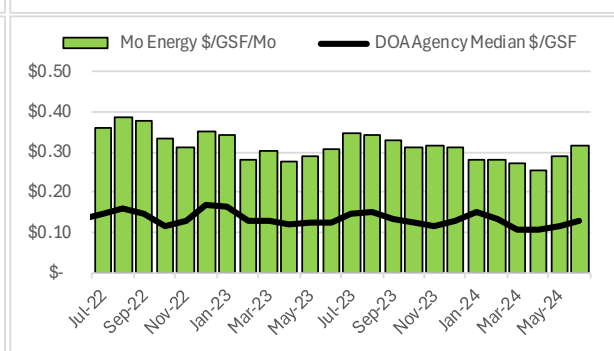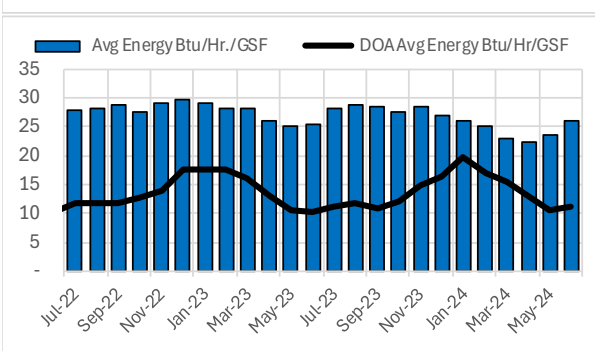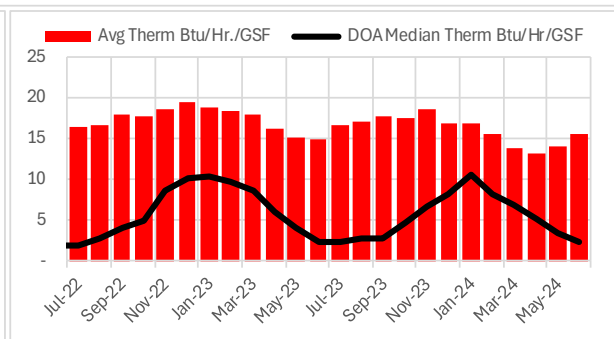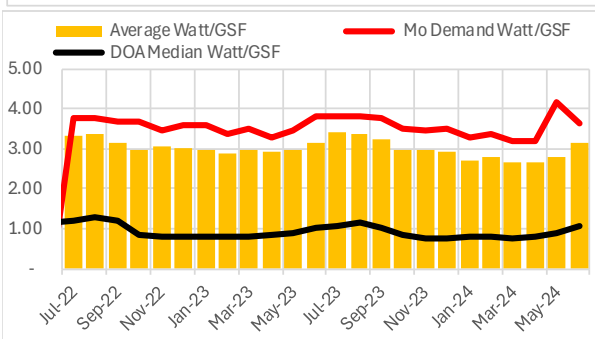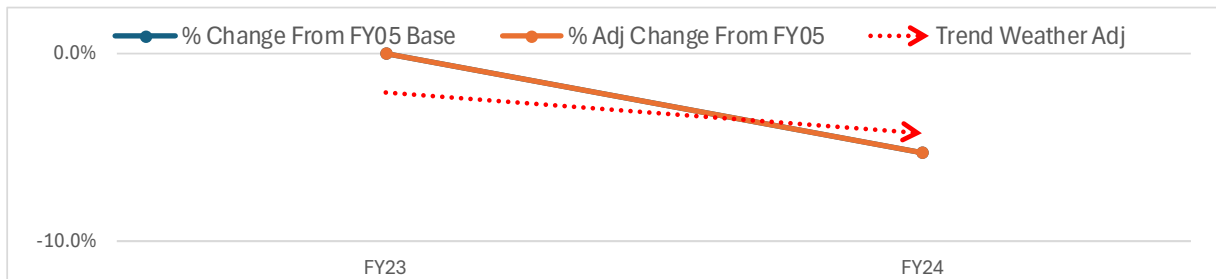

FY2024 DOA-Thompson Center State Facilities Energy Report

FY24 Electric kwh/GSF= 12.70			FY24 Therm/GSF = 0.51			FY24 Total Btu/GSF= 94,503			05-24 Thm	
FY24 Electric \$/GSF= \$ 1.64			FY24 Thermal \$/GSF= \$ 0.26			FY24 Energy \$/GSF= \$ 1.90			05-24 kwh	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	-									
FY06	-									
FY07	-									
FY08	-									
FY09	-									
FY10	-									
FY11	-									
FY12	-									
FY13	-									
FY14	-									
FY15	-									
FY16	-									
FY17	-									
FY18	-									
FY19	-									
FY20	-									
FY21	-									
FY22	-									
FY23	155,823	60,410	45,369	105,779	0.0%	48.63	101.6%	99.7%	106,607	0.0%
FY24	155,823	51,143	43,359	94,503	-10.7%	50.95	108.6%	98.7%	98,356	-7.7%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

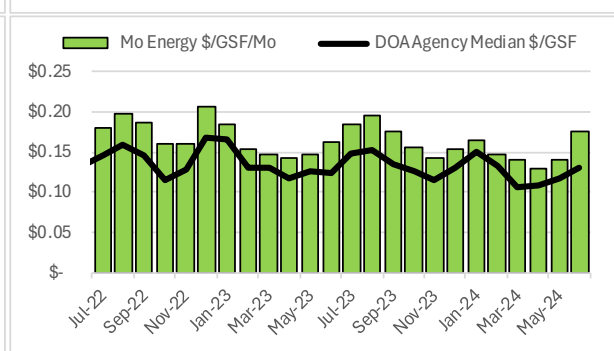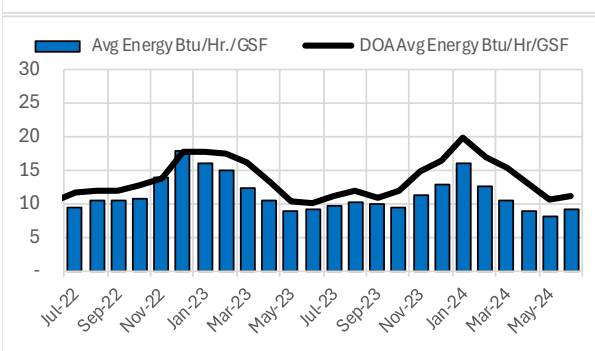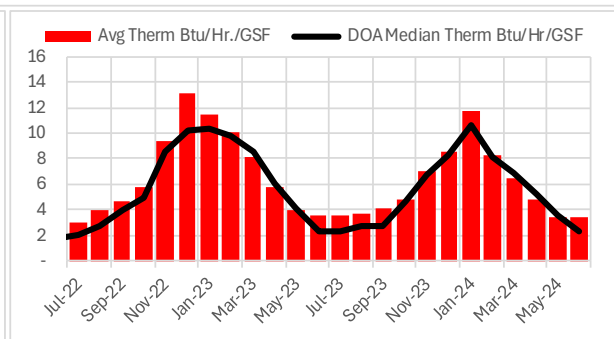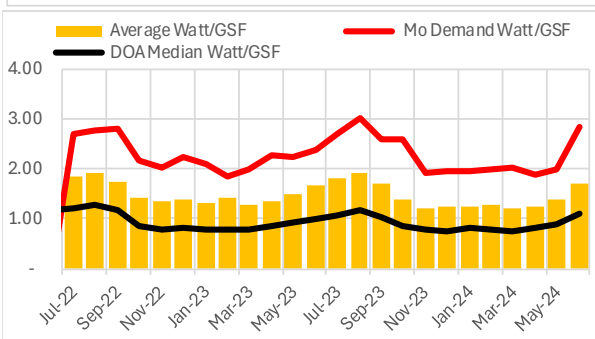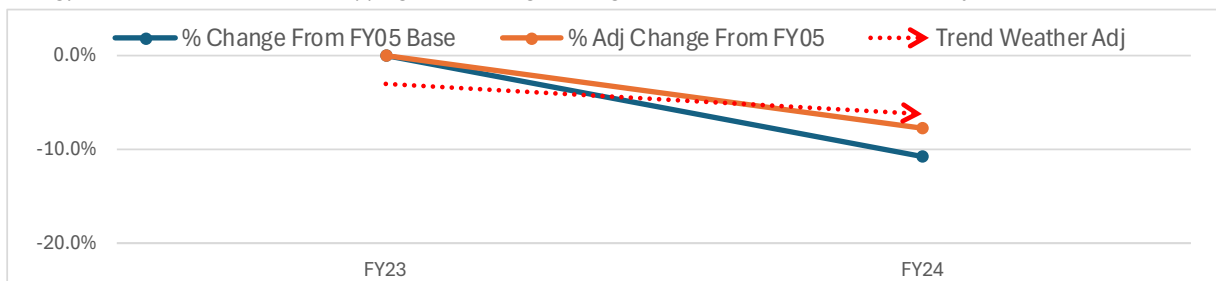

Agency Energy Use Summary

Department of Corrections



SCOPE

Facilities Included: Columbia Correctional Institution; Prairie du Chien Correctional; Ethan Allen School to FY14; Racine Correctional Institution; Fox Lake Correctional Institution; Racine Youthful Offender Facility; Green Bay Correctional Institution; Redgranite Correctional Institution; Jackson Correctional Institution; Stanley Correctional Institution; Kettle Moraine Correctional Institution; Sturtevant Transitional Facility; Lincoln Hills School; Taycheedah Correctional Institution; Milwaukee Secure Detention Facility; Waupun Complex, includes - Dodge Correctional Institution and Waupun Correctional Institution; New Lisbon Correctional Institution; Oak Hill Correctional Institution; Oshkosh Correctional Institution; and Wisconsin Secure Program Facility.

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 12.8 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 2.1 percent decrease

Energy use (BTU/GSF/Yr) for FY24 decrease 2.1 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 0.7 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 0.7 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: -3.5 percent decrease.



Gross square footage (GSF) has decreased 3.5% from the base fiscal year, FY05.

Consumption Change from Base: 21 percent decrease.

Total consumption was 21 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 14.2 percent less than in the base year when adjusted for weather compared to FY05.


Corrections, Department of

Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024	
Electricity	\$	9,634,257	\$	8,017,001	\$	8,571,053	\$	10,163,609	\$	10,263,581
Coal	\$	433	\$	-	\$	-	\$	(29)	\$	-
Natural Gas	\$	3,560,429	\$	4,586,331	\$	5,550,505	\$	7,037,205	\$	4,466,300
Fuel Oil	\$	79,603	\$	74,627	\$	144,664	\$	207,456	\$	74,950
Other Fuels	\$	261,281	\$	92,912	\$	145,629	\$	220,256	\$	404,385
Steam/Heat	\$	827,488	\$	890,708	\$	1,184,940	\$	1,275,495	\$	1,221,539
Chilled Water	\$	2,329	\$	-	\$	-	\$	-	\$	-
Water & Sewage	\$	10,439,751	\$	8,608,853	\$	8,952,322	\$	9,620,630	\$	10,852,777
Total Utilities	\$	24,805,570	\$	22,270,431	\$	24,549,112	\$	28,524,622	\$	27,283,533

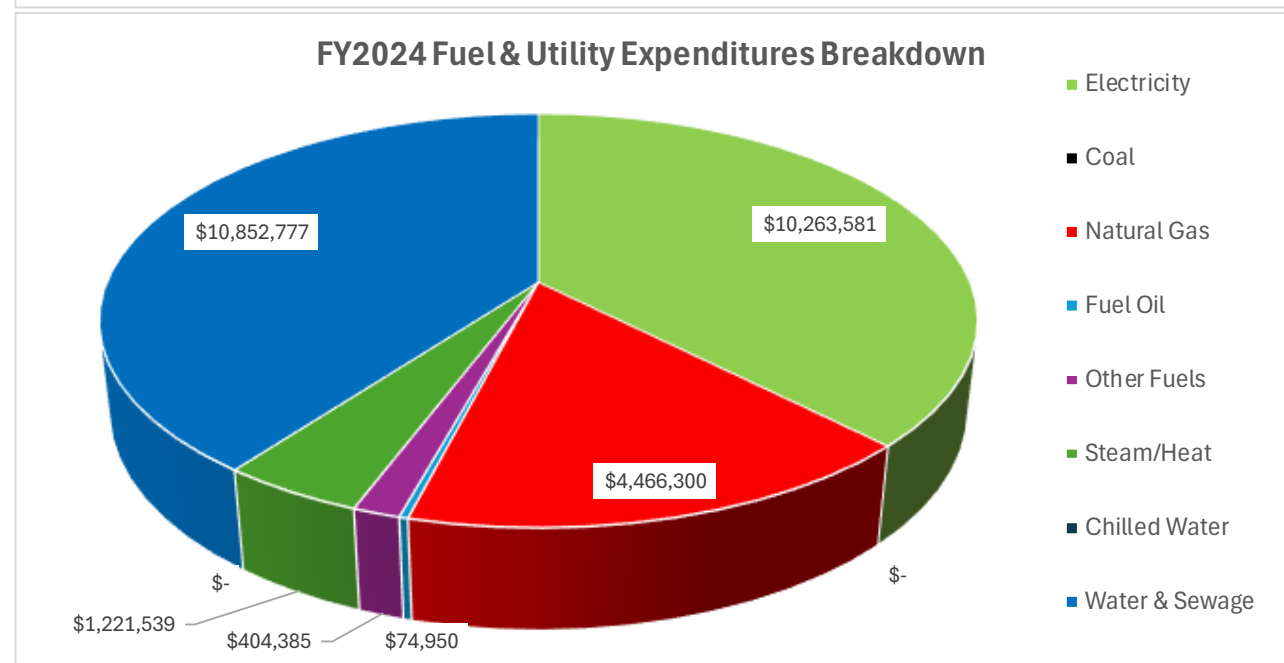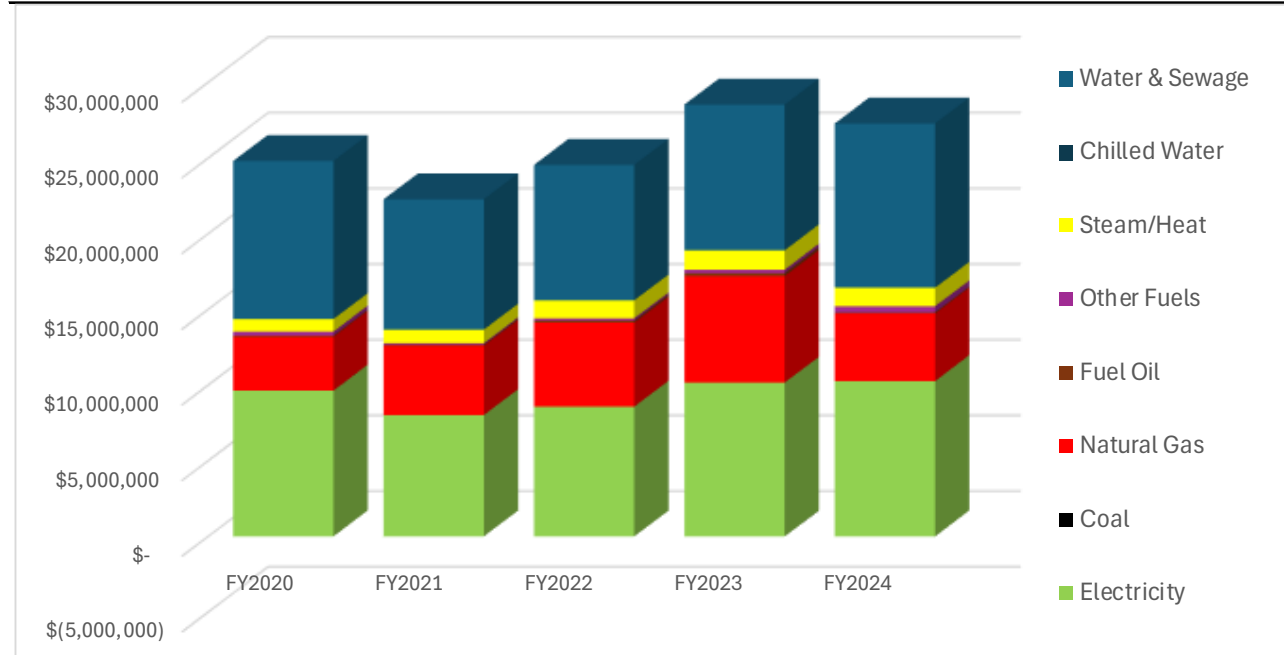

DOC Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	8,230,122	132,660	45,472	178,132	0.0%	47.21	100.0%	100.0%	178,132	0.0%
FY06	8,241,872	129,685	45,262	174,947	-1.8%	48.33	102.3%	99.7%	177,756	-0.2%
FY07	8,241,872	130,889	45,022	175,911	-1.2%	47.27	100.0%	99.8%	175,807	-1.3%
FY08	8,241,872	134,139	45,434	179,574	0.8%	45.69	95.4%	99.1%	172,946	-2.9%
FY09	8,241,872	135,521	44,649	180,170	1.1%	44.88	94.4%	99.2%	172,231	-3.3%
FY10	8,241,872	127,844	43,452	171,295	-3.8%	46.82	99.1%	100.0%	170,107	-4.5%
FY11	8,269,898	131,818	43,819	175,636	-1.4%	45.93	95.5%	98.8%	169,200	-5.0%
FY12	8,269,898	115,139	42,783	157,922	-11.3%	50.80	107.5%	100.0%	166,565	-6.5%
FY13	8,269,898	126,642	42,292	168,934	-5.2%	46.38	96.3%	99.4%	164,035	-7.9%
FY14	7,939,611	140,253	43,384	183,637	3.1%	43.43	91.3%	98.8%	170,966	-4.0%
FY15	7,939,611	131,434	42,395	173,829	-2.4%	45.00	94.9%	99.8%	167,000	-6.2%
FY16	7,939,611	119,703	42,100	161,803	-9.2%	49.10	105.1%	100.0%	167,855	-5.8%
FY17	7,939,611	119,888	41,468	161,357	-9.4%	49.41	105.5%	99.3%	167,721	-5.8%
FY18	7,939,611	127,041	41,429	168,470	-5.4%	46.23	96.8%	99.3%	164,121	-7.9%
FY19	7,939,611	129,370	40,848	170,218	-4.4%	45.41	95.2%	99.5%	163,809	-8.0%
FY20	7,939,611	124,301	40,700	165,002	-7.4%	47.47	100.2%	99.8%	165,181	-7.3%
FY21	7,939,611	119,593	39,519	159,111	-10.7%	47.81	101.0%	99.0%	159,955	-10.2%
FY22	7,939,611	120,613	39,127	159,740	-10.3%	47.70	99.9%	98.7%	159,096	-10.7%
FY23	7,939,611	118,201	37,895	156,095	-12.4%	48.33	102.3%	99.9%	158,823	-10.8%
FY24	7,939,611	108,686	37,034	145,719	-18.2%	50.71	108.9%	100.1%	155,408	-12.8%

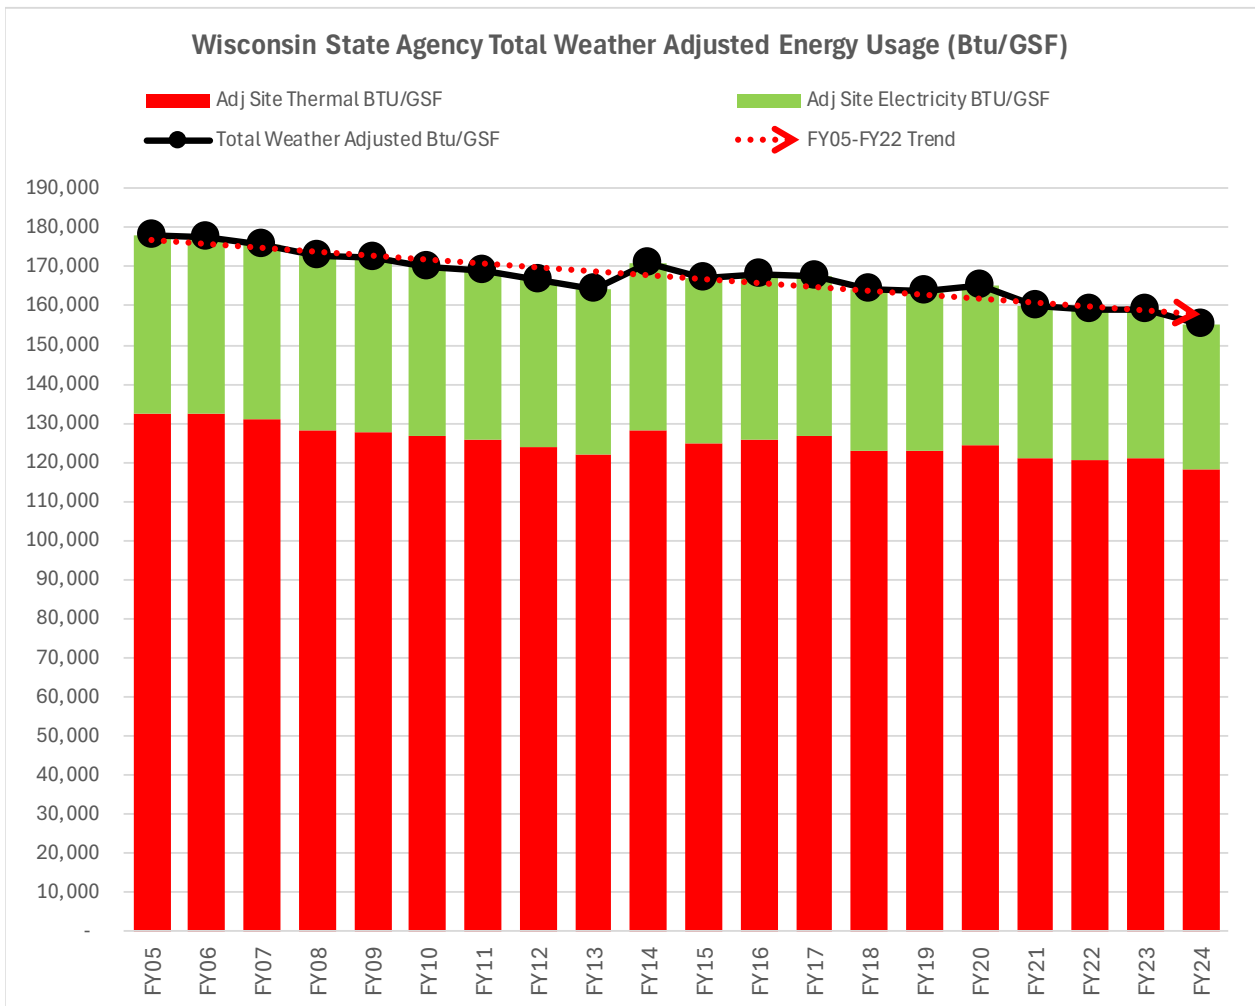

DOC Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 10.85			FY24 Therm/GSF = 1.09			FY24 Total Btu/GSF = 145,719			05-24 Thm -10.8%	
FY24 Electric \$/GSF = \$ 1.06			FY24 Thermal \$/GSF = \$ 0.46			FY24 Energy \$/GSF = \$ 1.52			05-24 kwh -18.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	8,230,122	132,660	45,472	178,132	0.0%	47.21	100.0%	100.0%	178,132	0.0%
FY06	8,241,872	129,685	45,262	174,947	-1.8%	48.33	102.3%	99.7%	177,756	-0.2%
FY07	8,241,872	130,889	45,022	175,911	-1.2%	47.27	100.0%	99.8%	175,807	-1.3%
FY08	8,241,872	134,139	45,434	179,574	0.8%	45.69	95.4%	99.1%	172,946	-2.9%
FY09	8,241,872	135,521	44,649	180,170	1.1%	44.88	94.4%	99.2%	172,231	-3.3%
FY10	8,241,872	127,844	43,452	171,295	-3.8%	46.82	99.1%	100.0%	170,107	-4.5%
FY11	8,269,898	131,818	43,819	175,636	-1.4%	45.93	95.5%	98.8%	169,200	-5.0%
FY12	8,269,898	115,139	42,783	157,922	-11.3%	50.80	107.5%	100.0%	166,565	-6.5%
FY13	8,269,898	126,642	42,292	168,934	-5.2%	46.38	96.3%	99.4%	164,035	-7.9%
FY14	7,939,611	140,253	43,384	183,637	3.1%	43.43	91.3%	98.8%	170,966	-4.0%
FY15	7,939,611	131,434	42,395	173,829	-2.4%	45.00	94.9%	99.8%	167,000	-6.2%
FY16	7,939,611	119,703	42,100	161,803	-9.2%	49.10	105.1%	100.0%	167,855	-5.8%
FY17	7,939,611	119,888	41,468	161,357	-9.4%	49.41	105.5%	99.3%	167,721	-5.8%
FY18	7,939,611	127,041	41,429	168,470	-5.4%	46.23	96.8%	99.3%	164,121	-7.9%
FY19	7,939,611	129,370	40,848	170,218	-4.4%	45.41	95.2%	99.5%	163,809	-8.0%
FY20	7,939,611	124,301	40,700	165,002	-7.4%	47.47	100.2%	99.8%	165,181	-7.3%
FY21	7,939,611	119,593	39,519	159,111	-10.7%	47.81	101.0%	99.0%	159,955	-10.2%
FY22	7,939,611	120,613	39,127	159,740	-10.3%	47.70	99.9%	98.7%	159,096	-10.7%
FY23	7,939,611	118,201	37,895	156,095	-12.4%	48.33	102.3%	99.9%	158,823	-10.8%
FY24	7,939,611	108,686	37,034	145,719	-18.2%	50.71	108.9%	100.1%	155,408	-12.8%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

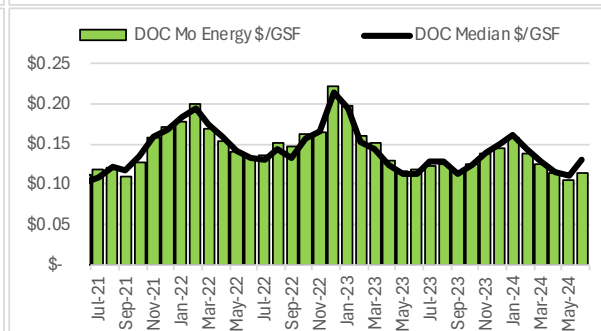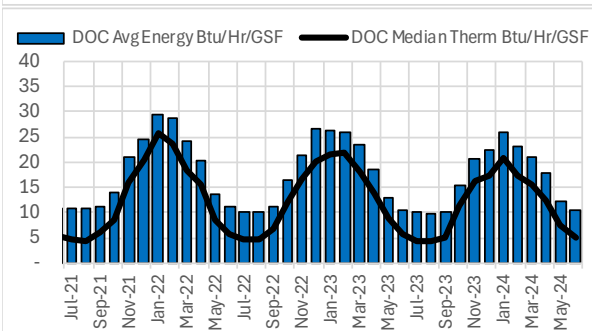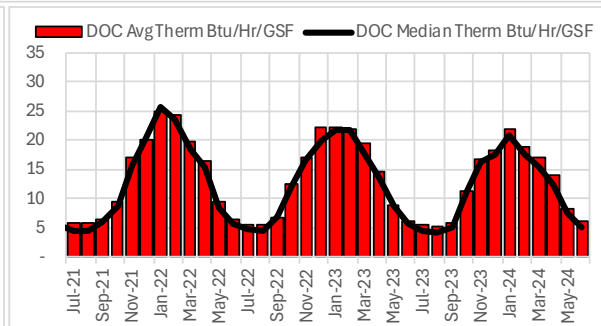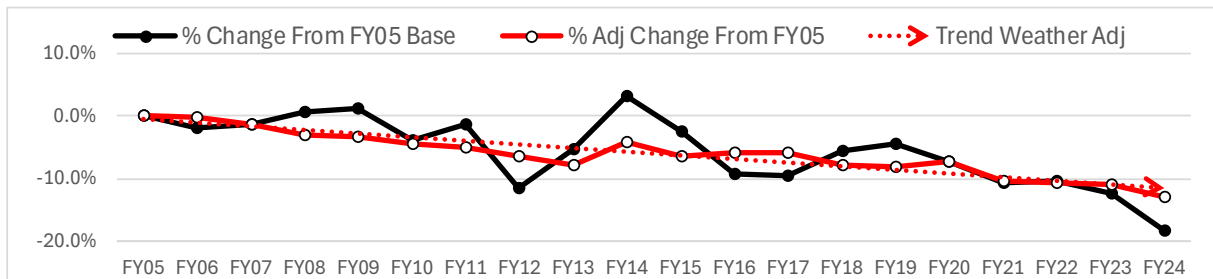

FY2024 DOC-Boscobel State Facilities Energy Report

FY24 Electric kwh/GSF= 17.27			FY24 Therm/GSF = 0.99			FY24 Total Btu/GSF= 158,030			05-24 Thm -7.8%	
FY24 Electric \$/GSF= \$ 1.39			FY24 Thermal \$/GSF= \$ 0.54			FY24 Energy \$/GSF= \$ 1.93			05-24 kwh -10.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	195,000	117,908	65,580	183,488	0.0%	48.12	100.0%	100.0%	183,488	0.0%
FY06	195,000	110,590	69,209	179,800	-2.0%	48.65	98.2%	99.5%	177,493	-3.3%
FY07	195,000	130,509	71,510	202,019	10.1%	47.46	98.0%	99.8%	199,311	8.6%
FY08	195,000	140,829	71,092	211,921	15.5%	46.19	89.8%	98.8%	196,641	7.2%
FY09	195,000	141,322	68,940	210,262	14.6%	45.66	90.7%	99.5%	196,686	7.2%
FY10	195,000	125,478	67,731	193,210	5.3%	47.10	96.2%	100.1%	188,548	2.8%
FY11	195,000	142,574	68,570	211,144	15.1%	46.81	93.0%	98.7%	200,280	9.2%
FY12	195,000	110,054	67,349	177,403	-3.3%	51.51	108.6%	99.0%	186,246	1.5%
FY13	195,000	131,264	66,796	198,059	7.9%	47.29	95.3%	99.1%	191,199	4.2%
FY14	195,000	154,267	66,998	221,265	20.6%	44.58	83.1%	99.1%	194,529	6.0%
FY15	195,000	132,228	65,530	197,758	7.8%	45.84	92.0%	99.7%	186,978	1.9%
FY16	195,000	121,598	65,086	186,684	1.7%	49.68	105.9%	99.8%	193,761	5.6%
FY17	195,000	125,584	66,075	191,659	4.5%	49.72	104.9%	99.0%	197,228	7.5%
FY18	195,000	123,377	65,059	188,437	2.7%	46.66	93.1%	99.3%	179,561	-2.1%
FY19	195,000	112,270	64,538	176,809	-3.6%	45.87	92.0%	99.7%	167,675	-8.6%
FY20	195,000	108,738	65,022	173,760	-5.3%	48.08	99.7%	99.6%	173,167	-5.6%
FY21	195,000	111,055	64,734	175,790	-4.2%	47.61	97.5%	98.8%	172,290	-6.1%
FY22	195,000	116,454	62,211	178,665	-2.6%	48.04	97.1%	98.5%	174,373	-5.0%
FY23	195,000	111,072	59,384	170,456	-7.1%	48.63	102.1%	99.9%	172,731	-5.9%
FY24	195,000	99,094	58,936	158,030	-13.9%	50.95	109.7%	99.6%	167,346	-8.8%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

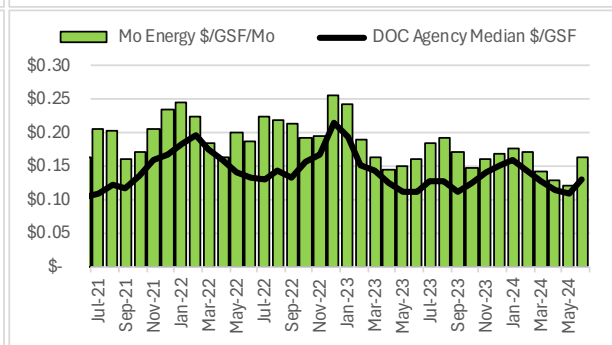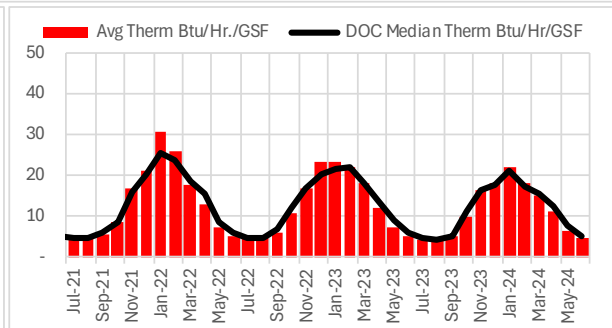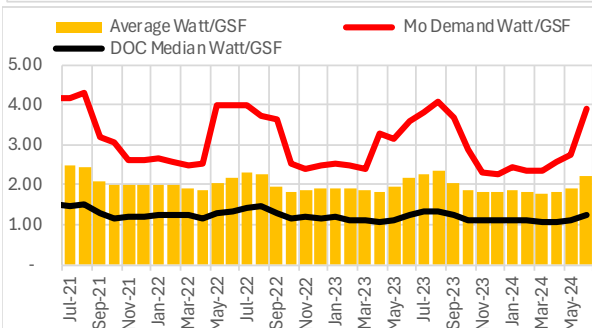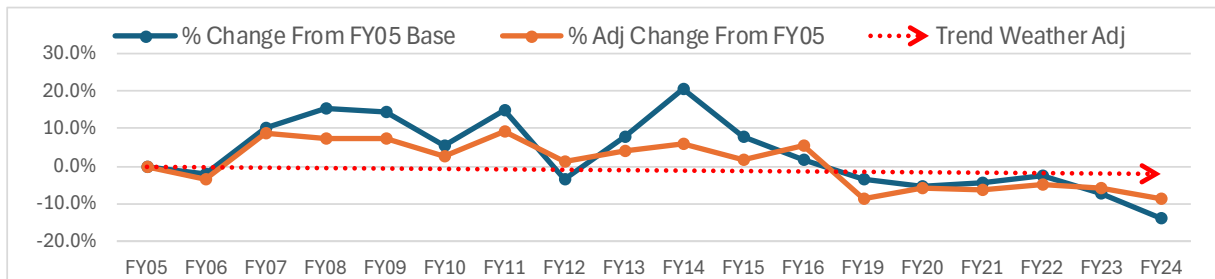

FY2024 DOC-Columbia State Facilities Energy Report

FY24 Electric kwh/GSF= 13.45			FY24 Therm/GSF = 0.80			FY24 Total Btu/GSF= 125,834			05-24 Thm -14.1%	
FY24 Electric \$/GSF= \$ 1.20			FY24 Thermal \$/GSF= \$ 0.35			FY24 Energy \$/GSF= \$ 1.54			05-24 kwh -25.5%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	330,807	101,211	61,594	162,805	0.0%	48.12	100.0%	100.0%	162,805	0.0%
FY06	330,807	102,969	62,609	165,578	1.7%	48.65	101.0%	99.4%	166,226	2.1%
FY07	330,807	99,321	61,866	161,187	-1.0%	47.46	99.9%	99.7%	160,899	-1.2%
FY08	330,807	96,556	61,086	157,642	-3.2%	46.19	94.4%	99.4%	151,864	-6.7%
FY09	330,807	97,894	54,784	152,678	-6.2%	45.66	94.5%	99.2%	146,848	-9.8%
FY10	330,807	90,489	51,677	142,166	-12.7%	47.10	98.6%	100.0%	140,878	-13.5%
FY11	330,807	93,736	52,754	146,490	-10.0%	46.81	95.1%	98.6%	141,146	-13.3%
FY12	330,807	76,039	52,036	128,074	-21.3%	51.51	109.9%	99.7%	135,440	-16.8%
FY13	330,807	87,419	51,107	138,526	-14.9%	47.29	95.4%	98.8%	133,830	-17.8%
FY14	330,807	79,482	52,584	132,066	-18.9%	44.58	88.6%	98.2%	122,005	-25.1%
FY15	330,807	75,521	51,797	127,318	-21.8%	45.84	92.1%	100.1%	121,407	-25.4%
FY16	330,807	68,488	50,360	118,847	-27.0%	49.68	105.6%	100.0%	122,660	-24.7%
FY17	330,807	71,170	50,475	121,645	-25.3%	49.72	104.6%	99.4%	124,604	-23.5%
FY18	330,807	87,961	52,799	140,759	-13.5%	46.66	93.1%	98.9%	134,112	-17.6%
FY19	330,807	87,400	55,082	142,482	-12.5%	45.87	93.7%	99.6%	136,747	-16.0%
FY20	330,807	83,157	52,189	135,346	-16.9%	48.08	99.7%	99.6%	134,879	-17.2%
FY21	330,807	83,788	53,417	137,206	-15.7%	47.61	98.4%	98.8%	135,198	-17.0%
FY22	330,807	92,162	51,977	144,138	-11.5%	48.04	98.9%	98.6%	142,408	-12.5%
FY23	330,807	85,141	47,078	132,219	-18.8%	48.63	101.4%	100.0%	133,369	-18.1%
FY24	330,807	79,940	45,895	125,834	-22.7%	50.95	108.8%	100.0%	132,904	-18.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

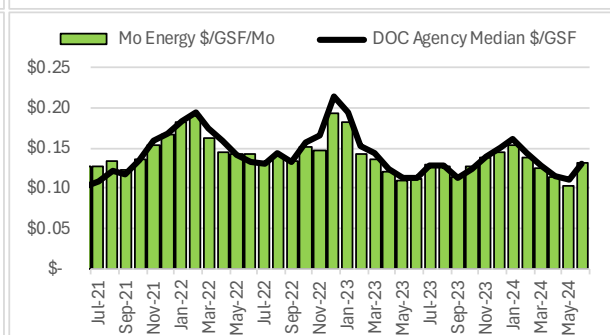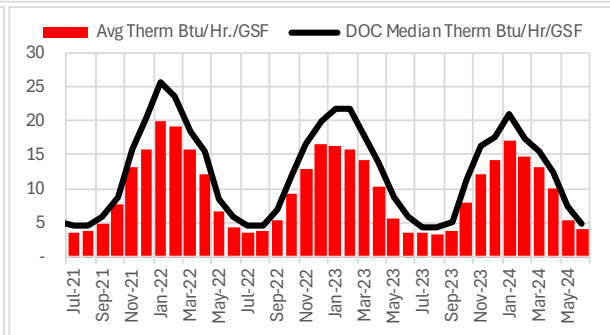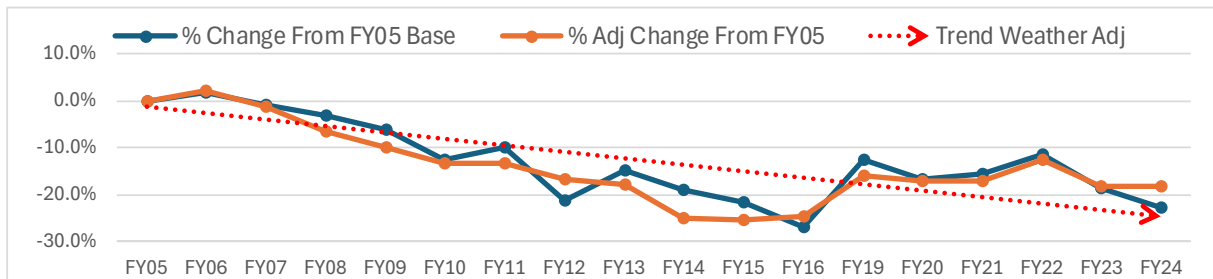

FY2024 DOC-Fox Lake State Facilities Energy Report

FY24 Electric kwh/GSF= 9.67			FY24 Therm/GSF = 1.40			FY24 Total Btu/GSF= 173,129			05-24 Thm -0.3%	
FY24 Electric \$/GSF= \$ 0.94			FY24 Thermal \$/GSF= \$ 0.53			FY24 Energy \$/GSF= \$ 1.46			05-24 kwh -15.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	533,407	149,959	39,424	189,382	0.0%	48.12	100.0%	100.0%	189,382	0.0%
FY06	533,407	150,044	38,497	188,540	-0.4%	48.65	100.7%	99.9%	189,545	0.1%
FY07	533,407	156,180	40,495	196,675	3.9%	47.46	100.1%	99.4%	196,520	3.8%
FY08	533,407	158,407	41,802	200,209	5.7%	46.19	95.0%	98.8%	191,796	1.3%
FY09	533,407	160,560	40,495	201,055	6.2%	45.66	96.4%	99.0%	194,815	2.9%
FY10	533,407	154,130	38,859	192,990	1.9%	47.10	99.0%	100.0%	191,450	1.1%
FY11	533,407	146,696	40,023	186,719	-1.4%	46.81	96.1%	98.7%	180,449	-4.7%
FY12	533,407	137,316	38,721	176,037	-7.0%	51.51	108.5%	100.3%	187,851	-0.8%
FY13	533,407	149,603	39,251	188,854	-0.3%	47.29	96.9%	99.0%	183,756	-3.0%
FY14	533,407	160,281	39,451	199,732	5.5%	44.58	91.9%	98.7%	186,246	-1.7%
FY15	533,407	151,557	37,712	189,268	-0.1%	45.84	94.3%	99.5%	180,367	-4.8%
FY16	533,407	149,721	36,919	186,639	-1.4%	49.68	103.8%	100.0%	192,294	1.5%
FY17	533,407	153,042	37,195	190,237	0.5%	49.72	103.8%	99.6%	195,824	3.4%
FY18	533,407	163,412	37,357	200,769	6.0%	46.66	95.7%	99.5%	193,517	2.2%
FY19	533,407	159,521	37,193	196,714	3.9%	45.87	95.4%	99.5%	189,271	-0.1%
FY20	533,407	163,477	37,058	200,535	5.9%	48.08	99.2%	99.9%	199,190	5.2%
FY21	533,407	160,749	36,141	196,890	4.0%	47.61	99.0%	99.2%	194,925	2.9%
FY22	533,407	153,075	34,565	187,639	-0.9%	48.04	99.3%	99.1%	186,308	-1.6%
FY23	533,407	147,724	32,878	180,602	-4.6%	48.63	100.9%	100.0%	181,962	-3.9%
FY24	533,407	140,121	33,008	173,129	-8.6%	50.95	106.7%	100.4%	182,612	-3.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

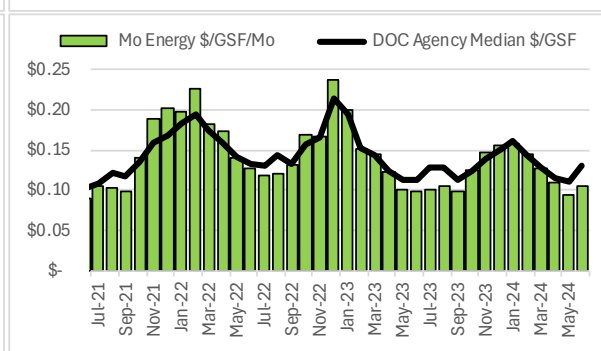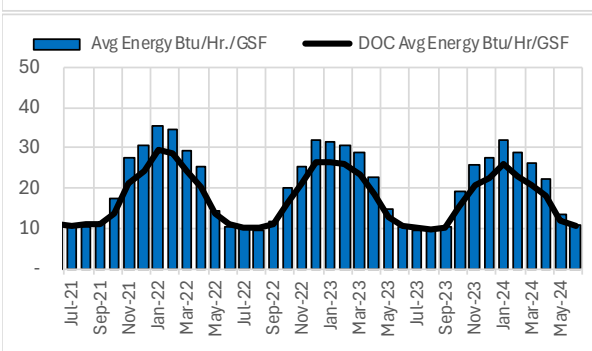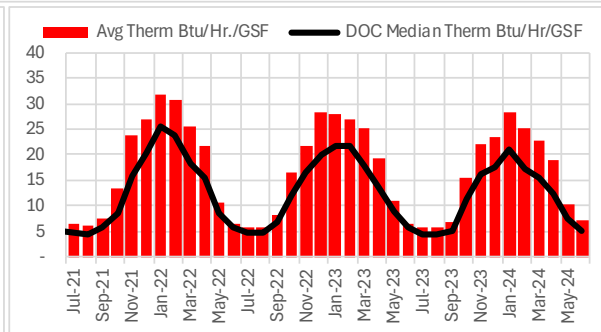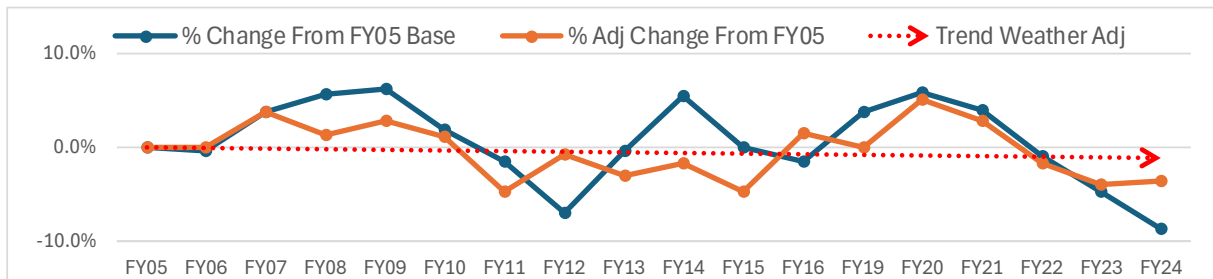

FY2024 DOC-Green Bay State Facilities Energy Report

FY24 Electric kwh/GSF= 8.91			FY24 Therm/GSF = 1.23			FY24 Total Btu/GSF= 153,804			05-24 Thm -5.4%	
FY24 Electric \$/GSF= \$ 0.79			FY24 Thermal \$/GSF= \$ 0.46			FY24 Energy \$/GSF= \$ 1.24			05-24 kwh -4.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	453,750	146,759	32,097	178,856	0.0%	45.94	100.0%	100.0%	178,856	0.0%
FY06	453,750	147,306	33,408	180,714	1.0%	47.26	104.2%	100.0%	186,887	4.5%
FY07	453,750	139,103	32,619	171,722	-4.0%	46.64	101.9%	100.1%	174,338	-2.5%
FY08	453,750	139,251	33,211	172,462	-3.6%	45.02	96.8%	99.3%	167,772	-6.2%
FY09	453,750	135,705	31,831	167,536	-6.3%	43.47	92.5%	99.4%	157,166	-12.1%
FY10	453,750	123,702	30,828	154,531	-13.6%	45.98	100.4%	100.2%	155,044	-13.3%
FY11	453,750	136,752	31,257	168,009	-6.1%	44.58	95.4%	99.7%	161,671	-9.6%
FY12	453,750	112,157	30,945	143,102	-20.0%	49.86	109.2%	100.1%	153,477	-14.2%
FY13	453,750	128,064	31,432	159,496	-10.8%	45.29	97.4%	99.8%	156,106	-12.7%
FY14	453,750	157,043	32,353	189,396	5.9%	41.95	91.4%	99.1%	175,565	-1.8%
FY15	453,750	158,051	32,665	190,716	6.6%	43.98	95.3%	99.7%	183,170	2.4%
FY16	453,750	135,637	32,825	168,462	-5.8%	48.11	105.7%	100.2%	176,291	-1.4%
FY17	453,750	137,774	32,745	170,519	-4.7%	48.65	107.7%	100.4%	181,321	1.4%
FY18	453,750	142,274	32,223	174,497	-2.4%	45.41	98.1%	99.6%	171,701	-4.0%
FY19	453,750	148,400	32,065	180,466	0.9%	44.90	96.6%	99.7%	175,301	-2.0%
FY20	453,750	138,531	32,103	170,634	-4.6%	46.40	100.9%	100.0%	171,869	-3.9%
FY21	453,750	143,077	31,991	175,068	-2.1%	47.28	103.3%	99.6%	179,725	0.5%
FY22	453,750	145,955	30,782	176,737	-1.2%	46.76	101.8%	99.1%	179,136	0.2%
FY23	453,750	144,920	30,778	175,697	-1.8%	47.58	102.2%	100.2%	178,887	0.0%
FY24	453,750	123,382	30,421	153,804	-14.0%	49.93	112.6%	101.3%	169,719	-5.1%


Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

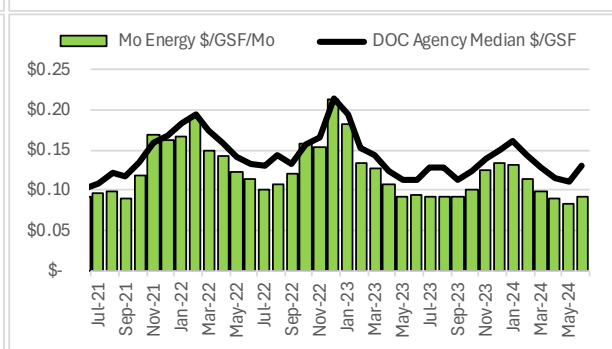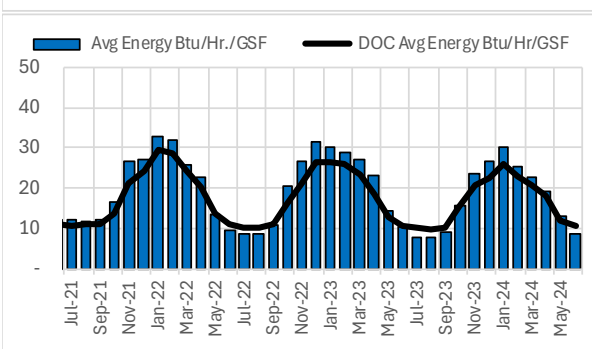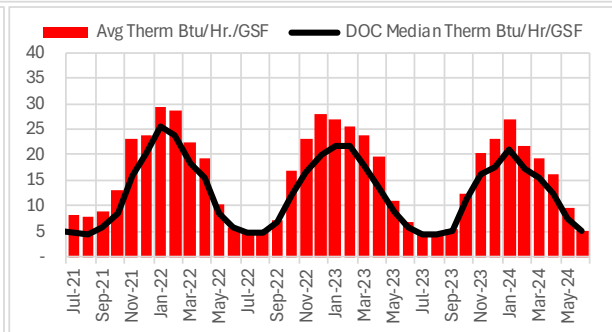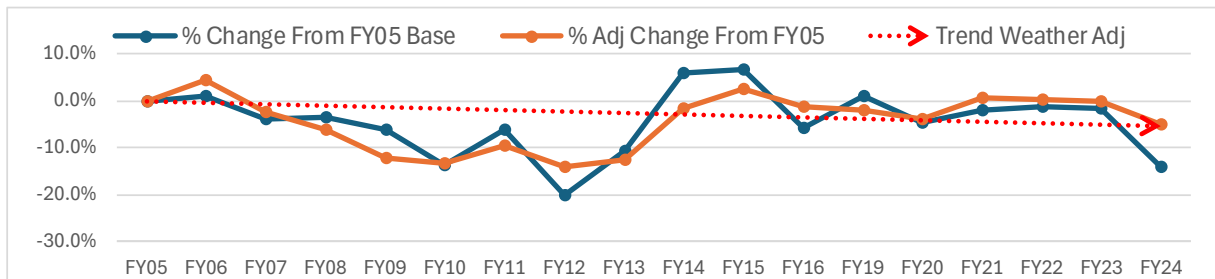

FY2024 DOC-Jackson State Facilities Energy Report *FY24Mo Elec = FY23Mo Elec

FY24 Electric kwh/GSF= 13.10			FY24 Therm/GSF = 1.12			FY24 Total Btu/GSF= 156,576		05-24 Thm 1.3%		
FY24 Electric \$/GSF= \$ 1.18			FY24 Thermal \$/GSF= \$ 0.57			FY24 Energy \$/GSF= \$ 1.75		05-24 kwh -25.0%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	390,613	120,043	59,864	179,907	0.0%	45.85	100.0%	100.0%	179,907	0.0%
FY06	390,613	116,901	51,678	168,579	-6.3%	47.80	104.5%	99.8%	173,657	-3.5%
FY07	390,613	106,704	51,339	158,043	-12.2%	46.32	100.0%	99.8%	157,912	-12.2%
FY08	390,613	116,608	49,995	166,603	-7.4%	43.27	93.6%	99.4%	158,851	-11.7%
FY09	390,613	117,792	50,166	167,959	-6.6%	42.97	93.4%	99.5%	159,958	-11.1%
FY10	390,613	109,180	48,546	157,726	-12.3%	45.29	99.1%	100.0%	156,706	-12.9%
FY11	390,613	115,370	48,826	164,196	-8.7%	43.68	94.4%	99.4%	157,490	-12.5%
FY12	390,613	102,124	48,606	150,730	-16.2%	49.02	106.5%	100.2%	157,465	-12.5%
FY13	390,613	113,949	48,803	162,751	-9.5%	43.85	94.6%	99.5%	156,406	-13.1%
FY14	390,613	130,328	49,841	180,169	0.1%	41.37	90.1%	98.7%	166,595	-7.4%
FY15	390,613	123,806	47,392	171,197	-4.8%	43.42	94.3%	99.8%	163,997	-8.8%
FY16	390,613	103,291	46,058	149,349	-17.0%	47.61	104.7%	100.1%	154,290	-14.2%
FY17	390,613	104,794	45,730	150,525	-16.3%	47.07	102.7%	100.0%	153,288	-14.8%
FY18	390,613	111,107	45,752	156,859	-12.8%	43.54	94.9%	99.5%	150,953	-16.1%
FY19	390,613	113,706	45,650	159,356	-11.4%	42.23	93.3%	100.0%	151,689	-15.7%
FY20	390,613	107,941	46,414	154,355	-14.2%	45.42	99.2%	99.9%	153,479	-14.7%
FY21	390,613	110,686	44,919	155,605	-13.5%	46.01	100.8%	99.6%	156,347	-13.1%
FY22	390,613	107,128	44,713	151,841	-15.6%	44.82	96.8%	99.5%	148,152	-17.7%
FY23	390,613	109,710	44,713	154,422	-14.2%	45.82	99.9%	99.7%	154,237	-14.3%
FY24	390,613	111,863	44,713	156,576	-13.0%	49.00	108.8%	100.4%	166,554	-7.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

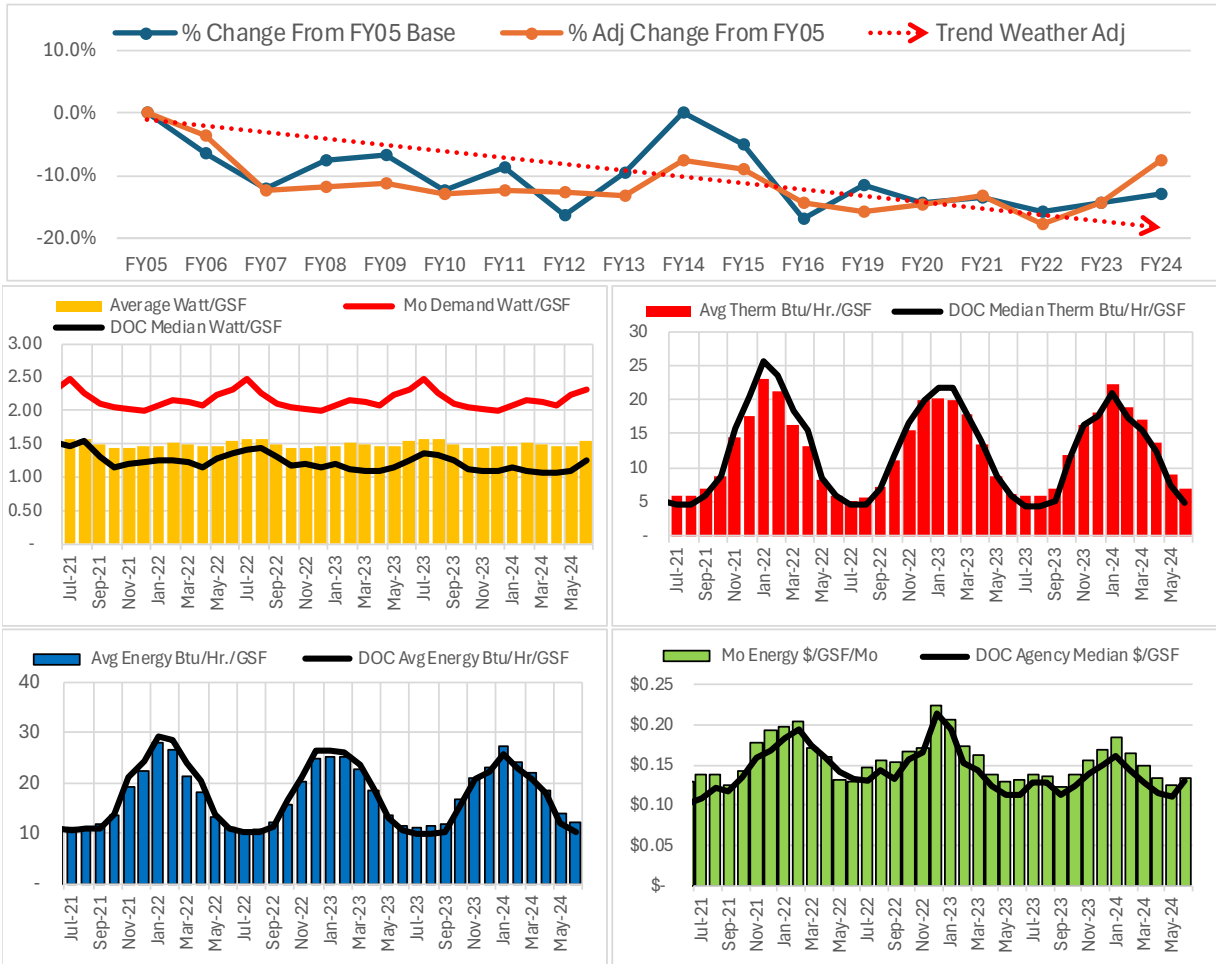

FY2024 DOC-Kettle Moraine State Facilities Energy Report

FY24 Electric kwh/GSF= 12.24			FY24 Therm/GSF = 1.33			FY24 Total Btu/GSF= 174,939			05-24 Thm 3.0%	
FY24 Electric \$/GSF= \$ 0.92			FY24 Thermal \$/GSF= \$ 0.48			FY24 Energy \$/GSF= \$ 1.40			05-24 kwh -14.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	361,612	144,408	50,502	194,910	0.0%	45.94	100.0%	100.0%	194,910	0.0%
FY06	361,612	138,897	50,138	189,035	-3.0%	47.26	103.9%	100.6%	194,758	-0.1%
FY07	361,612	132,421	50,482	182,903	-6.2%	46.64	102.9%	100.5%	186,927	-4.1%
FY08	361,612	138,258	50,885	189,143	-3.0%	45.02	97.0%	99.3%	184,660	-5.3%
FY09	361,612	140,573	50,817	191,390	-1.8%	43.47	93.5%	98.0%	181,265	-7.0%
FY10	361,612	136,537	50,441	186,978	-4.1%	45.98	100.3%	100.6%	187,764	-3.7%
FY11	361,612	144,475	52,175	196,650	0.9%	44.58	94.7%	98.4%	188,214	-3.4%
FY12	361,612	129,572	49,476	179,049	-8.1%	49.86	108.7%	101.2%	190,930	-2.0%
FY13	361,612	149,178	46,663	195,841	0.5%	45.29	97.2%	99.6%	191,498	-1.8%
FY14	361,612	160,181	44,828	205,009	5.2%	41.95	91.5%	98.4%	190,583	-2.2%
FY15	361,612	159,012	45,503	204,515	4.9%	43.98	95.7%	99.5%	197,439	1.3%
FY16	361,612	151,142	44,629	195,771	0.4%	48.11	106.0%	100.6%	205,094	5.2%
FY17	361,612	145,237	43,347	188,584	-3.2%	48.65	108.3%	101.3%	201,126	3.2%
FY18	361,612	156,141	44,642	200,783	3.0%	45.41	97.6%	99.6%	196,812	1.0%
FY19	361,612	163,471	45,603	209,073	7.3%	44.90	96.5%	99.5%	203,155	4.2%
FY20	361,612	149,384	45,209	194,593	-0.2%	46.40	100.5%	100.2%	195,479	0.3%
FY21	361,612	147,566	45,702	193,269	-0.8%	47.28	102.3%	100.1%	196,679	0.9%
FY22	361,612	151,536	44,783	196,319	0.7%	46.76	101.1%	99.8%	197,952	1.6%
FY23	361,612	150,418	43,442	193,860	-0.5%	47.58	103.1%	100.5%	198,732	2.0%
FY24	361,612	133,160	41,779	174,939	-10.2%	49.93	111.7%	102.9%	191,685	-1.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

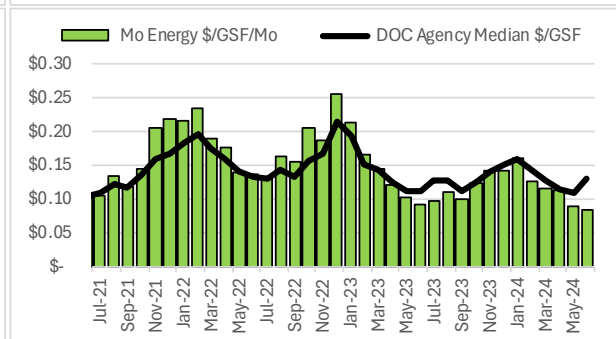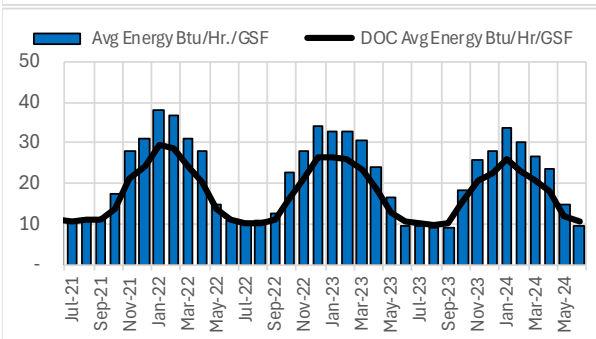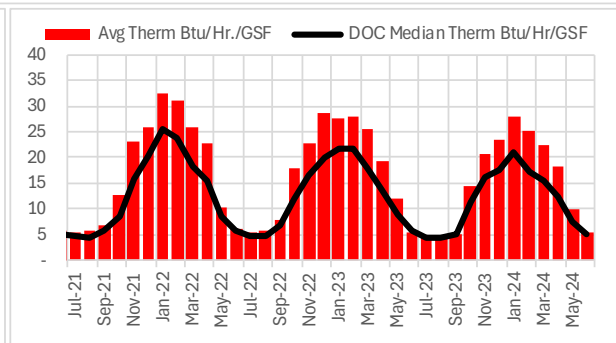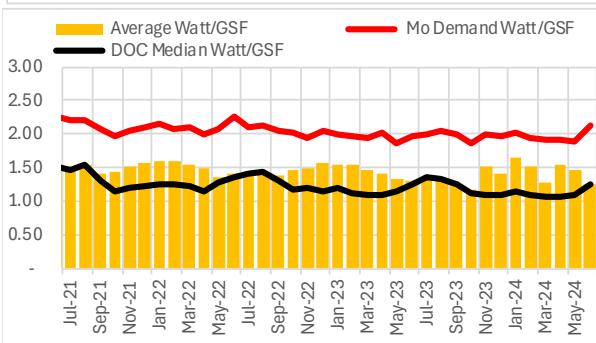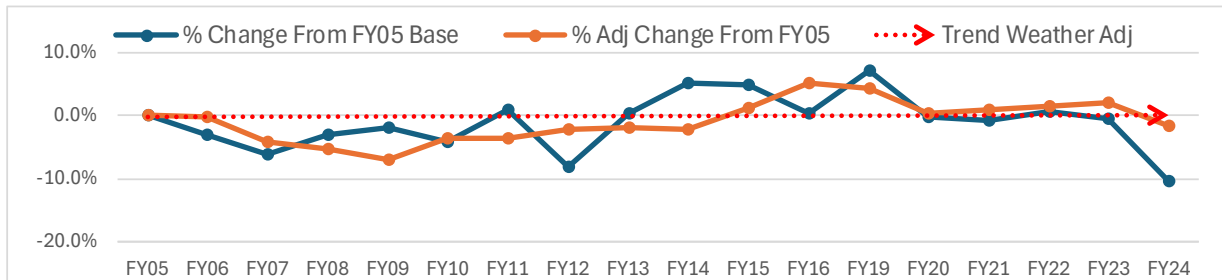

FY2024 DOC-Lincoln Hills State Facilities Energy Report

FY24 Electric kwh/GSF= 9.18			FY24 Therm/GSF = 1.17			FY24 Total Btu/GSF= 147,992		05-24 Thm 4.7%		
FY24 Electric \$/GSF= \$ 0.79			FY24 Thermal \$/GSF= \$ 0.44			FY24 Energy \$/GSF= \$ 1.23		05-24 kwh 2.9%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	249,792	124,056	30,725	154,781	0.0%	44.50	100.0%	100.0%	154,781	0.0%
FY06	249,792	118,831	28,501	147,332	-4.8%	46.21	104.8%	100.3%	153,147	-1.1%
FY07	249,792	123,766	27,976	151,742	-2.0%	44.70	100.9%	100.0%	152,812	-1.3%
FY08	249,792	128,636	31,397	160,033	3.4%	42.68	94.1%	99.0%	152,144	-1.7%
FY09	249,792	133,673	32,717	166,390	7.5%	42.20	93.7%	99.7%	157,897	2.0%
FY10	249,792	117,257	30,441	147,698	-4.6%	45.07	101.8%	100.1%	149,874	-3.2%
FY11	249,792	124,713	30,228	154,941	0.1%	43.03	94.8%	99.3%	148,262	-4.2%
FY12	249,792	118,982	34,727	153,709	-0.7%	48.08	109.5%	100.7%	165,284	6.8%
FY13	249,792	137,976	38,281	176,257	13.9%	43.78	96.2%	100.0%	171,027	10.5%
FY14	249,792	146,481	38,382	184,863	19.4%	40.42	89.7%	100.1%	169,843	9.7%
FY15	249,792	147,239	38,767	186,006	20.2%	42.00	92.3%	99.4%	174,495	12.7%
FY16	249,792	120,206	38,553	158,759	2.6%	47.49	109.0%	100.8%	169,926	9.8%
FY17	249,792	115,807	37,301	153,108	-1.1%	45.96	104.3%	100.3%	158,145	2.2%
FY18	249,792	123,095	37,372	160,467	3.7%	43.03	94.4%	99.5%	153,464	-0.9%
FY19	249,792	128,124	36,657	164,782	6.5%	41.93	92.3%	99.5%	154,687	-0.1%
FY20	249,792	129,179	36,399	165,579	7.0%	43.74	97.8%	100.2%	162,796	5.2%
FY21	249,792	126,928	36,289	163,217	5.5%	45.40	101.9%	99.6%	165,549	7.0%
FY22	249,792	129,490	35,587	165,077	6.7%	45.76	101.1%	99.0%	166,143	7.3%
FY23	249,792	126,165	33,546	159,711	3.2%	46.29	104.7%	99.6%	165,489	6.9%
FY24	249,792	116,662	31,330	147,992	-4.4%	48.13	111.3%	100.9%	161,441	4.3%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

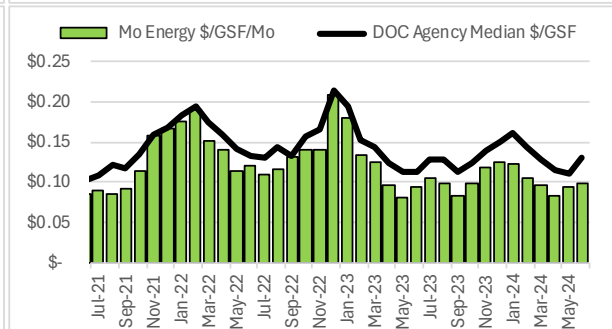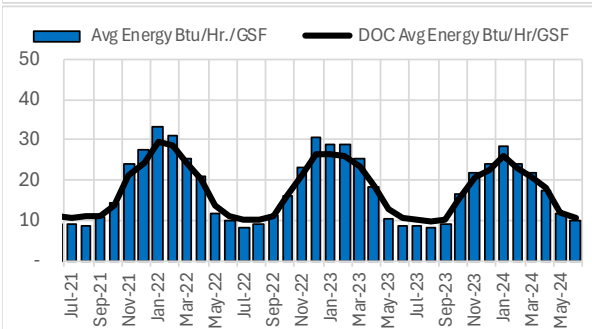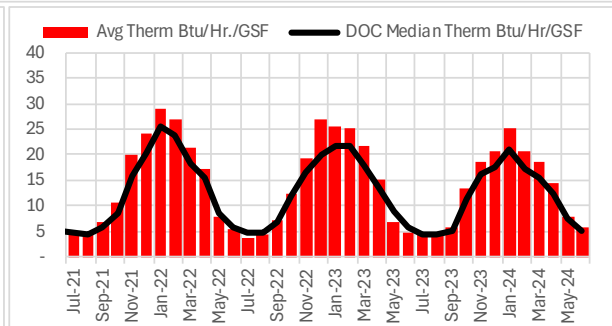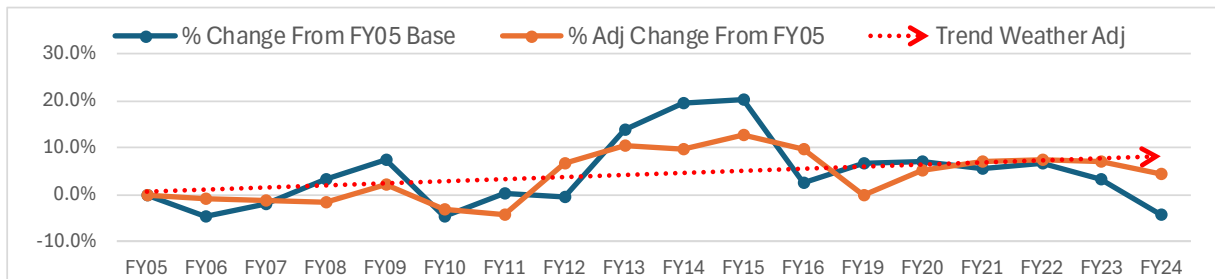

FY2024 DOC-Milwaukee Secure State Facilities Energy Report

FY24 Electric kwh/GSF= 8.51			FY24 Therm/GSF = 0.51			FY24 Total Btu/GSF= 80,092			05-24 Thm 8.6%	
FY24 Electric \$/GSF= \$ 0.95			FY24 Thermal \$/GSF= \$ 0.81			FY24 Energy \$/GSF= \$ 1.77			05-24 kwh -19.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	413,011	54,540	33,939	88,479	0.0%	48.47	100.0%	100.0%	88,479	0.0%
FY06	413,011	47,428	36,537	83,964	-5.1%	50.11	102.4%	97.5%	84,189	-4.8%
FY07	413,011	37,743	37,680	75,423	-14.8%	48.88	100.7%	98.9%	75,271	-14.9%
FY08	413,011	34,956	36,872	71,827	-18.8%	47.87	96.0%	98.8%	69,982	-20.9%
FY09	413,011	28,626	37,821	66,446	-24.9%	47.26	92.6%	99.5%	64,118	-27.5%
FY10	413,011	36,433	39,180	75,612	-14.5%	49.10	101.6%	99.5%	76,012	-14.1%
FY11	413,011	36,722	38,916	75,638	-14.5%	48.17	96.5%	98.5%	73,768	-16.6%
FY12	413,011	52,506	40,523	93,029	5.1%	52.24	106.5%	96.0%	94,804	7.1%
FY13	413,011	56,572	38,516	95,088	7.5%	48.26	97.0%	99.3%	93,163	5.3%
FY14	413,011	66,797	38,107	104,904	18.6%	45.20	92.0%	99.8%	99,526	12.5%
FY15	413,011	59,565	35,461	95,026	7.4%	46.08	94.8%	101.9%	92,607	4.7%
FY16	413,011	51,612	36,569	88,182	-0.3%	50.51	108.2%	98.2%	91,767	3.7%
FY17	413,011	51,205	36,881	88,086	-0.4%	51.99	110.9%	94.8%	91,747	3.7%
FY18	413,011	63,295	36,975	100,270	13.3%	48.79	100.2%	98.6%	99,907	12.9%
FY19	413,011	63,493	34,727	98,220	11.0%	47.88	95.7%	98.4%	94,964	7.3%
FY20	413,011	61,168	34,941	96,109	8.6%	49.85	105.0%	98.0%	98,449	11.3%
FY21	413,011	58,361	32,166	90,528	2.3%	50.84	105.5%	94.9%	92,071	4.1%
FY22	413,011	54,603	31,624	86,227	-2.5%	50.91	105.0%	93.5%	86,875	-1.8%
FY23	413,011	60,444	30,685	91,129	3.0%	51.08	110.5%	97.5%	96,711	9.3%
FY24	413,011	51,042	29,051	80,092	-9.5%	53.15	116.0%	94.5%	86,669	-2.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

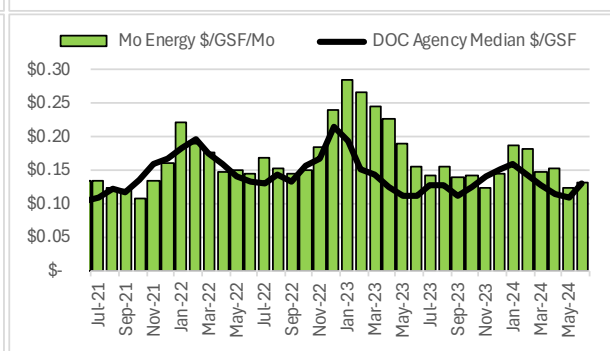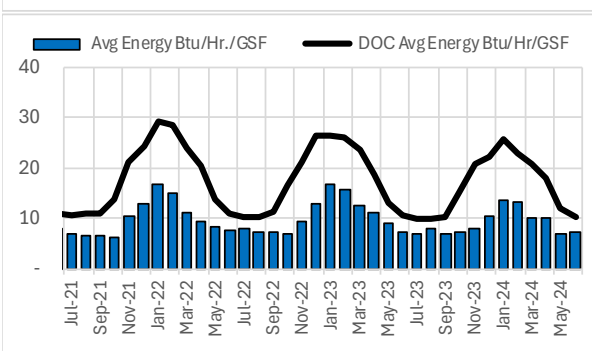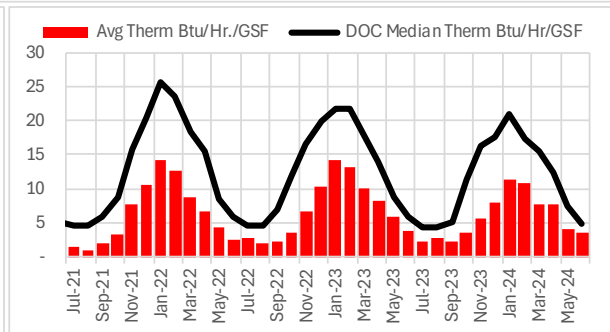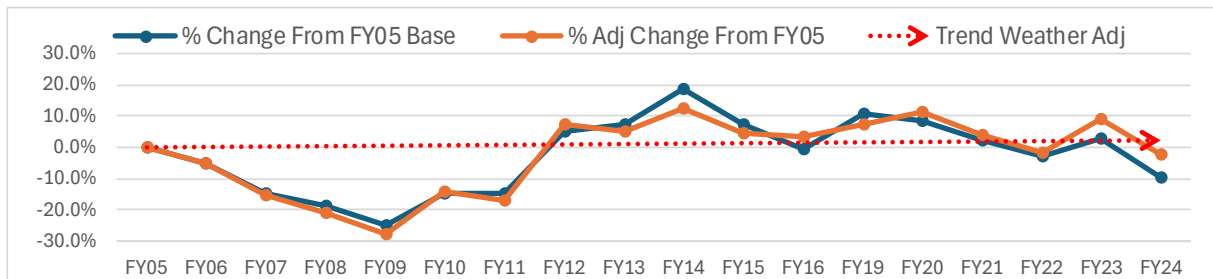

FY2024 DOC-New Lisbon State Facilities Energy Report

FY24 Electric kwh/GSF= 16.70			FY24 Therm/GSF = 1.14			FY24 Total Btu/GSF= 171,153			05-24 Thm -23.0%	
FY24 Electric \$/GSF= \$ 1.59			FY24 Thermal \$/GSF= \$ 0.49			FY24 Energy \$/GSF= \$ 2.08			05-24 kwh -16.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	316,878	156,152	68,006	224,158	0.0%	48.43	100.0%	100.0%	224,158	0.0%
FY06	316,878	140,266	69,779	210,045	-6.3%	49.77	101.8%	100.0%	212,594	-5.2%
FY07	316,878	133,273	67,612	200,885	-10.4%	48.68	101.9%	99.8%	203,323	-9.3%
FY08	316,878	128,558	66,143	194,701	-13.1%	46.15	94.7%	99.3%	187,405	-16.4%
FY09	316,878	127,214	63,464	190,678	-14.9%	45.86	94.9%	99.6%	183,945	-17.9%
FY10	316,878	120,443	63,345	183,788	-18.0%	47.43	98.8%	99.9%	182,305	-18.7%
FY11	316,878	122,922	63,509	186,431	-16.8%	46.70	95.6%	99.3%	180,523	-19.5%
FY12	316,878	105,377	62,385	167,762	-25.2%	51.77	108.0%	100.2%	176,295	-21.4%
FY13	316,878	125,151	62,072	187,223	-16.5%	46.71	94.3%	99.8%	179,955	-19.7%
FY14	316,878	126,244	62,653	188,897	-15.7%	44.97	93.0%	99.1%	179,525	-19.9%
FY15	316,878	127,977	63,964	191,941	-14.4%	47.28	97.2%	99.7%	188,184	-16.0%
FY16	316,878	125,872	64,693	190,565	-15.0%	51.01	106.2%	100.0%	198,452	-11.5%
FY17	316,878	119,139	63,022	182,161	-18.7%	51.62	107.0%	99.7%	190,311	-15.1%
FY18	316,878	135,289	62,191	197,480	-11.9%	48.61	98.9%	99.4%	195,534	-12.8%
FY19	316,878	136,679	60,977	197,656	-11.8%	46.76	95.2%	99.9%	191,074	-14.8%
FY20	316,878	162,100	60,860	222,960	-0.5%	49.35	100.7%	99.7%	223,899	-0.1%
FY21	316,878	125,504	60,588	186,092	-17.0%	49.59	102.3%	99.4%	188,569	-15.9%
FY22	316,878	126,960	59,674	186,635	-16.7%	48.90	100.5%	99.7%	187,103	-16.5%
FY23	316,878	135,882	59,972	195,854	-12.6%	49.35	101.2%	99.9%	197,464	-11.9%
FY24	316,878	114,140	57,013	171,153	-23.6%	52.02	105.3%	99.1%	176,742	-21.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

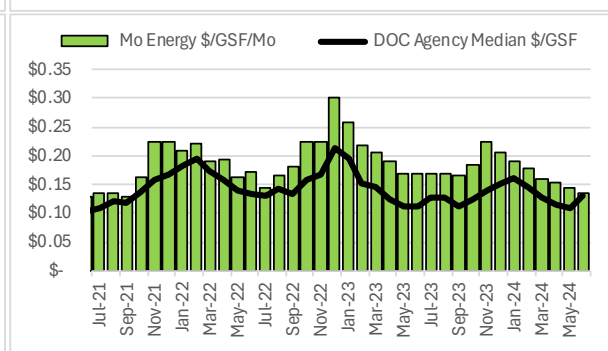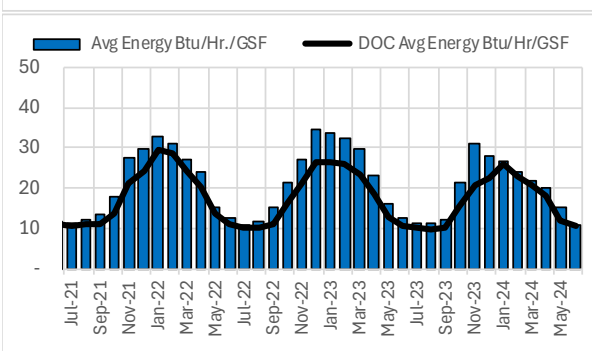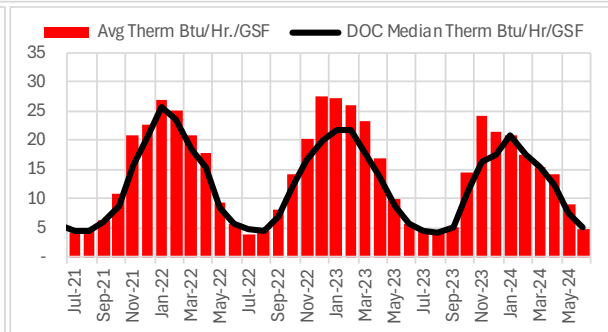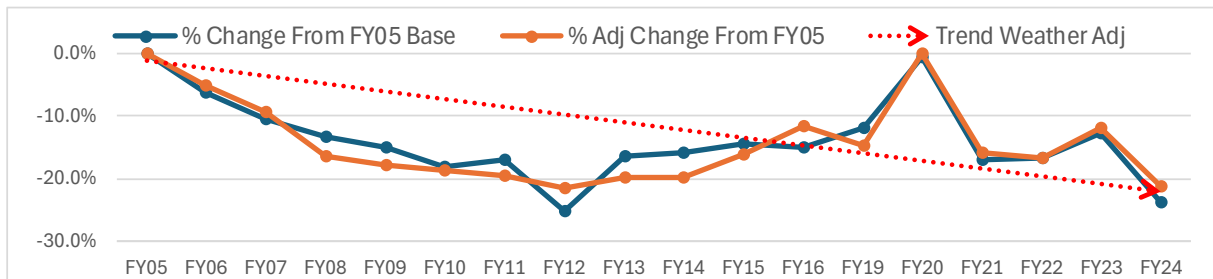

FY2024 DOC-Oakhill State Facilities Energy Report

FY24 Electric kwh/GSF= 9.48			FY24 Therm/GSF = 1.37			FY24 Total Btu/GSF= 169,457		05-24 Thm 19.2%		
FY24 Electric \$/GSF= \$ 0.90			FY24 Thermal \$/GSF= \$ 0.54			FY24 Energy \$/GSF= \$ 1.43		05-24 kwh -4.8%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	319,630	123,588	33,738	157,326	0.0%	48.12	100.0%	100.0%	157,326	0.0%
FY06	331,380	120,605	34,859	155,465	-1.2%	48.65	99.3%	99.9%	154,637	-1.7%
FY07	331,380	134,930	35,774	170,704	8.5%	47.46	94.8%	99.7%	163,545	4.0%
FY08	331,380	155,265	37,158	192,423	22.3%	46.19	93.0%	98.7%	181,063	15.1%
FY09	331,380	161,178	36,568	197,746	25.7%	45.66	93.6%	99.2%	187,087	18.9%
FY10	331,380	153,778	37,041	190,818	21.3%	47.10	96.2%	100.0%	184,900	17.5%
FY11	348,153	141,509	36,421	177,929	13.1%	46.81	93.8%	99.0%	168,757	7.3%
FY12	348,153	125,267	37,091	162,358	3.2%	51.51	106.7%	99.8%	170,697	8.5%
FY13	348,153	147,566	36,939	184,506	17.3%	47.29	95.0%	99.4%	176,965	12.5%
FY14	348,153	162,932	36,966	199,897	27.1%	44.58	91.1%	99.3%	185,052	17.6%
FY15	348,153	156,462	36,728	193,190	22.8%	45.84	94.0%	99.9%	183,834	16.8%
FY16	348,153	146,394	31,336	177,730	13.0%	49.68	104.4%	99.6%	184,054	17.0%
FY17	348,153	148,831	31,087	179,918	14.4%	49.72	103.8%	99.3%	185,349	17.8%
FY18	348,153	162,045	31,507	193,551	23.0%	46.66	94.9%	99.8%	185,214	17.7%
FY19	348,153	153,600	31,028	184,628	17.4%	45.87	93.2%	99.9%	174,171	10.7%
FY20	348,153	160,398	30,854	191,252	21.6%	48.08	99.4%	99.8%	190,261	20.9%
FY21	348,153	148,358	29,283	177,641	12.9%	47.61	99.1%	99.2%	176,020	11.9%
FY22	348,153	141,199	30,230	171,430	9.0%	48.04	99.8%	99.5%	171,055	8.7%
FY23	348,153	148,222	31,187	179,409	14.0%	48.63	100.9%	100.0%	180,744	14.9%
FY24	348,153	137,085	32,372	169,457	7.7%	50.95	107.4%	99.3%	179,430	14.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

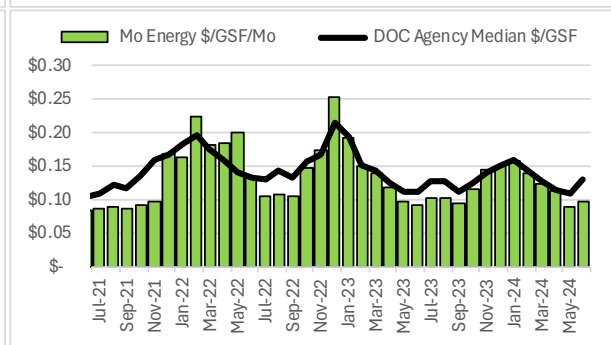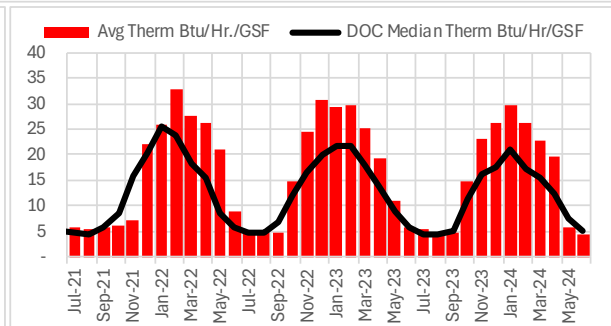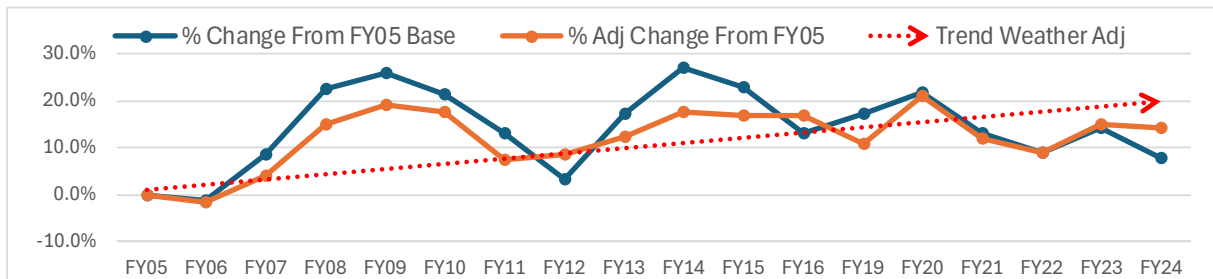

FY2024 DOC-Oshkosh State Facilities Energy Report

FY24 Electric kwh/GSF= 9.45			FY24 Therm/GSF = 1.02			FY24 Total Btu/GSF= 134,649		05-24 Thm -1.1%		
FY24 Electric \$/GSF= \$ 0.81			FY24 Thermal \$/GSF= \$ 0.35			FY24 Energy \$/GSF= \$ 1.16		05-24 kwh -22.9%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	890,187	112,252	42,105	154,357	0.0%	45.94	100.0%	100.0%	154,357	0.0%
FY06	890,187	107,877	41,991	149,868	-2.9%	47.26	103.5%	99.9%	153,559	-0.5%
FY07	890,187	109,030	42,903	151,932	-1.6%	46.64	102.1%	100.1%	154,274	-0.1%
FY08	890,187	116,494	43,110	159,605	3.4%	45.02	98.7%	99.3%	157,733	2.2%
FY09	890,187	114,436	42,311	156,747	1.5%	43.47	95.7%	99.3%	151,502	-1.8%
FY10	890,187	110,648	41,021	151,669	-1.7%	45.98	99.6%	100.3%	151,299	-2.0%
FY11	890,187	117,976	41,112	159,088	3.1%	44.58	96.7%	99.3%	154,866	0.3%
FY12	890,187	103,233	40,770	144,003	-6.7%	49.86	108.4%	100.5%	152,928	-0.9%
FY13	890,187	111,171	40,913	152,084	-1.5%	45.29	97.6%	99.8%	149,322	-3.3%
FY14	890,187	122,831	39,403	162,234	5.1%	41.95	92.6%	98.9%	152,763	-1.0%
FY15	890,187	121,847	36,384	158,231	2.5%	43.98	95.8%	100.0%	153,053	-0.8%
FY16	890,187	104,828	36,382	141,210	-8.5%	48.11	106.1%	100.2%	147,657	-4.3%
FY17	890,187	102,475	36,190	138,665	-10.2%	48.65	108.3%	99.4%	146,922	-4.8%
FY18	890,187	104,169	35,212	139,381	-9.7%	45.41	98.4%	99.4%	137,542	-10.9%
FY19	890,187	108,513	34,830	143,343	-7.1%	44.90	97.7%	99.8%	140,820	-8.8%
FY20	890,187	104,203	35,347	139,550	-9.6%	46.40	100.6%	100.0%	140,212	-9.2%
FY21	890,187	107,148	34,352	141,500	-8.3%	47.28	102.7%	99.2%	144,119	-6.6%
FY22	890,187	108,782	35,054	143,836	-6.8%	46.76	101.7%	99.0%	145,372	-5.8%
FY23	890,187	108,071	33,984	142,054	-8.0%	47.58	103.5%	99.9%	145,795	-5.5%
FY24	890,187	102,403	32,245	134,649	-12.8%	49.93	108.4%	100.6%	143,505	-7.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

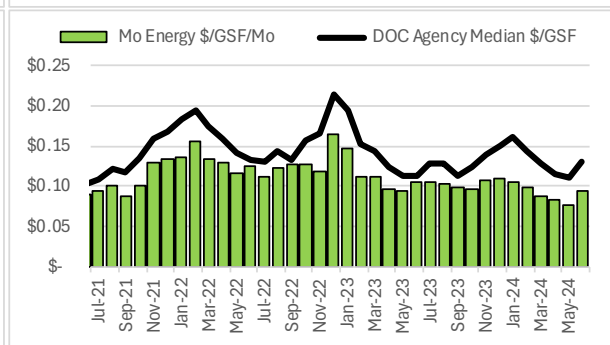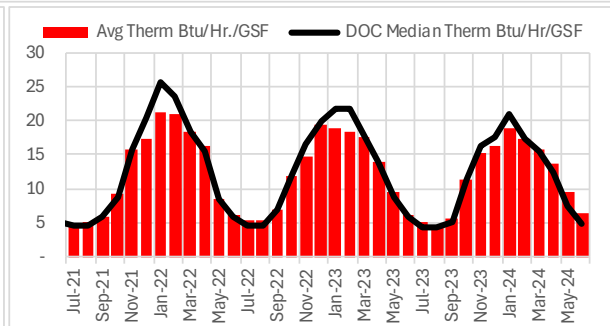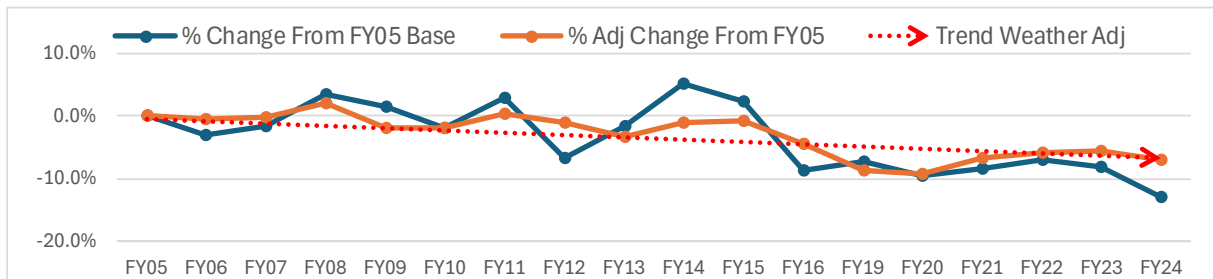

FY2024 DOC-Prairie du Chien State Facilities Energy Report

FY24 Electric kwh/GSF= 4.64			FY24 Therm/GSF = 0.66			FY24 Total Btu/GSF= 81,540			05-24 Thm -33.3%	
FY24 Electric \$/GSF= \$ 0.44			FY24 Thermal \$/GSF= \$ 0.29			FY24 Energy \$/GSF= \$ 0.73			05-24 kwh -4.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	383,100	105,090	16,589	121,679	0.0%	48.12	100.0%	100.0%	121,679	0.0%
FY06	383,100	99,802	17,172	116,974	-3.9%	48.65	101.5%	99.7%	118,449	-2.7%
FY07	383,100	109,906	18,685	128,591	5.7%	47.46	98.3%	99.6%	126,644	4.1%
FY08	383,100	109,408	19,144	128,552	5.6%	46.19	93.7%	98.6%	121,365	-0.3%
FY09	383,100	105,144	18,166	123,310	1.3%	45.66	93.1%	98.9%	115,813	-4.8%
FY10	383,100	105,909	18,289	124,199	2.1%	47.10	96.6%	99.9%	120,538	-0.9%
FY11	383,100	103,314	17,669	120,983	-0.6%	46.81	94.3%	98.9%	114,844	-5.6%
FY12	383,100	85,752	17,167	102,918	-15.4%	51.51	103.8%	100.6%	106,269	-12.7%
FY13	383,100	84,135	15,515	99,650	-18.1%	47.29	93.1%	98.8%	93,684	-23.0%
FY14	383,100	82,630	15,751	98,382	-19.1%	44.58	96.9%	98.5%	95,591	-21.4%
FY15	383,100	80,992	15,843	96,835	-20.4%	45.84	92.2%	99.7%	90,478	-25.6%
FY16	383,100	76,598	15,848	92,446	-24.0%	49.68	102.5%	99.8%	94,323	-22.5%
FY17	383,100	76,598	15,619	92,217	-24.2%	49.72	102.3%	99.1%	93,873	-22.9%
FY18	383,100	64,820	15,775	80,595	-33.8%	46.66	91.6%	99.3%	75,007	-38.4%
FY19	383,100	77,751	15,870	93,621	-23.1%	45.87	90.3%	99.5%	85,978	-29.3%
FY20	383,100	81,182	15,713	96,896	-20.4%	48.08	96.4%	99.7%	93,886	-22.8%
FY21	383,100	70,072	15,041	85,113	-30.1%	47.61	98.4%	98.7%	83,808	-31.1%
FY22	383,100	73,600	15,772	89,371	-26.6%	48.04	93.7%	98.9%	84,531	-30.5%
FY23	383,100	78,171	15,974	94,145	-22.6%	48.63	98.3%	99.9%	92,773	-23.8%
FY24	383,100	65,702	15,838	81,540	-33.0%	50.95	106.6%	100.1%	85,903	-29.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

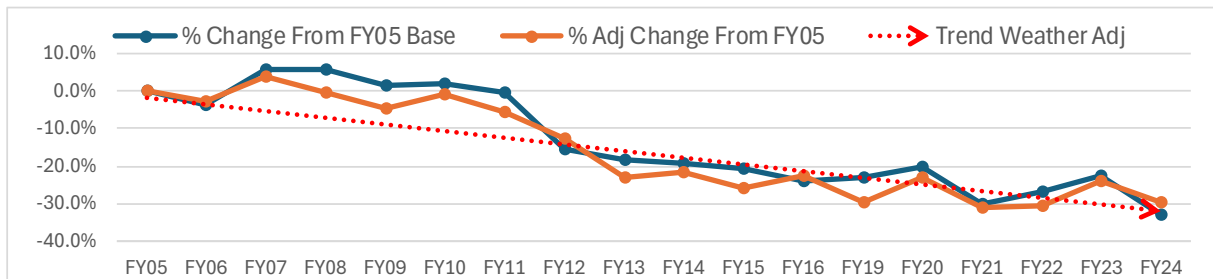

FY2024 DOC-Racine State Facilities Energy Report

FY24 Electric kwh/GSF= 14.30			FY24 Therm/GSF = 0.83			FY24 Total Btu/GSF= 131,374		05-24 Thm -10.9%		
FY24 Electric \$/GSF= \$ 1.49			FY24 Thermal \$/GSF= \$ 0.32			FY24 Energy \$/GSF= \$ 1.81		05-24 kwh -26.8%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	409,046	106,944	67,085	174,029	0.0%	48.47	100.0%	100.0%	174,029	0.0%
FY06	409,046	109,439	68,714	178,153	2.4%	50.11	103.5%	99.5%	181,593	4.3%
FY07	409,046	110,566	68,676	179,242	3.0%	48.88	101.3%	99.8%	180,507	3.7%
FY08	409,046	103,329	68,480	171,809	-1.3%	47.87	97.5%	98.9%	168,475	-3.2%
FY09	409,046	112,264	68,076	180,340	3.6%	47.26	96.0%	99.3%	175,380	0.8%
FY10	409,046	105,822	64,164	169,986	-2.3%	49.10	102.2%	100.1%	172,365	-1.0%
FY11	409,046	110,909	61,212	172,121	-1.1%	48.17	97.9%	98.9%	169,052	-2.9%
FY12	409,046	97,050	60,909	157,959	-9.2%	52.24	108.9%	100.1%	166,640	-4.2%
FY13	409,046	104,257	60,837	165,093	-5.1%	48.26	98.8%	99.5%	163,552	-6.0%
FY14	409,046	120,628	63,458	184,086	5.8%	45.20	91.0%	98.9%	172,540	-0.9%
FY15	409,046	112,663	65,659	178,322	2.5%	46.08	94.0%	99.7%	171,353	-1.5%
FY16	409,046	110,993	63,280	174,273	0.1%	50.51	106.6%	100.1%	181,608	4.4%
FY17	409,046	110,893	60,375	171,268	-1.6%	51.99	108.0%	99.5%	179,784	3.3%
FY18	409,046	122,445	59,228	181,673	4.4%	48.79	100.4%	99.3%	181,700	4.4%
FY19	409,046	121,162	57,006	178,169	2.4%	47.88	97.9%	99.3%	175,215	0.7%
FY20	409,046	109,995	56,544	166,539	-4.3%	49.85	104.1%	99.9%	171,018	-1.7%
FY21	409,046	95,314	52,437	147,751	-15.1%	50.84	106.7%	98.6%	153,377	-11.9%
FY22	409,046	96,432	51,451	147,883	-15.0%	50.91	105.0%	99.5%	152,468	-12.4%
FY23	409,046	99,094	49,194	148,289	-14.8%	51.08	107.9%	100.3%	156,272	-10.2%
FY24	409,046	82,551	48,822	131,374	-24.5%	53.15	115.4%	100.6%	144,331	-17.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

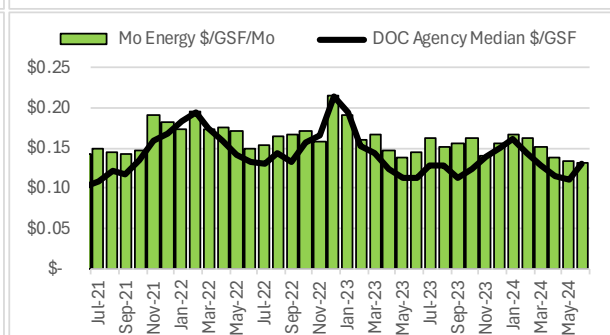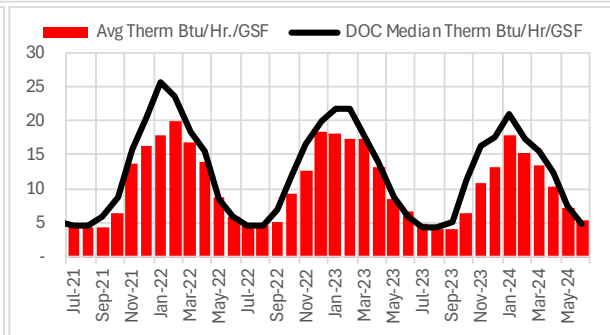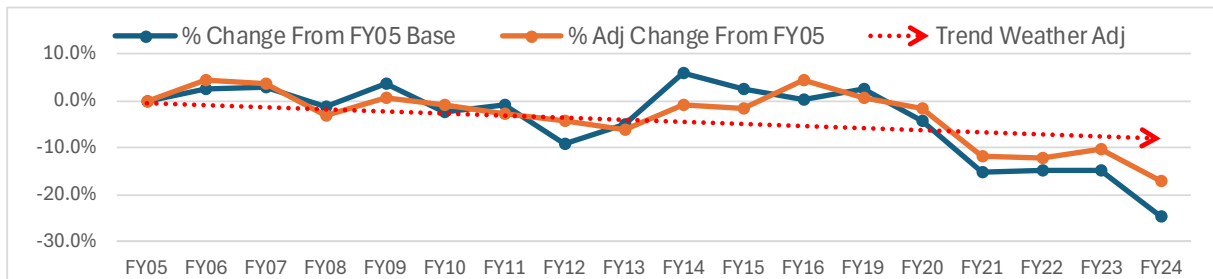

FY2024 DOC-Racine Youth State Facilities Energy Report

FY24 Electric kwh/GSF= 9.29			FY24 Therm/GSF = 0.56			FY24 Total Btu/GSF= 87,476			05-24 Thm -24.9%	
FY24 Electric \$/GSF= \$ 1.12			FY24 Thermal \$/GSF= \$ 0.24			FY24 Energy \$/GSF= \$ 1.35			05-24 kwh -19.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	207,697	85,046	38,193	123,239	0.0%	48.47	100.0%	100.0%	123,239	0.0%
FY06	207,697	80,443	40,758	121,201	-1.7%	50.11	104.1%	97.9%	123,611	0.3%
FY07	207,697	80,478	40,715	121,193	-1.7%	48.88	100.4%	98.9%	121,038	-1.8%
FY08	207,697	66,072	40,406	106,478	-13.6%	47.87	97.7%	98.5%	104,381	-15.3%
FY09	207,697	72,363	38,660	111,023	-9.9%	47.26	95.9%	99.1%	107,667	-12.6%
FY10	207,697	72,763	37,540	110,303	-10.5%	49.10	100.6%	99.7%	110,595	-10.3%
FY11	207,697	89,156	39,752	128,908	4.6%	48.17	96.3%	97.6%	124,637	1.1%
FY12	207,697	75,118	41,040	116,158	-5.7%	52.24	108.6%	97.6%	121,582	-1.3%
FY13	207,697	84,271	41,215	125,486	1.8%	48.26	97.1%	98.6%	122,418	-0.7%
FY14	207,697	89,930	36,137	126,067	2.3%	45.20	91.2%	97.8%	117,376	-4.8%
FY15	207,697	67,337	31,975	99,311	-19.4%	46.08	92.6%	101.0%	94,610	-23.2%
FY16	207,697	60,510	33,002	93,512	-24.1%	50.51	107.1%	99.1%	97,548	-20.8%
FY17	207,697	59,188	33,743	92,931	-24.6%	51.99	109.4%	94.9%	96,807	-21.4%
FY18	207,697	64,910	33,930	98,840	-19.8%	48.79	100.2%	98.1%	98,326	-20.2%
FY19	207,697	63,557	32,665	96,223	-21.9%	47.88	96.7%	98.4%	93,597	-24.1%
FY20	207,697	63,613	32,750	96,364	-21.8%	49.85	103.8%	98.9%	98,398	-20.2%
FY21	207,697	60,718	31,255	91,973	-25.4%	50.84	105.9%	96.3%	94,415	-23.4%
FY22	207,697	58,129	31,439	89,568	-27.3%	50.91	105.3%	95.4%	91,206	-26.0%
FY23	207,697	58,880	31,651	90,531	-26.5%	51.08	107.3%	99.4%	94,659	-23.2%
FY24	207,697	55,760	31,716	87,476	-29.0%	53.15	114.5%	97.1%	94,665	-23.2%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

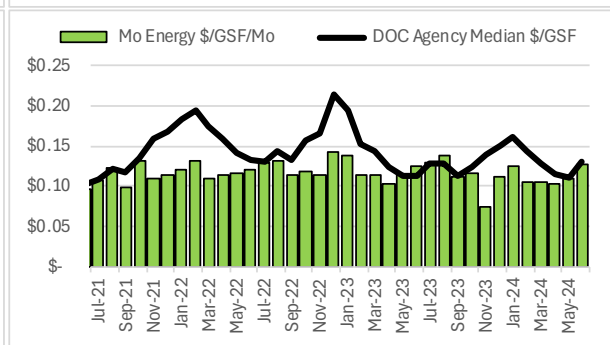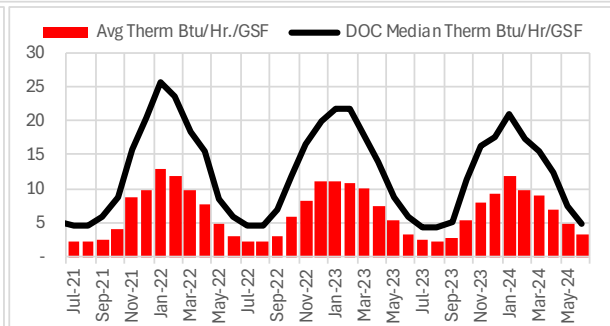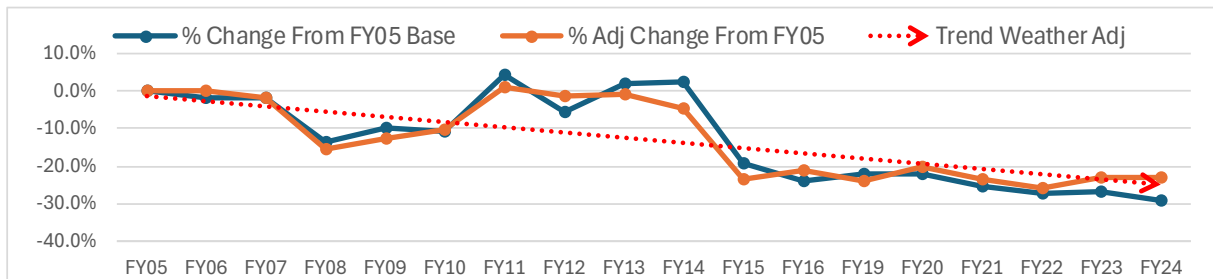

FY2024 DOC-Redgranite State Facilities Energy Report

FY24 Electric kwh/GSF= 14.67			FY24 Therm/GSF = 0.96			FY24 Total Btu/GSF= 146,581		05-24 Thm -29.3%		
FY24 Electric \$/GSF= \$ 1.32			FY24 Thermal \$/GSF= \$ 0.40			FY24 Energy \$/GSF= \$ 1.73		05-24 kwh -18.1%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	310,135	152,068	61,358	213,425	0.0%	45.94	100.0%	100.0%	213,425	0.0%
FY06	310,135	143,563	61,625	205,188	-3.9%	47.26	103.4%	100.1%	210,194	-1.5%
FY07	310,135	147,920	60,417	208,337	-2.4%	46.64	101.0%	100.2%	209,955	-1.6%
FY08	310,135	154,523	60,863	215,386	0.9%	45.02	97.7%	99.3%	211,392	-1.0%
FY09	310,135	145,411	60,714	206,125	-3.4%	43.47	94.1%	99.5%	197,223	-7.6%
FY10	310,135	131,445	60,011	191,456	-10.3%	45.98	99.5%	99.5%	190,517	-10.7%
FY11	310,135	134,920	58,674	193,594	-9.3%	44.58	95.4%	98.7%	186,594	-12.6%
FY12	310,135	118,110	57,891	176,001	-17.5%	49.86	109.6%	100.9%	187,874	-12.0%
FY13	310,135	139,269	57,954	197,223	-7.6%	45.29	96.7%	99.8%	192,445	-9.8%
FY14	310,135	137,482	55,539	193,021	-9.6%	41.95	90.6%	99.0%	179,582	-15.9%
FY15	310,135	130,751	52,033	182,785	-14.4%	43.98	95.5%	99.7%	176,711	-17.2%
FY16	310,135	122,094	52,436	174,531	-18.2%	48.11	106.2%	100.2%	182,208	-14.6%
FY17	310,135	129,607	52,162	181,769	-14.8%	48.65	107.9%	100.6%	192,319	-9.9%
FY18	310,135	141,065	51,135	192,200	-9.9%	45.41	97.8%	99.5%	188,919	-11.5%
FY19	310,135	149,176	49,508	198,684	-6.9%	44.90	96.3%	99.7%	192,959	-9.6%
FY20	310,135	139,991	49,462	189,454	-11.2%	46.40	100.9%	100.0%	190,720	-10.6%
FY21	310,135	119,645	48,517	168,162	-21.2%	47.28	102.4%	99.6%	170,837	-20.0%
FY22	310,135	117,894	50,665	168,559	-21.0%	46.76	101.2%	99.4%	169,710	-20.5%
FY23	310,135	116,258	50,046	166,304	-22.1%	47.58	103.3%	100.2%	170,292	-20.2%
FY24	310,135	96,498	50,084	146,581	-31.3%	49.93	111.3%	100.3%	157,700	-26.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

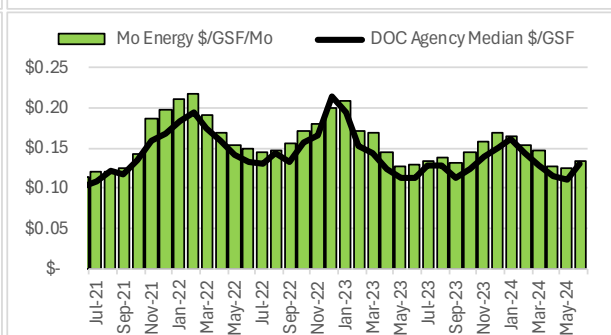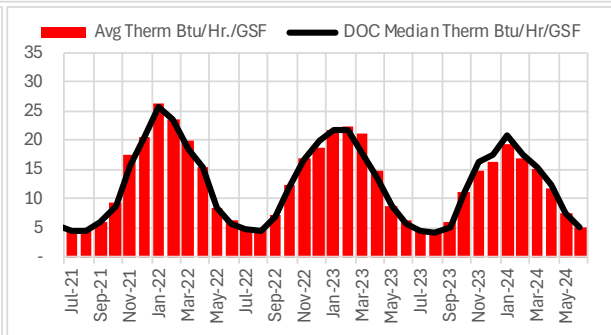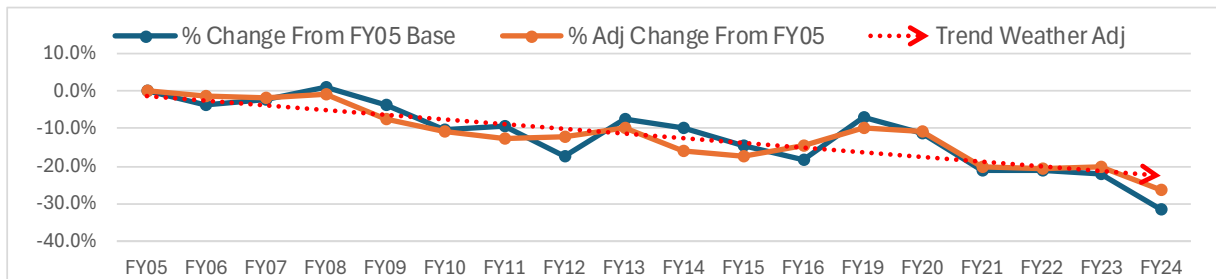

FY2024 DOC-Stanley State Facilities Energy Report

FY24 Electric kwh/GSF= 13.02			FY24 Therm/GSF = 1.07			FY24 Total Btu/GSF= 151,817			05-24 Thm -13.8%	
FY24 Electric \$/GSF= \$ 1.39			FY24 Thermal \$/GSF= \$ 0.50			FY24 Energy \$/GSF= \$ 1.89			05-24 kwh -33.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	411,897	136,226	68,314	204,540	0.0%	45.85	100.0%	100.0%	204,540	0.0%
FY06	411,897	118,035	66,203	184,238	-9.9%	47.80	104.8%	99.8%	189,798	-7.2%
FY07	411,897	130,405	57,584	187,989	-8.1%	46.32	101.2%	99.4%	189,220	-7.5%
FY08	411,897	133,092	55,500	188,592	-7.8%	43.27	93.8%	98.4%	179,472	-12.3%
FY09	411,897	135,351	55,173	190,524	-6.9%	42.97	93.9%	98.0%	181,098	-11.5%
FY10	411,897	109,698	51,820	161,518	-21.0%	45.29	99.0%	99.9%	160,321	-21.6%
FY11	411,897	134,274	53,285	187,559	-8.3%	43.68	93.5%	99.3%	178,448	-12.8%
FY12	411,897	118,819	52,235	171,054	-16.4%	49.02	106.9%	100.7%	179,625	-12.2%
FY13	411,897	133,715	49,943	183,658	-10.2%	43.85	94.3%	99.5%	175,832	-14.0%
FY14	411,897	145,049	50,450	195,499	-4.4%	41.37	88.4%	98.3%	177,893	-13.0%
FY15	411,897	131,797	50,775	182,572	-10.7%	43.42	95.1%	99.5%	175,815	-14.0%
FY16	411,897	133,706	52,090	185,796	-9.2%	47.61	104.7%	100.3%	192,290	-6.0%
FY17	411,897	129,747	52,209	181,956	-11.0%	47.07	102.9%	99.8%	185,655	-9.2%
FY18	411,897	131,768	52,067	183,835	-10.1%	43.54	94.3%	99.2%	175,922	-14.0%
FY19	411,897	131,397	52,076	183,473	-10.3%	42.23	91.7%	99.5%	172,231	-15.8%
FY20	411,897	128,654	51,451	180,105	-11.9%	45.42	99.2%	99.9%	178,995	-12.5%
FY21	411,897	124,215	48,380	172,595	-15.6%	46.01	100.8%	99.3%	173,265	-15.3%
FY22	411,897	132,400	46,247	178,647	-12.7%	44.82	97.9%	98.9%	175,343	-14.3%
FY23	411,897	122,602	42,767	165,370	-19.2%	45.82	99.7%	100.1%	165,008	-19.3%
FY24	411,897	107,380	44,437	151,817	-25.8%	49.00	109.3%	101.5%	162,516	-20.5%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

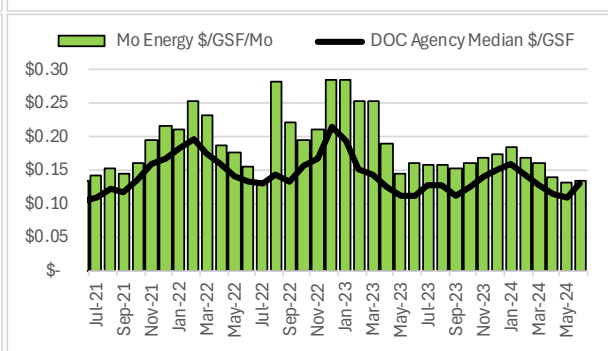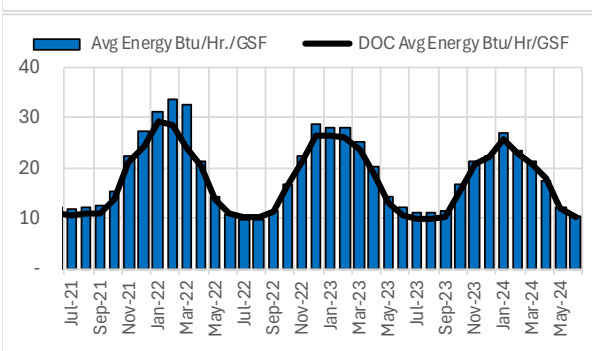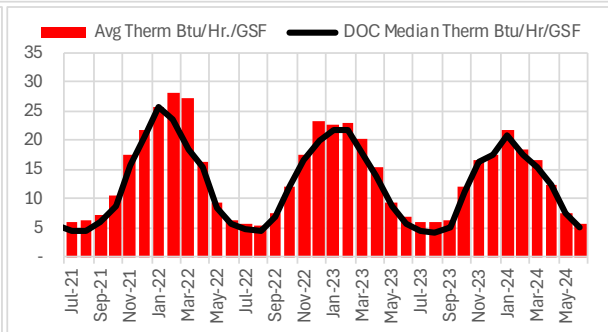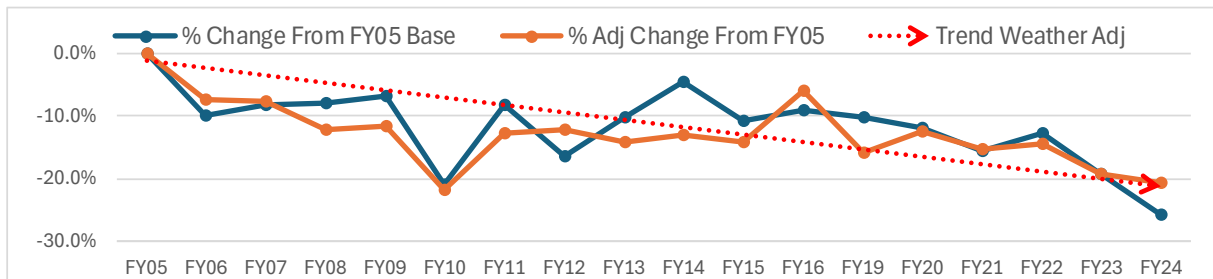

FY2024 DOC-Sturtevant State Facilities Energy Report

FY24 Electric kwh/GSF= 11.85			FY24 Therm/GSF = 0.80			FY24 Total Btu/GSF= 120,897			05-24 Thm -29.4%	
FY24 Electric \$/GSF= \$ 1.31			FY24 Thermal \$/GSF= \$ 0.35			FY24 Energy \$/GSF= \$ 1.66			05-24 kwh -26.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	93,312	131,324	54,613	185,937	0.0%	48.47	100.0%	100.0%	185,937	0.0%
FY06	93,312	122,768	52,729	175,497	-5.6%	50.11	99.9%	99.0%	174,908	-5.9%
FY07	93,312	124,053	55,178	179,231	-3.6%	48.88	99.9%	99.6%	178,908	-3.8%
FY08	93,312	134,062	58,563	192,625	3.6%	47.87	100.4%	99.5%	192,949	3.8%
FY09	93,312	138,779	59,728	198,507	6.8%	47.26	98.5%	99.7%	196,268	5.6%
FY10	93,312	136,318	57,564	193,882	4.3%	49.10	101.1%	99.8%	195,304	5.0%
FY11	93,312	125,983	58,048	184,031	-1.0%	48.17	98.7%	99.0%	181,733	-2.3%
FY12	93,312	115,209	57,756	172,965	-7.0%	52.24	107.4%	99.0%	180,911	-2.7%
FY13	93,312	127,853	58,103	185,956	0.0%	48.26	98.8%	99.7%	184,265	-0.9%
FY14	93,312	126,438	56,699	183,137	-1.5%	45.20	90.1%	99.2%	170,185	-8.5%
FY15	93,312	134,765	56,870	191,635	3.1%	46.08	93.7%	100.7%	183,570	-1.3%
FY16	93,312	106,682	53,103	159,785	-14.1%	50.51	105.5%	99.2%	165,226	-11.1%
FY17	93,312	96,279	47,583	143,862	-22.6%	51.99	108.7%	98.1%	151,321	-18.6%
FY18	93,312	100,043	45,077	145,120	-22.0%	48.79	100.6%	99.1%	145,312	-21.8%
FY19	93,312	97,753	45,924	143,676	-22.7%	47.88	97.0%	100.0%	140,673	-24.3%
FY20	93,312	83,075	46,686	129,761	-30.2%	49.85	104.0%	99.7%	132,966	-28.5%
FY21	93,312	76,482	38,070	114,553	-38.4%	50.84	106.3%	99.2%	119,058	-36.0%
FY22	93,312	74,876	38,975	113,851	-38.8%	50.91	104.2%	99.1%	116,638	-37.3%
FY23	93,312	80,011	38,061	118,072	-36.5%	51.08	111.8%	98.6%	126,935	-31.7%
FY24	93,312	80,460	40,437	120,897	-35.0%	53.15	115.3%	99.8%	133,100	-28.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

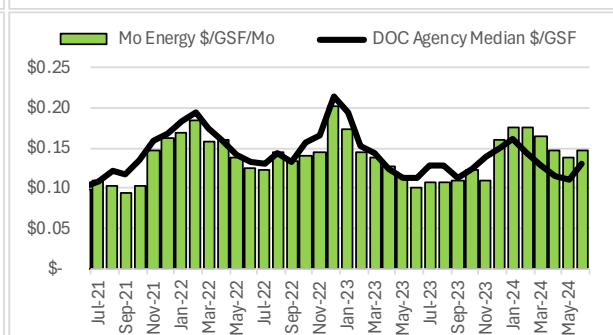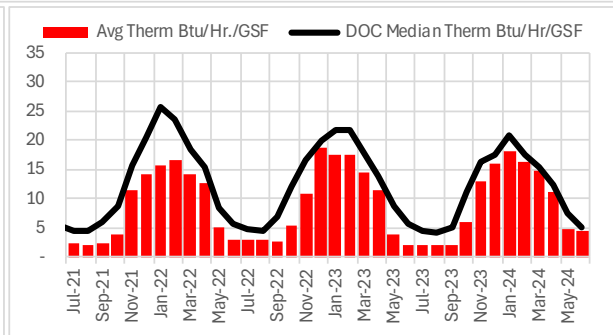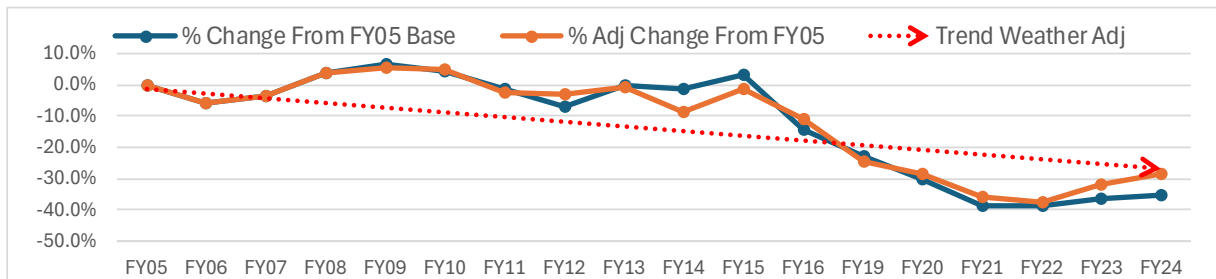

FY2024 DOC-Taycheedah State Facilities Energy Report

FY24 Electric kwh/GSF= 9.08			FY24 Therm/GSF = 0.62			FY24 Total Btu/GSF= 93,486			05-24 Thm -13.7%	
FY24 Electric \$/GSF= \$ 0.85			FY24 Thermal \$/GSF= \$ 0.25			FY24 Energy \$/GSF= \$ 1.10			05-24 kwh -15.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	380,940	81,875	37,036	118,910	0.0%	45.94	100.0%	100.0%	118,910	0.0%
FY06	380,940	84,843	37,608	122,451	3.0%	47.26	105.1%	100.1%	126,851	6.7%
FY07	380,940	87,325	37,003	124,328	4.6%	46.64	102.2%	100.3%	126,337	6.2%
FY08	380,940	88,875	37,777	126,653	6.5%	45.02	97.0%	99.5%	123,826	4.1%
FY09	380,940	89,681	38,027	127,708	7.4%	43.47	92.3%	99.8%	120,772	1.6%
FY10	380,940	77,349	37,471	114,820	-3.4%	45.98	103.7%	99.4%	117,489	-1.2%
FY11	380,940	81,955	37,156	119,112	0.2%	44.58	94.2%	99.3%	114,109	-4.0%
FY12	380,940	70,353	38,382	108,735	-8.6%	49.86	112.2%	100.5%	117,536	-1.2%
FY13	380,940	89,724	37,780	127,504	7.2%	45.29	95.3%	99.8%	123,242	3.6%
FY14	380,940	97,793	37,471	135,264	13.8%	41.95	87.2%	99.5%	122,586	3.1%
FY15	380,940	90,851	36,461	127,313	7.1%	43.98	94.4%	99.9%	122,151	2.7%
FY16	380,940	79,491	34,313	113,804	-4.3%	48.11	107.0%	99.9%	119,323	0.3%
FY17	380,940	79,162	32,075	111,237	-6.5%	48.65	109.5%	99.9%	118,735	-0.1%
FY18	380,940	82,552	31,936	114,489	-3.7%	45.41	96.8%	99.6%	111,730	-6.0%
FY19	380,940	89,327	31,981	121,308	2.0%	44.90	95.4%	99.8%	117,173	-1.5%
FY20	380,940	80,858	32,354	113,212	-4.8%	46.40	99.0%	100.0%	112,430	-5.4%
FY21	380,940	75,388	31,157	106,545	-10.4%	47.28	102.9%	99.5%	108,555	-8.7%
FY22	380,940	81,634	31,505	113,140	-4.9%	46.76	100.5%	99.3%	113,354	-4.7%
FY23	380,940	78,401	31,316	109,717	-7.7%	47.58	103.7%	99.9%	112,576	-5.3%
FY24	380,940	62,480	31,006	93,486	-21.4%	49.93	113.1%	100.4%	101,826	-14.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

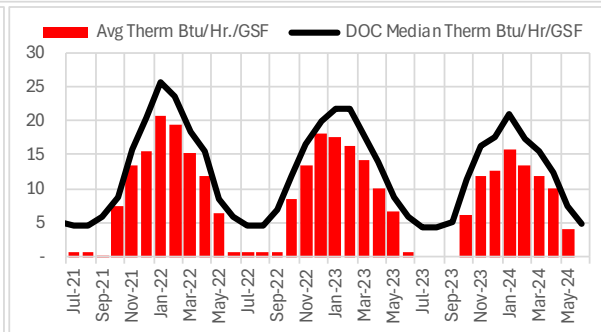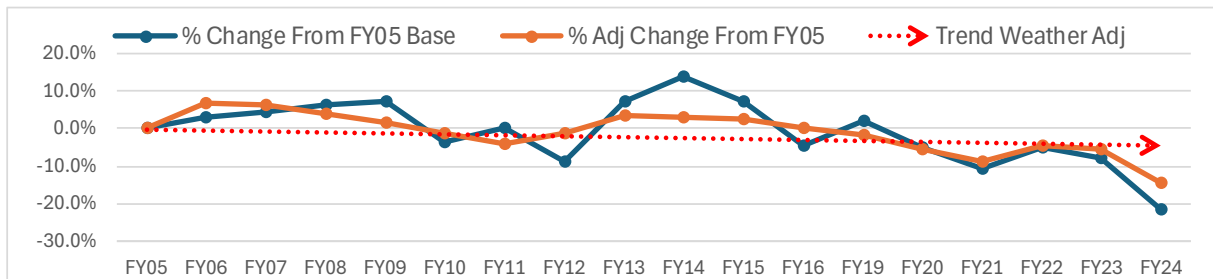

FY2024 DOC-Waupun State Facilities Energy Report

FY24 Electric kwh/GSF= 10.10			FY24 Therm/GSF = 1.53			FY24 Total Btu/GSF= 187,883		05-24 Thm -20.5%		
FY24 Electric \$/GSF= \$ 1.21			FY24 Thermal \$/GSF= \$ 0.58			FY24 Energy \$/GSF= \$ 1.79		05-24 kwh -17.3%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,260,274	203,602	41,632	245,233	0.0%	48.12	100.0%	100.0%	245,233	0.0%
FY06	1,260,274	209,536	40,731	250,267	2.1%	48.65	100.9%	99.5%	252,007	2.8%
FY07	1,260,274	209,439	40,638	250,078	2.0%	47.46	98.5%	99.7%	246,815	0.6%
FY08	1,260,274	213,020	42,524	255,545	4.2%	46.19	95.0%	99.3%	244,553	-0.3%
FY09	1,260,274	217,938	42,051	259,989	6.0%	45.66	94.9%	99.6%	248,699	1.4%
FY10	1,260,274	208,344	40,815	249,159	1.6%	47.10	98.3%	100.1%	245,622	0.2%
FY11	1,260,274	208,778	43,122	251,900	2.7%	46.81	96.4%	98.0%	243,590	-0.7%
FY12	1,260,274	190,756	41,753	232,509	-5.2%	51.51	105.1%	99.7%	242,102	-1.3%
FY13	1,260,274	202,136	41,702	243,838	-0.6%	47.29	97.0%	99.3%	237,509	-3.1%
FY14	1,260,274	214,423	41,576	255,999	4.4%	44.58	92.8%	98.2%	239,754	-2.2%
FY15	1,260,274	187,545	40,619	228,163	-7.0%	45.84	95.9%	99.5%	220,199	-10.2%
FY16	1,260,274	167,911	42,139	210,050	-14.3%	49.68	103.1%	99.9%	215,291	-12.2%
FY17	1,260,274	171,067	41,131	212,198	-13.5%	49.72	103.5%	99.1%	217,835	-11.2%
FY18	1,260,274	180,755	41,735	222,489	-9.3%	46.66	97.0%	99.4%	216,838	-11.6%
FY19	1,260,274	184,637	40,242	224,878	-8.3%	45.87	95.5%	99.2%	216,167	-11.9%
FY20	1,260,274	166,774	39,841	206,614	-15.7%	48.08	100.1%	99.7%	206,632	-15.7%
FY21	1,260,274	164,806	39,022	203,829	-16.9%	47.61	98.9%	98.8%	201,514	-17.8%
FY22	1,260,274	166,537	38,605	205,142	-16.3%	48.04	98.1%	98.3%	201,294	-17.9%
FY23	1,260,274	153,062	36,848	189,910	-22.6%	48.63	101.2%	100.0%	191,746	-21.8%
FY24	1,260,274	153,397	34,486	187,883	-23.4%	50.95	105.6%	99.9%	196,374	-19.9%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

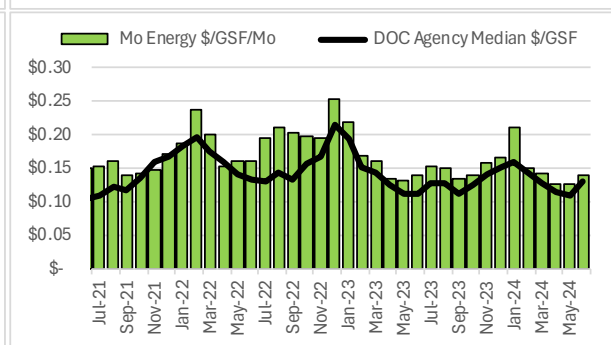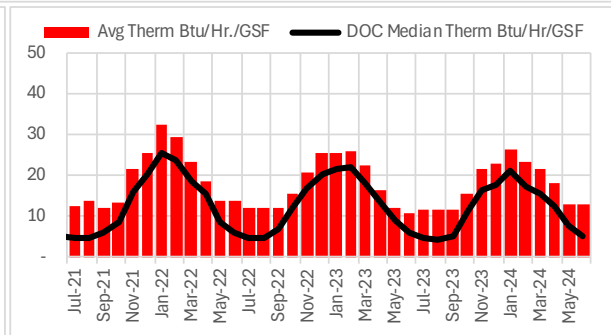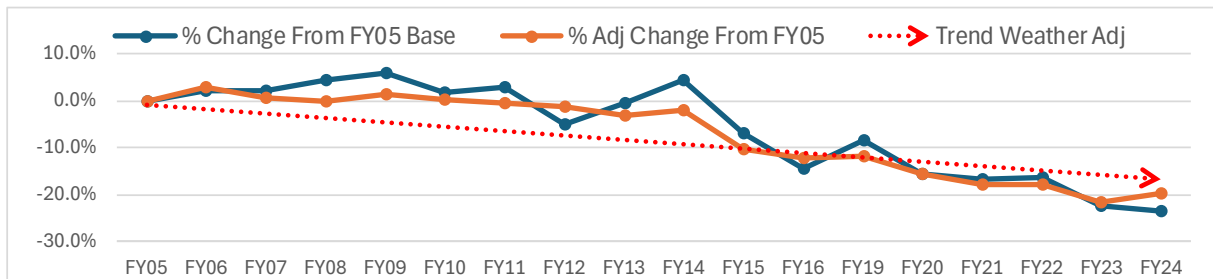

Agency Energy Use Summary

Department of Health Services



WISCONSIN DEPARTMENT
of HEALTH SERVICES

SCOPE

Includes five facilities:

1. Mendota Complex - Mendota Mental Health Institute and Center Wisconsin Center;
2. Northern Center and Chippewa Valley CTF (DOC);
3. Sand Ridge Center;
4. Southern Center - Southern Oaks Girls School (DOC), Ellsworth Correctional Center (DOC), and facilities now operated by Department of Veterans Affairs; and
5. Winnebago Complex - Winnebago Mental Health Institute and Wisconsin Resources Center.

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 16.5 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 2.2 percent decrease

Energy use (BTU/GSF/Yr) for FY24 decrease 2.2 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 0.9 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 0.9 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: -2.1 percent decrease.



Gross square footage (GSF) has decreased 2.1% from the base fiscal year, FY05.

Consumption Change from Base: 23.9 percent decrease.

Total consumption was 23.9 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 19.6 percent less than in the base year when adjusted for weather compared to FY05.


Health Services, Department of

Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024	
Electricity	\$	3,487,127	\$	2,632,095	\$	3,608,601	\$	3,977,447	\$	4,326,539
Coal	\$	188,089	\$	185,864	\$	61,340	\$	-	\$	-
Natural Gas	\$	1,228,406	\$	2,813,926	\$	4,263,409	\$	4,172,798	\$	2,167,182
Fuel Oil	\$	32,911	\$	32,631	\$	31,436	\$	6,531	\$	7,110
Other Fuels	\$	18,022	\$	30,065	\$	81,547	\$	77,350	\$	65,938
Steam/Heat	\$	70,175	\$	-	\$	-	\$	-	\$	-
Chilled Water	\$	-	\$	-	\$	-	\$	-	\$	-
Water & Sewage	\$	2,342,656	\$	1,623,569	\$	1,659,970	\$	2,097,671	\$	2,302,881
Total Utilities	\$	7,367,384	\$	7,318,151	\$	9,706,302	\$	10,331,797	\$	8,869,650

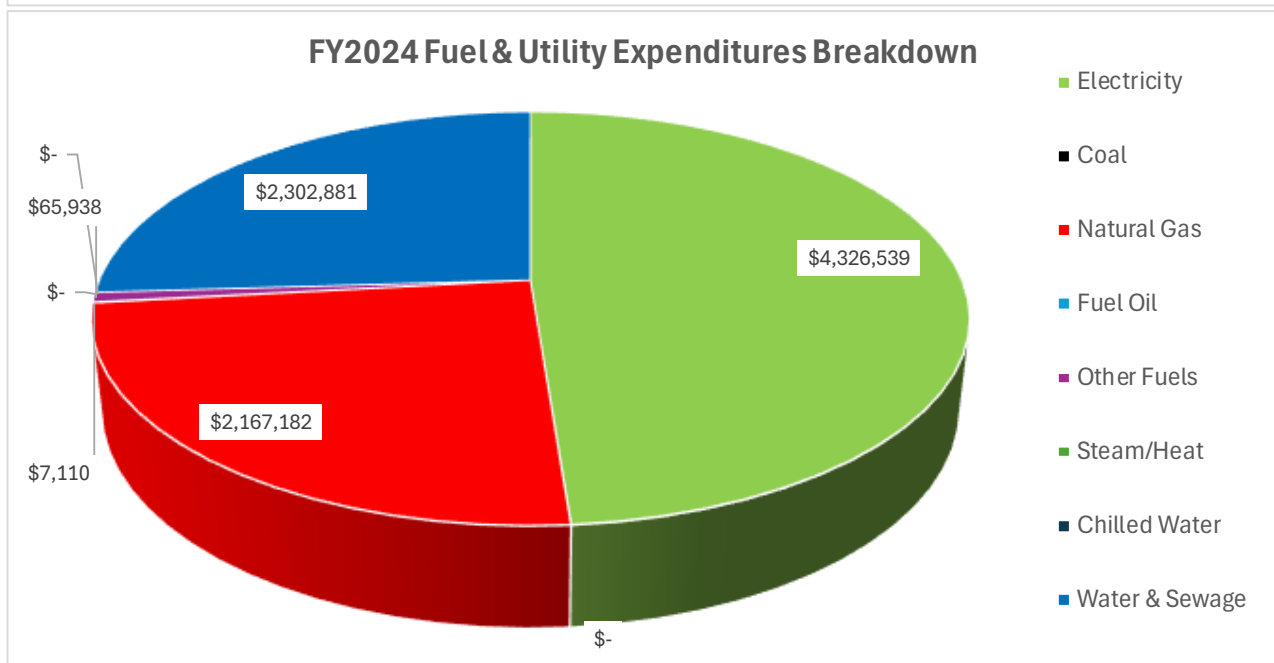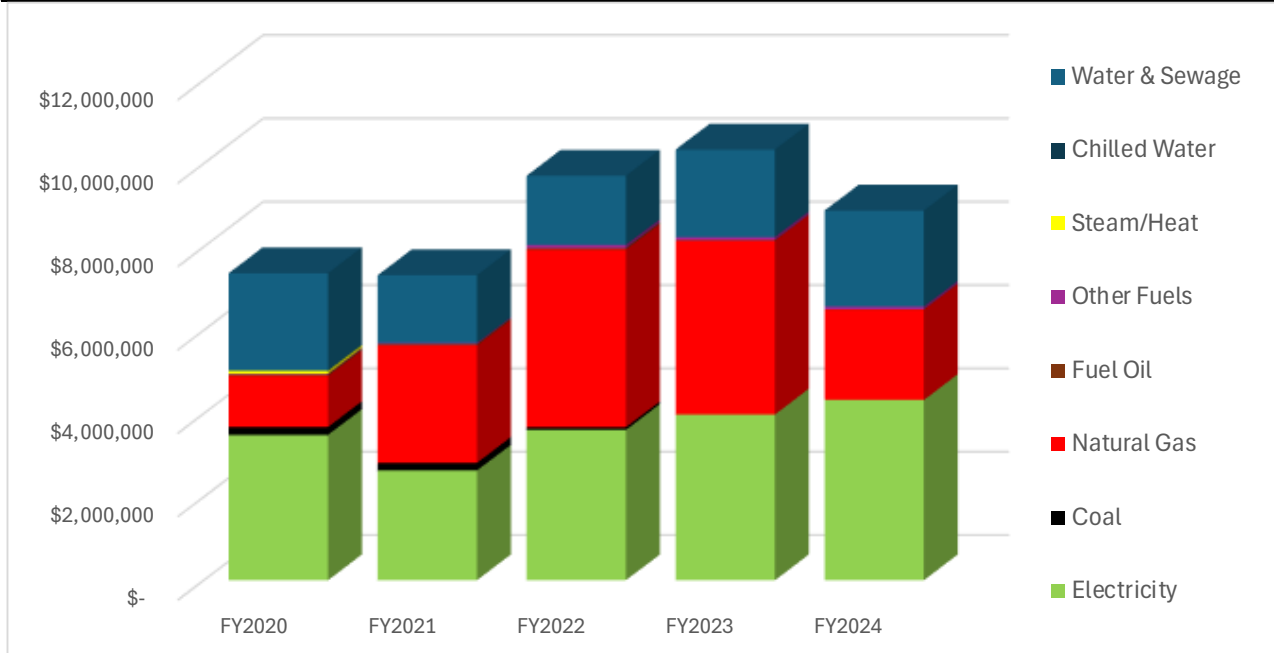

DHS Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	4,247,798	169,215	34,970	204,184	0.0%	47.32	100.0%	100.0%	204,184	0.0%
FY06	4,247,798	162,465	36,013	198,479	-2.8%	48.60	102.0%	98.9%	201,397	-1.4%
FY07	4,247,798	167,295	36,142	203,437	-0.4%	47.47	100.5%	99.5%	204,031	-0.1%
FY08	4,247,798	173,573	37,301	210,874	3.3%	45.80	96.5%	99.1%	204,412	0.1%
FY09	4,099,238	177,474	37,891	215,365	5.5%	45.16	95.6%	99.9%	207,557	1.7%
FY10	4,198,234	161,722	35,845	197,567	-3.2%	47.09	100.0%	100.4%	197,705	-3.2%
FY11	4,198,234	168,916	37,803	206,720	1.2%	46.17	96.6%	98.9%	200,479	-1.8%
FY12	4,088,791	155,669	39,096	194,765	-4.6%	51.02	105.5%	98.6%	202,871	-0.6%
FY13	4,145,773	163,386	37,009	200,396	-1.9%	46.58	97.2%	99.7%	195,676	-4.2%
FY14	4,145,773	166,387	36,777	203,164	-0.5%	43.74	91.8%	98.9%	189,105	-7.4%
FY15	4,159,400	159,109	36,732	195,841	-4.1%	45.26	96.0%	100.4%	189,665	-7.1%
FY16	4,159,400	155,603	37,360	192,962	-5.5%	49.35	103.2%	99.3%	197,709	-3.2%
FY17	4,159,400	147,570	37,742	185,312	-9.2%	49.83	103.4%	98.4%	189,787	-7.1%
FY18	4,159,400	165,404	36,238	201,642	-1.2%	46.64	97.8%	99.2%	197,749	-3.2%
FY19	4,159,400	155,221	35,072	190,294	-6.8%	45.74	96.5%	99.9%	184,863	-9.5%
FY20	4,159,400	143,486	35,152	178,637	-12.5%	47.88	100.9%	99.4%	179,704	-12.0%
FY21	4,159,400	146,783	34,546	181,329	-11.2%	48.27	100.9%	98.2%	182,027	-10.9%
FY22	4,159,400	150,294	34,072	184,366	-9.7%	48.10	100.2%	97.7%	183,887	-9.9%
FY23	4,159,400	139,676	32,227	171,903	-15.8%	48.69	102.1%	99.0%	174,495	-14.5%
FY24	4,159,400	131,105	32,415	163,520	-19.9%	51.09	105.7%	98.6%	170,580	-16.5%

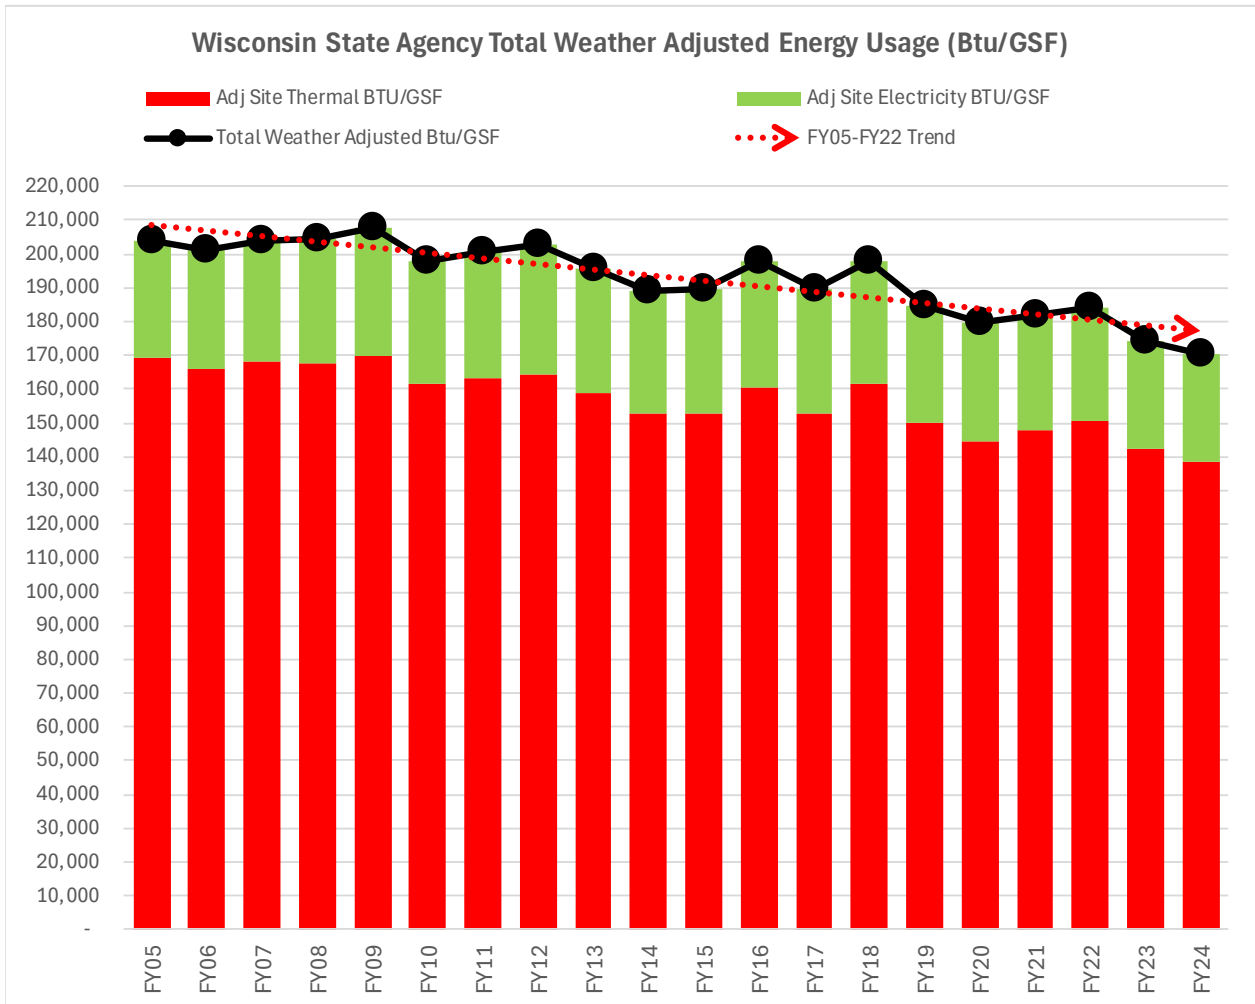

DHS Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 9.50			FY24 Therm/GSF = 1.31			FY24 Total Btu/GSF = 163,520			05-24 Thm -18.1%	
FY24 Electric \$/GSF = \$ 0.98			FY24 Thermal \$/GSF = \$ 0.51			FY24 Energy \$/GSF = \$ 1.49			05-24 kwh -8.6%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	4,247,798	169,215	34,970	204,184	0.0%	47.32	100.0%	100.0%	204,184	0.0%
FY06	4,247,798	162,465	36,013	198,479	-2.8%	48.60	102.0%	98.9%	201,397	-1.4%
FY07	4,247,798	167,295	36,142	203,437	-0.4%	47.47	100.5%	99.5%	204,031	-0.1%
FY08	4,247,798	173,573	37,301	210,874	3.3%	45.80	96.5%	99.1%	204,412	0.1%
FY09	4,099,238	177,474	37,891	215,365	5.5%	45.16	95.6%	99.9%	207,557	1.7%
FY10	4,198,234	161,722	35,845	197,567	-3.2%	47.09	100.0%	100.4%	197,705	-3.2%
FY11	4,198,234	168,916	37,803	206,720	1.2%	46.17	96.6%	98.9%	200,479	-1.8%
FY12	4,088,791	155,669	39,096	194,765	-4.6%	51.02	105.5%	98.6%	202,871	-0.6%
FY13	4,145,773	163,386	37,009	200,396	-1.9%	46.58	97.2%	99.7%	195,676	-4.2%
FY14	4,145,773	166,387	36,777	203,164	-0.5%	43.74	91.8%	98.9%	189,105	-7.4%
FY15	4,159,400	159,109	36,732	195,841	-4.1%	45.26	96.0%	100.4%	189,665	-7.1%
FY16	4,159,400	155,603	37,360	192,962	-5.5%	49.35	103.2%	99.3%	197,709	-3.2%
FY17	4,159,400	147,570	37,742	185,312	-9.2%	49.83	103.4%	98.4%	189,787	-7.1%
FY18	4,159,400	165,404	36,238	201,642	-1.2%	46.64	97.8%	99.2%	197,749	-3.2%
FY19	4,159,400	155,221	35,072	190,294	-6.8%	45.74	96.5%	99.9%	184,863	-9.5%
FY20	4,159,400	143,486	35,152	178,637	-12.5%	47.88	100.9%	99.4%	179,704	-12.0%
FY21	4,159,400	146,783	34,546	181,329	-11.2%	48.27	100.9%	98.2%	182,027	-10.9%
FY22	4,159,400	150,294	34,072	184,366	-9.7%	48.10	100.2%	97.7%	183,887	-9.9%
FY23	4,159,400	139,676	32,227	171,903	-15.8%	48.69	102.1%	99.0%	174,495	-14.5%
FY24	4,159,400	131,105	32,415	163,520	-19.9%	51.09	105.7%	98.6%	170,580	-16.5%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

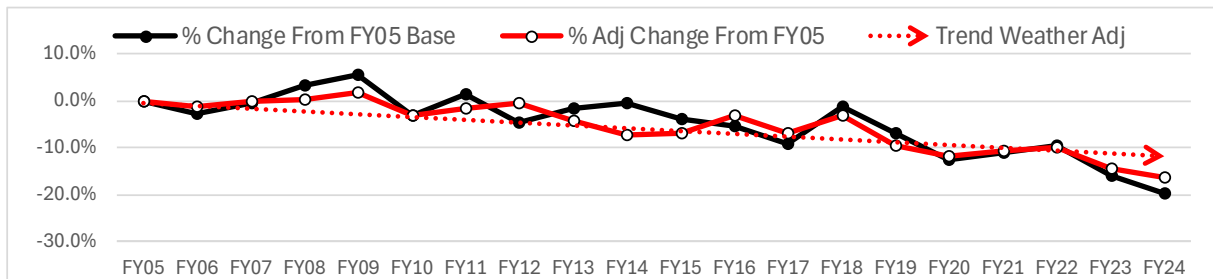

FY2024 DHS-Mendota State Facilities Energy Report

FY24 Electric kwh/GSF= 8.65			FY24 Therm/GSF = 1.90			FY24 Total Btu/GSF= 219,238			05-24 Thm -19.6%	
FY24 Electric \$/GSF= \$ 1.08			FY24 Thermal \$/GSF= \$ 0.71			FY24 Energy \$/GSF= \$ 1.79			05-24 kwh -18.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,313,997	237,977	35,861	273,839	0.0%	48.12	100.0%	100.0%	273,839	0.0%
FY06	1,313,997	236,207	38,330	274,537	0.3%	48.65	99.7%	99.2%	273,463	-0.1%
FY07	1,313,997	242,071	37,144	279,215	2.0%	47.46	98.8%	99.8%	276,333	0.9%
FY08	1,313,997	255,709	37,895	293,604	7.2%	46.19	96.3%	99.4%	283,812	3.6%
FY09	1,313,997	248,507	36,513	285,020	4.1%	45.66	96.5%	100.1%	276,365	0.9%
FY10	1,313,997	231,683	32,812	264,495	-3.4%	47.10	99.1%	100.6%	262,640	-4.1%
FY11	1,313,997	240,209	37,268	277,477	1.3%	46.81	96.8%	99.1%	269,502	-1.6%
FY12	1,313,997	225,823	37,359	263,182	-3.9%	51.51	102.5%	98.6%	268,354	-2.0%
FY13	1,313,997	230,260	35,982	266,242	-2.8%	47.29	97.2%	100.2%	259,890	-5.1%
FY14	1,313,997	234,125	36,625	270,750	-1.1%	44.58	93.5%	99.0%	255,059	-6.9%
FY15	1,320,211	231,774	36,852	268,627	-1.9%	45.84	96.9%	100.1%	261,477	-4.5%
FY16	1,320,211	244,583	37,478	282,062	3.0%	49.68	100.8%	99.7%	283,960	3.7%
FY17	1,320,211	221,327	37,462	258,789	-5.5%	49.72	99.4%	99.7%	257,389	-6.0%
FY18	1,320,211	264,205	34,869	299,074	9.2%	46.66	97.4%	99.8%	292,172	6.7%
FY19	1,320,211	224,992	32,418	257,410	-6.0%	45.87	96.3%	100.8%	249,275	-9.0%
FY20	1,320,211	201,745	31,743	233,488	-14.7%	48.08	99.9%	99.6%	233,088	-14.9%
FY21	1,320,211	215,248	30,420	245,668	-10.3%	47.61	97.9%	99.7%	241,056	-12.0%
FY22	1,320,211	222,584	30,957	253,541	-7.4%	48.04	98.1%	99.2%	249,157	-9.0%
FY23	1,320,211	198,503	29,258	227,761	-16.8%	48.63	100.7%	99.7%	228,967	-16.4%
FY24	1,320,211	189,731	29,507	219,238	-19.9%	50.95	100.8%	99.6%	220,741	-19.4%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

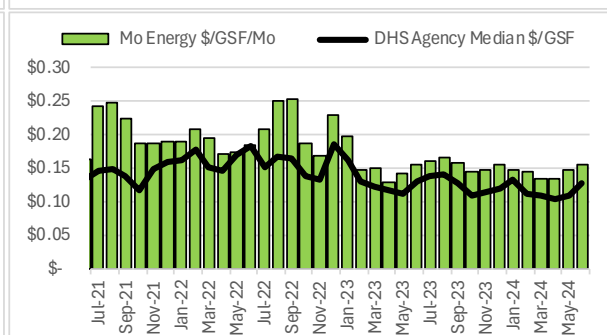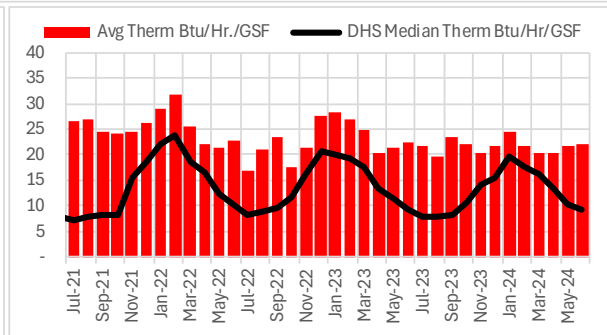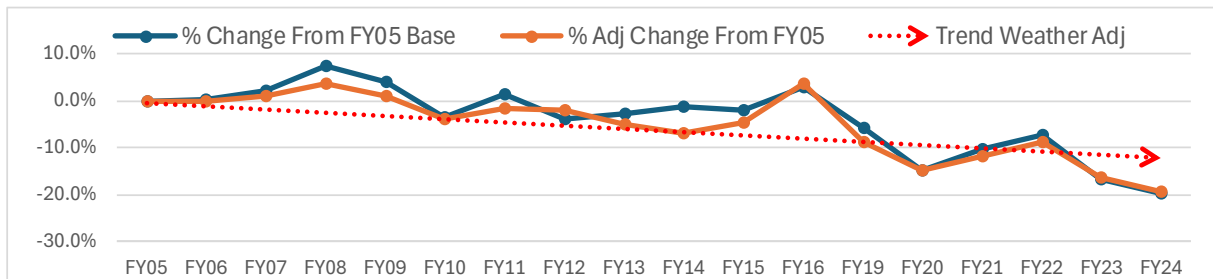

FY2024 DHS-Northern Center State Facilities Energy Report

FY24 Electric kwh/GSF= 9.44			FY24 Therm/GSF = 1.14			FY24 Total Btu/GSF= 146,010			05-24 Thm -13.6%	
FY24 Electric \$/GSF= \$ 0.90			FY24 Thermal \$/GSF= \$ 0.53			FY24 Energy \$/GSF= \$ 1.43			05-24 kwh 8.6%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	792,392	140,342	29,596	169,938	0.0%	45.85	100.0%	100.0%	169,938	0.0%
FY06	792,392	125,767	26,128	151,895	-10.6%	47.80	104.1%	98.1%	156,570	-7.9%
FY07	792,392	116,598	23,016	139,614	-17.8%	46.32	101.6%	98.9%	141,189	-16.9%
FY08	792,392	118,343	23,497	141,840	-16.5%	43.27	95.8%	99.2%	136,627	-19.6%
FY09	632,669	145,198	27,642	172,840	1.7%	42.97	94.5%	100.3%	164,944	-2.9%
FY10	632,669	135,595	27,797	163,393	-3.9%	45.29	99.3%	100.5%	162,540	-4.4%
FY11	632,669	137,811	26,675	164,486	-3.2%	43.68	93.9%	99.4%	155,933	-8.2%
FY12	523,226	141,377	33,800	175,176	3.1%	49.02	105.8%	99.1%	183,005	7.7%
FY13	523,226	142,405	33,212	175,617	3.3%	43.85	95.0%	100.5%	168,592	-0.8%
FY14	523,226	147,899	32,472	180,371	6.1%	41.37	89.8%	99.3%	165,070	-2.9%
FY15	523,226	132,461	32,892	165,353	-2.7%	43.42	95.0%	100.4%	158,932	-6.5%
FY16	523,226	116,617	32,861	149,478	-12.0%	47.61	103.9%	99.5%	153,836	-9.5%
FY17	523,226	117,850	31,901	149,751	-11.9%	47.07	102.1%	99.0%	151,920	-10.6%
FY18	523,226	121,382	31,467	152,849	-10.1%	43.54	95.6%	99.5%	147,358	-13.3%
FY19	523,226	123,130	31,647	154,778	-8.9%	42.23	93.8%	101.1%	147,536	-13.2%
FY20	523,226	103,341	31,579	134,920	-20.6%	45.42	99.4%	99.9%	134,293	-21.0%
FY21	523,226	109,783	31,403	141,186	-16.9%	46.01	100.1%	98.7%	140,864	-17.1%
FY22	523,226	116,030	31,147	147,177	-13.4%	44.82	98.6%	98.8%	145,125	-14.6%
FY23	523,226	129,403	32,317	161,720	-4.8%	45.82	99.7%	99.1%	160,997	-5.3%
FY24	523,226	113,807	32,202	146,010	-14.1%	49.00	106.5%	99.8%	153,378	-9.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

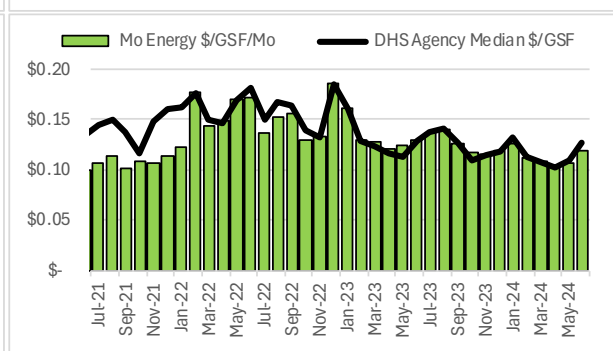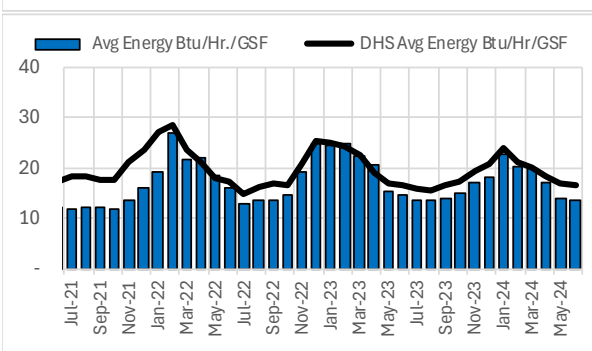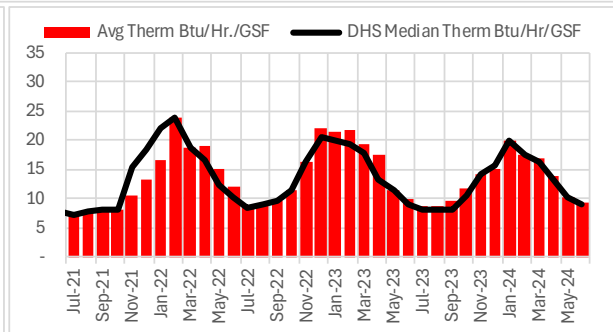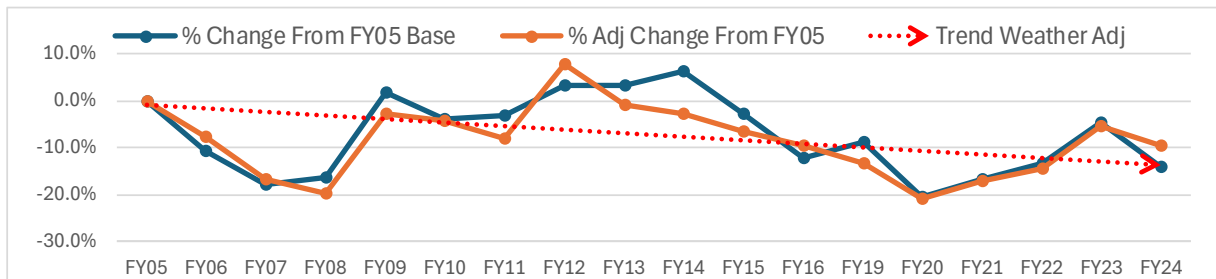

FY2024 DHS-Sand Ridge State Facilities Energy Report

FY24 Electric kwh/GSF= 14.34			FY24 Therm/GSF = 0.84			FY24 Total Btu/GSF= 133,205		05-24 Thm -10.0%		
FY24 Electric \$/GSF= \$ 1.27			FY24 Thermal \$/GSF= \$ 0.36			FY24 Energy \$/GSF= \$ 1.63		05-24 kwh -6.3%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	198,669	102,791	52,262	155,053	0.0%	48.43	100.0%	100.0%	155,053	0.0%
FY06	198,669	89,314	53,296	142,610	-8.0%	49.77	102.5%	99.9%	144,785	-6.6%
FY07	198,669	97,073	54,087	151,160	-2.5%	48.68	99.5%	99.4%	150,290	-3.1%
FY08	198,669	101,388	55,392	156,780	1.1%	46.15	90.9%	98.8%	146,902	-5.3%
FY09	209,832	124,824	60,174	184,998	19.3%	45.86	91.7%	99.5%	174,315	12.4%
FY10	308,828	87,515	42,823	130,338	-15.9%	47.43	97.1%	99.7%	127,650	-17.7%
FY11	308,828	93,215	45,947	139,163	-10.2%	46.70	93.2%	98.8%	132,285	-14.7%
FY12	308,828	71,292	47,554	118,846	-23.4%	51.77	107.3%	100.3%	124,235	-19.9%
FY13	308,828	87,051	45,928	132,979	-14.2%	46.71	94.0%	99.7%	127,567	-17.7%
FY14	308,828	96,944	47,473	144,417	-6.9%	44.97	88.8%	97.3%	132,216	-14.7%
FY15	308,828	95,635	48,863	144,499	-6.8%	47.28	96.4%	99.7%	140,921	-9.1%
FY16	308,828	83,536	48,828	132,365	-14.6%	51.01	108.4%	99.3%	139,065	-10.3%
FY17	308,828	74,372	49,474	123,846	-20.1%	51.62	109.3%	98.9%	130,186	-16.0%
FY18	308,828	90,990	49,405	140,395	-9.5%	48.61	97.3%	98.3%	137,102	-11.6%
FY19	308,828	92,423	49,045	141,468	-8.8%	46.76	94.9%	98.7%	136,136	-12.2%
FY20	308,828	95,707	51,608	147,315	-5.0%	49.35	101.8%	99.1%	148,546	-4.2%
FY21	308,828	87,225	48,509	135,733	-12.5%	49.59	102.7%	97.3%	136,783	-11.8%
FY22	308,828	100,729	46,718	147,448	-4.9%	48.90	101.0%	97.3%	147,223	-5.0%
FY23	308,828	89,612	48,580	138,192	-10.9%	49.35	102.0%	98.6%	139,294	-10.2%
FY24	308,828	84,259	48,946	133,205	-14.1%	52.02	109.8%	100.1%	141,497	-8.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

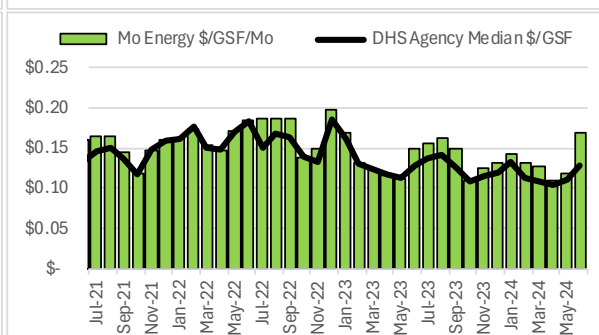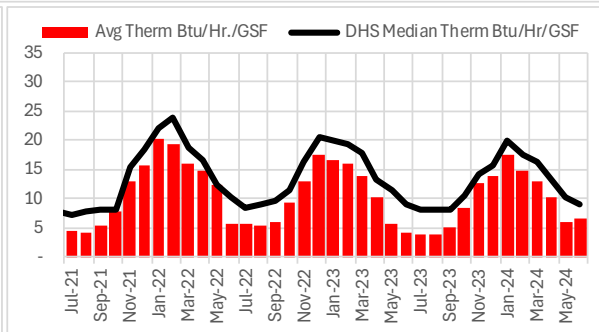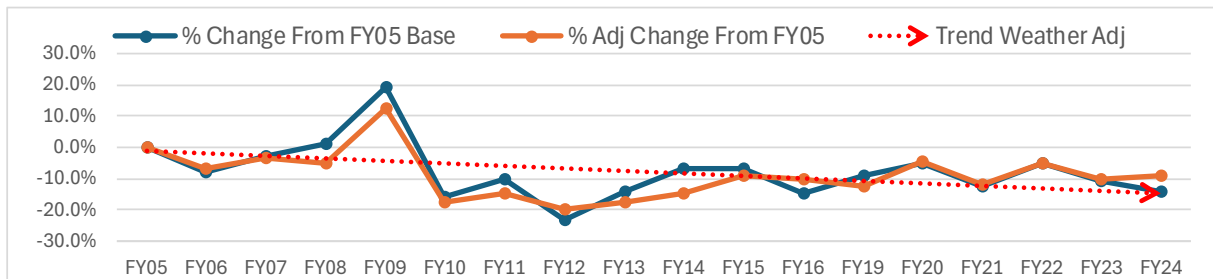

FY2024 DHS-Southern Center State Facilities Energy Report

FY24 Electric kwh/GSF= 8.89			FY24 Therm/GSF = 1.07			FY24 Total Btu/GSF= 137,413			05-24 Thm -18.0%	
FY24 Electric \$/GSF= \$ 0.94			FY24 Thermal \$/GSF= \$ 0.40			FY24 Energy \$/GSF= \$ 1.34			05-24 kwh -16.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	1,023,235	142,723	34,662	177,385	0.0%	48.47	100.0%	100.0%	177,385	0.0%
FY06	1,023,235	135,306	36,395	171,701	-3.2%	50.11	104.2%	98.3%	176,792	-0.3%
FY07	1,023,235	149,554	40,525	190,080	7.2%	48.88	101.3%	99.1%	191,624	8.0%
FY08	1,023,235	159,251	43,608	202,859	14.4%	47.87	97.5%	98.6%	198,361	11.8%
FY09	1,023,235	158,024	42,358	200,382	13.0%	47.26	97.1%	99.3%	195,565	10.2%
FY10	1,023,235	146,831	41,183	188,014	6.0%	49.10	101.7%	99.7%	190,336	7.3%
FY11	1,023,235	149,154	42,047	191,202	7.8%	48.17	98.4%	97.9%	187,924	5.9%
FY12	1,023,235	132,494	39,930	172,424	-2.8%	52.24	107.9%	97.7%	181,984	2.6%
FY13	1,023,235	154,828	38,549	193,377	9.0%	48.26	98.9%	99.0%	191,323	7.9%
FY14	1,023,235	152,116	37,854	189,969	7.1%	45.20	92.1%	99.6%	177,781	0.2%
FY15	1,023,235	147,440	37,606	185,046	4.3%	46.08	95.2%	101.1%	178,379	0.6%
FY16	1,023,235	139,236	38,534	177,771	0.2%	50.51	104.6%	98.8%	183,667	3.5%
FY17	1,023,235	136,747	40,003	176,750	-0.4%	51.99	107.0%	96.3%	184,897	4.2%
FY18	1,023,235	144,120	38,692	182,812	3.1%	48.79	100.2%	98.6%	182,600	2.9%
FY19	1,023,235	148,453	38,073	186,526	5.2%	47.88	98.4%	99.0%	183,757	3.6%
FY20	1,023,235	141,818	37,972	179,790	1.4%	49.85	103.2%	98.7%	183,785	3.6%
FY21	1,023,235	135,257	37,582	172,840	-2.6%	50.84	105.0%	96.8%	178,436	0.6%
FY22	1,023,235	131,234	35,917	167,151	-5.8%	50.91	104.2%	95.9%	171,114	-3.5%
FY23	1,023,235	117,162	29,376	146,538	-17.4%	51.08	104.5%	98.0%	151,177	-14.8%
FY24	1,023,235	107,074	30,339	137,413	-22.5%	53.15	109.3%	95.6%	146,075	-17.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

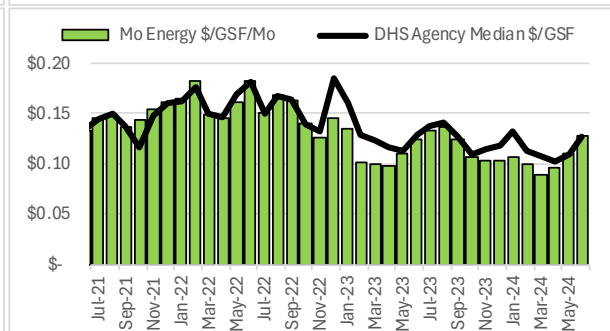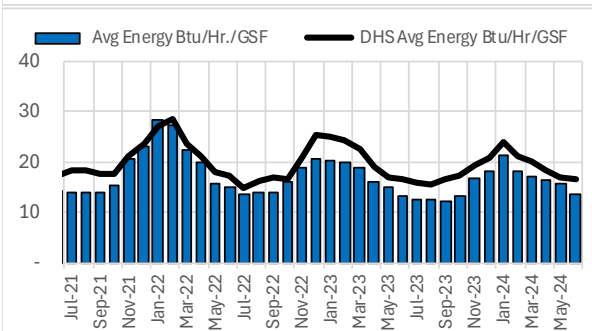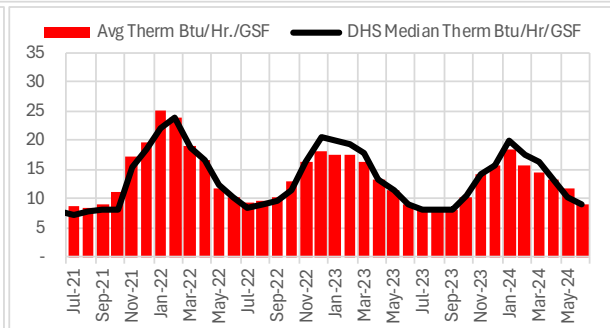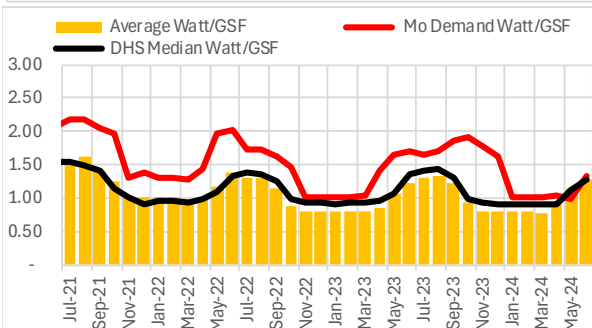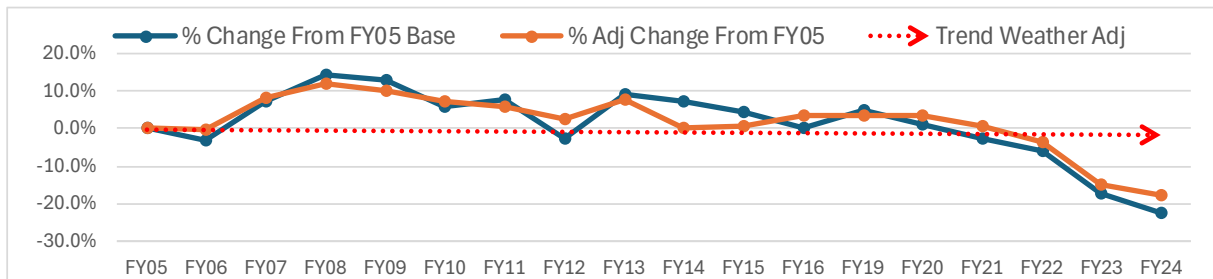

FY2024 DHS-Winnebago State Facilities Energy Report

FY24 Electric kwh/GSF= 9.79			FY24 Therm/GSF = 1.01			FY24 Total Btu/GSF= 134,735		05-24 Thm -18.4%		
FY24 Electric \$/GSF= \$ 0.85			FY24 Thermal \$/GSF= \$ 0.38			FY24 Energy \$/GSF= \$ 1.23		05-24 kwh -5.3%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	919,505	139,664	34,932	174,596	0.0%	45.94	100.0%	100.0%	174,596	0.0%
FY06	919,505	134,739	37,064	171,803	-1.6%	47.26	103.8%	99.3%	176,655	1.2%
FY07	919,505	139,043	37,265	176,308	1.0%	46.64	102.9%	99.8%	180,281	3.3%
FY08	919,505	135,325	37,423	172,748	-1.1%	45.02	97.1%	99.3%	168,520	-3.5%
FY09	919,505	131,834	36,855	168,689	-3.4%	43.47	93.0%	100.2%	159,482	-8.7%
FY10	919,505	121,216	37,434	158,650	-9.1%	45.98	101.5%	101.0%	160,837	-7.9%
FY11	919,505	135,856	38,766	174,622	0.0%	44.58	96.3%	99.6%	169,367	-3.0%
FY12	919,505	117,679	40,821	158,500	-9.2%	49.86	110.4%	98.9%	170,252	-2.5%
FY13	976,487	117,750	35,992	153,742	-11.9%	45.29	96.9%	99.6%	149,879	-14.2%
FY14	976,487	122,059	34,777	156,837	-10.2%	41.95	89.2%	98.4%	143,092	-18.0%
FY15	983,900	107,836	33,896	141,732	-18.8%	43.98	95.2%	100.4%	136,687	-21.7%
FY16	983,900	96,580	34,771	131,351	-24.8%	48.11	107.4%	99.4%	138,317	-20.8%
FY17	983,900	98,638	35,189	133,827	-23.4%	48.65	109.8%	98.5%	143,006	-18.1%
FY18	983,900	101,736	33,926	135,662	-22.3%	45.41	97.2%	99.6%	132,641	-24.0%
FY19	983,900	105,418	32,949	138,366	-20.8%	44.90	96.7%	99.6%	134,728	-22.8%
FY20	983,900	103,393	33,526	136,918	-21.6%	46.40	100.9%	99.9%	137,755	-21.1%
FY21	983,900	105,273	34,213	139,485	-20.1%	47.28	103.6%	98.1%	142,648	-18.3%
FY22	983,900	106,895	33,919	140,814	-19.3%	46.76	101.6%	97.5%	141,712	-18.8%
FY23	983,900	105,335	33,994	139,329	-20.2%	47.58	104.6%	99.2%	143,882	-17.6%
FY24	983,900	101,336	33,399	134,735	-22.8%	49.93	112.4%	99.1%	147,035	-15.8%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

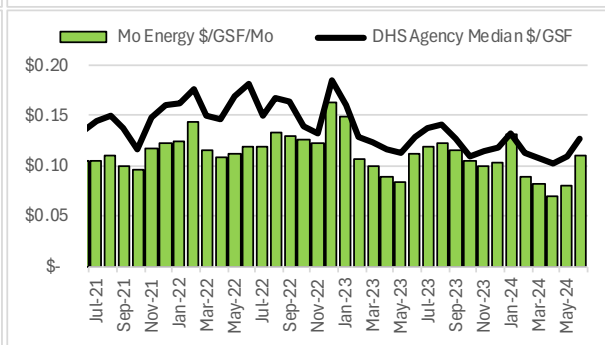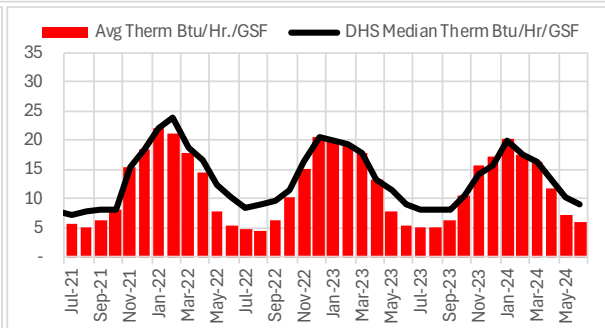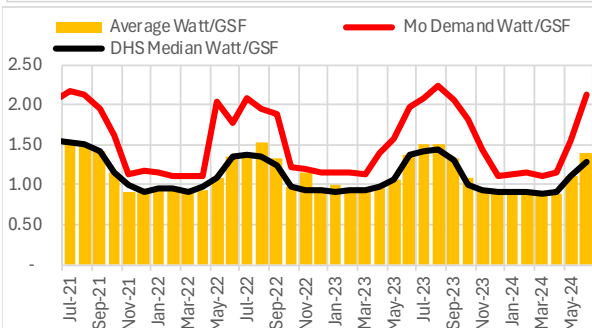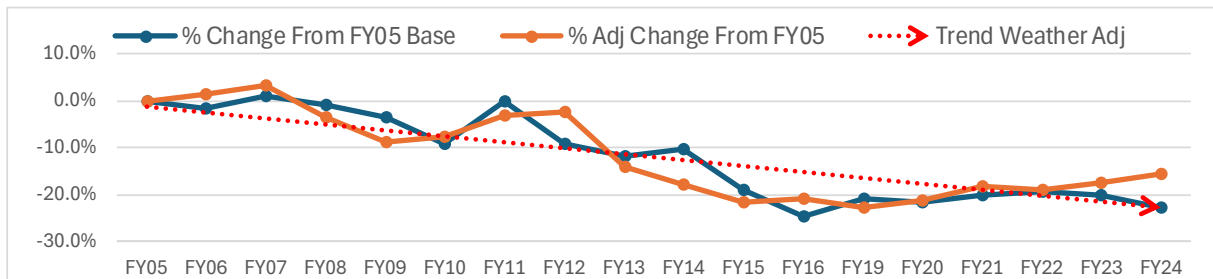

Agency Energy Use Summary

Department of Public Instruction



SCOPE

Includes the Wisconsin School for the Deaf (Delavan) and the Wisconsin School for the Blind and Visually Impaired (Janesville).

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 7 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 3.8 percent decrease

Energy use (BTU/GSF/Yr) for FY24 decrease 3.8 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 0.4 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 0.4 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: 0 percent increase.



Gross square footage (GSF) has not changed from the base fiscal year, FY05.

Consumption Change from Base: 11.5 percent decrease.

Total consumption was 11.5 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 2.4 percent less than in the base year when adjusted for weather compared to FY05.


Public Instruction, Department of

Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024	
Electricity	\$	158,139	\$	147,799	\$	201,195	\$	270,335	\$	272,264
Coal	\$	-	\$	-	\$	-	\$	-	\$	-
Natural Gas	\$	38,034	\$	188,764	\$	207,844	\$	236,970	\$	143,075
Fuel Oil	\$	-	\$	-	\$	-	\$	-	\$	-
Other Fuels	\$	-	\$	-	\$	-	\$	-	\$	-
Steam/Heat	\$	-	\$	-	\$	-	\$	-	\$	-
Chilled Water	\$	-	\$	-	\$	-	\$	-	\$	-
Water & Sewage	\$	66,287	\$	41,728	\$	68,400	\$	72,731	\$	81,756
Total Utilities	\$	262,459	\$	378,291	\$	477,439	\$	580,036	\$	497,095

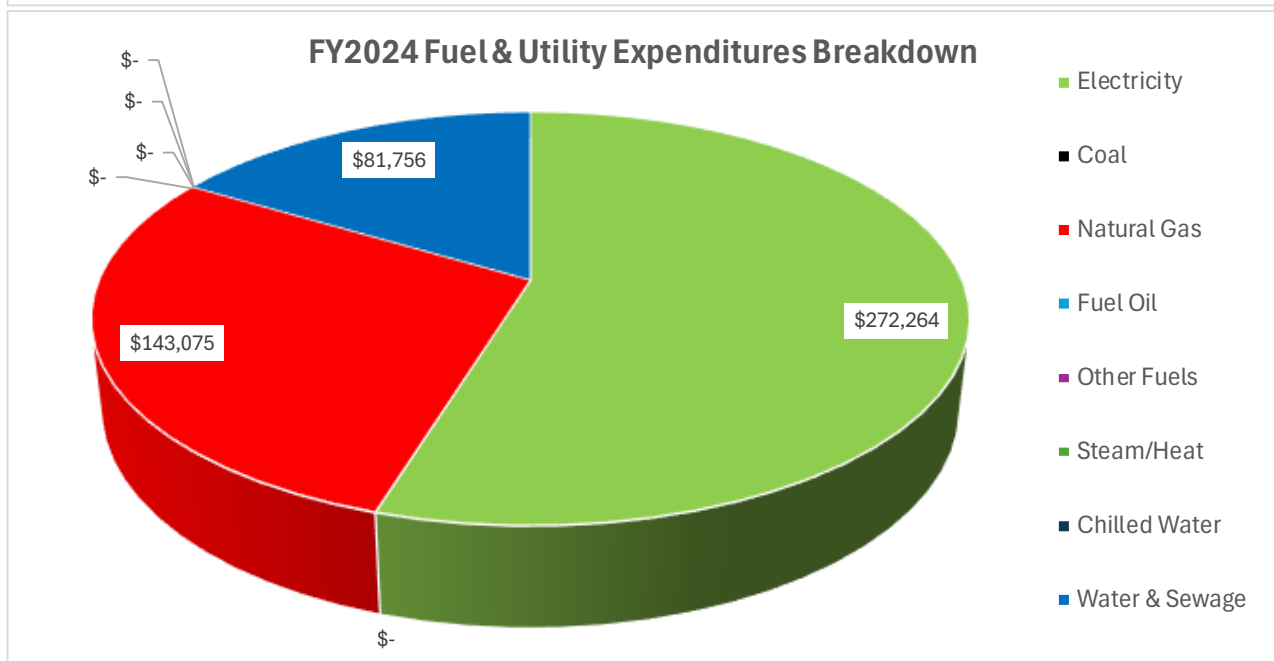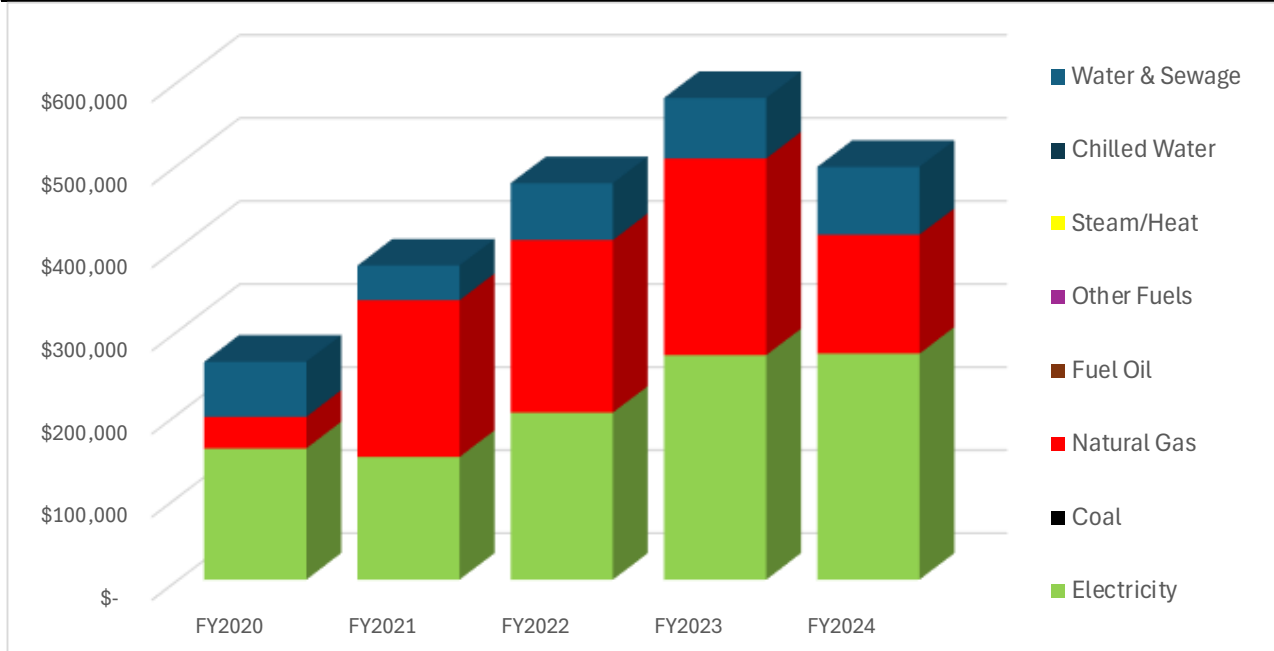

DPI Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	441,183	74,517	23,484	98,001	0.0%	48.12	100.0%	100.0%	98,001	0.0%
FY06	441,183	70,542	24,293	94,835	-3.2%	48.65	97.8%	99.0%	93,039	-5.1%
FY07	441,183	73,983	22,893	96,876	-1.1%	47.46	94.9%	99.5%	93,030	-5.1%
FY08	441,183	78,081	22,496	100,578	2.6%	46.19	85.8%	98.0%	89,049	-9.1%
FY09	441,183	80,109	21,788	101,897	4.0%	45.66	86.9%	99.3%	91,222	-6.9%
FY10	441,183	71,838	21,292	93,130	-5.0%	47.10	95.3%	100.3%	89,831	-8.3%
FY11	441,183	75,226	22,980	98,206	0.2%	46.81	89.9%	98.3%	90,223	-7.9%
FY12	441,183	65,293	22,746	88,039	-10.2%	51.51	109.6%	98.4%	93,980	-4.1%
FY13	441,183	85,243	23,015	108,258	10.5%	47.29	93.3%	99.2%	102,357	4.4%
FY14	441,183	89,901	21,379	111,281	13.6%	44.58	84.0%	99.8%	96,833	-1.2%
FY15	441,183	86,814	20,152	106,966	9.1%	45.84	89.4%	100.0%	97,760	-0.2%
FY16	441,183	72,932	20,276	93,209	-4.9%	49.68	105.9%	99.4%	97,372	-0.6%
FY17	441,183	71,518	20,328	91,847	-6.3%	49.72	106.4%	98.7%	96,132	-1.9%
FY18	441,183	82,097	20,116	102,213	4.3%	46.66	88.6%	99.2%	92,709	-5.4%
FY19	441,183	85,292	15,408	100,700	2.8%	45.87	89.0%	100.2%	91,372	-6.8%
FY20	441,183	75,214	16,595	91,809	-6.3%	48.08	96.7%	99.3%	89,234	-8.9%
FY21	441,183	66,229	14,259	80,488	-17.9%	47.61	94.7%	97.7%	76,675	-21.8%
FY22	441,183	72,940	17,485	90,425	-7.7%	48.04	92.8%	98.0%	84,795	-13.5%
FY23	441,183	76,405	17,800	94,206	-3.9%	48.63	100.7%	100.1%	94,727	-3.3%
FY24	441,183	66,221	17,855	84,076	-14.2%	50.95	110.4%	100.9%	91,147	-7.0%

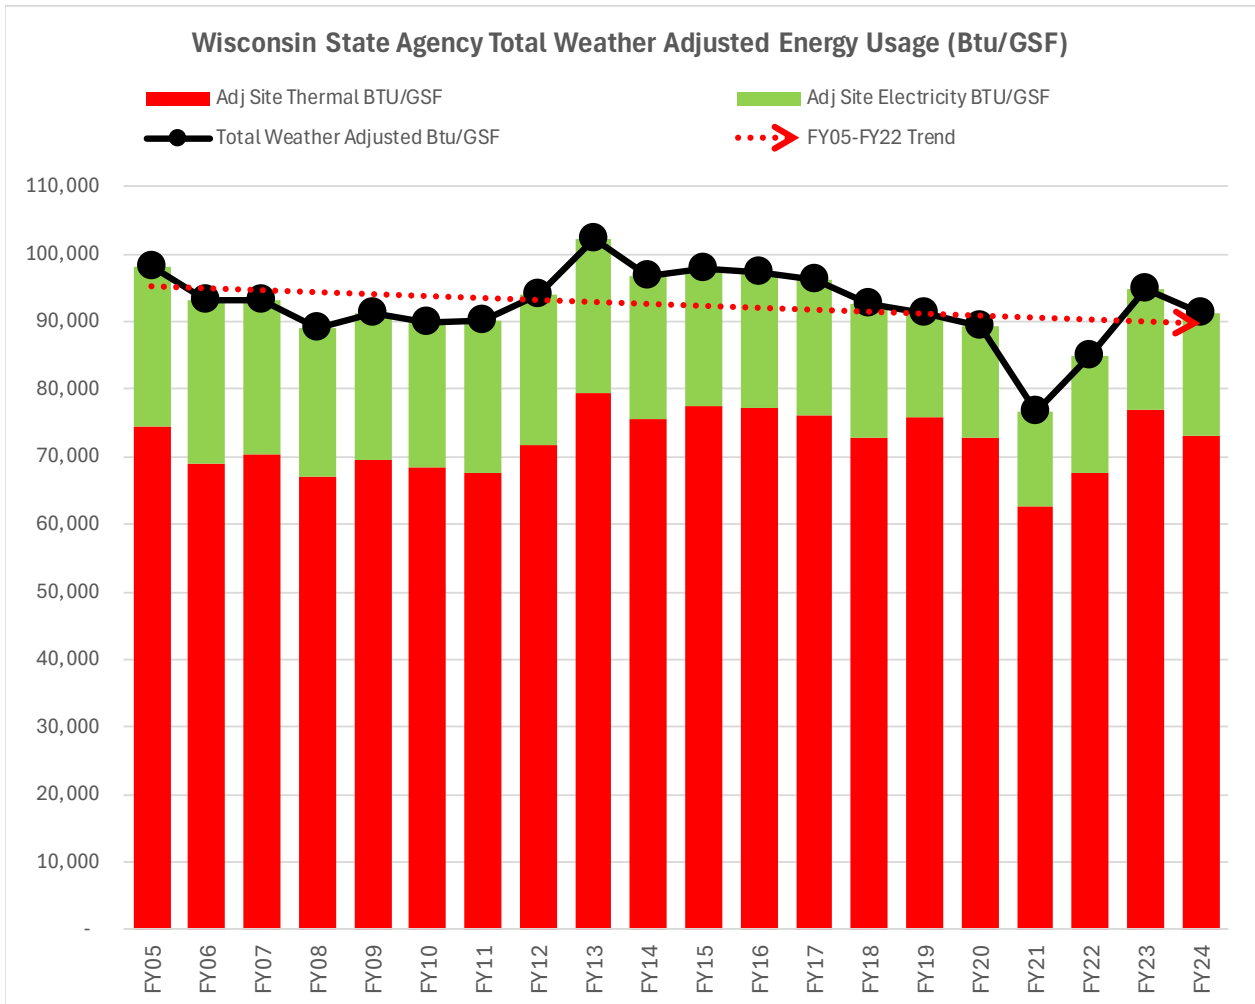

DPI Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 5.23			FY24 Therm/GSF = 0.66			FY24 Total Btu/GSF = 84,076			05-24 Thm -1.9%	
FY24 Electric \$/GSF = \$ 0.62			FY24 Thermal \$/GSF = \$ 0.27			FY24 Energy \$/GSF = \$ 0.89			05-24 kwh -23.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	441,183	74,517	23,484	98,001	0.0%	48.12	100.0%	100.0%	98,001	0.0%
FY06	441,183	70,542	24,293	94,835	-3.2%	48.65	97.8%	99.0%	93,039	-5.1%
FY07	441,183	73,983	22,893	96,876	-1.1%	47.46	94.9%	99.5%	93,030	-5.1%
FY08	441,183	78,081	22,496	100,578	2.6%	46.19	85.8%	98.0%	89,049	-9.1%
FY09	441,183	80,109	21,788	101,897	4.0%	45.66	86.9%	99.3%	91,222	-6.9%
FY10	441,183	71,838	21,292	93,130	-5.0%	47.10	95.3%	100.3%	89,831	-8.3%
FY11	441,183	75,226	22,980	98,206	0.2%	46.81	89.9%	98.3%	90,223	-7.9%
FY12	441,183	65,293	22,746	88,039	-10.2%	51.51	109.6%	98.4%	93,980	-4.1%
FY13	441,183	85,243	23,015	108,258	10.5%	47.29	93.3%	99.2%	102,357	4.4%
FY14	441,183	89,901	21,379	111,281	13.6%	44.58	84.0%	99.8%	96,833	-1.2%
FY15	441,183	86,814	20,152	106,966	9.1%	45.84	89.4%	100.0%	97,760	-0.2%
FY16	441,183	72,932	20,276	93,209	-4.9%	49.68	105.9%	99.4%	97,372	-0.6%
FY17	441,183	71,518	20,328	91,847	-6.3%	49.72	106.4%	98.7%	96,132	-1.9%
FY18	441,183	82,097	20,116	102,213	4.3%	46.66	88.6%	99.2%	92,709	-5.4%
FY19	441,183	85,292	15,408	100,700	2.8%	45.87	89.0%	100.2%	91,372	-6.8%
FY20	441,183	75,214	16,595	91,809	-6.3%	48.08	96.7%	99.3%	89,234	-8.9%
FY21	441,183	66,229	14,259	80,488	-17.9%	47.61	94.7%	97.7%	76,675	-21.8%
FY22	441,183	72,940	17,485	90,425	-7.7%	48.04	92.8%	98.0%	84,795	-13.5%
FY23	441,183	76,405	17,800	94,206	-3.9%	48.63	100.7%	100.1%	94,727	-3.3%
FY24	441,183	66,221	17,855	84,076	-14.2%	50.95	110.4%	100.9%	91,147	-7.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

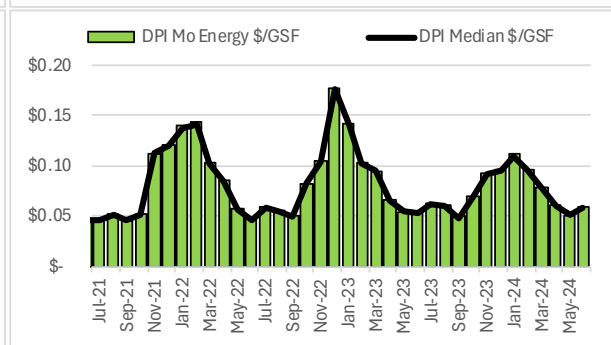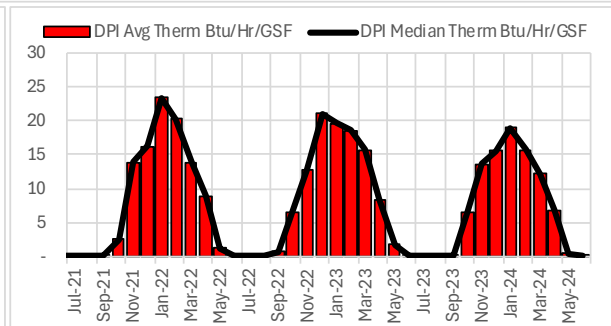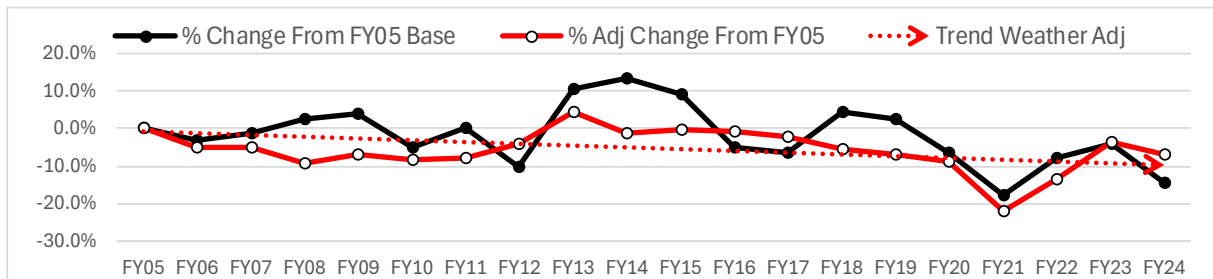

FY2024 DPI-Delavan State Facilities Energy Report

FY24 Electric kwh/GSF= 6.22			FY24 Therm/GSF = 0.68			FY24 Total Btu/GSF= 89,108			05-24 Thm 0.5%	
FY24 Electric \$/GSF= \$ 0.72			FY24 Thermal \$/GSF= \$ 0.27			FY24 Energy \$/GSF= \$ 0.99			05-24 kwh -19.9%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	244,979	74,564	26,898	101,462	0.0%	48.12	100.0%	100.0%	101,462	0.0%
FY06	244,979	70,361	28,819	99,180	-2.2%	48.65	97.2%	98.7%	96,868	-4.5%
FY07	244,979	69,028	27,244	96,272	-5.1%	47.46	95.3%	99.7%	92,952	-8.4%
FY08	244,979	73,870	26,336	100,207	-1.2%	46.19	85.8%	98.1%	89,252	-12.0%
FY09	244,979	77,043	26,286	103,329	1.8%	45.66	87.1%	99.5%	93,259	-8.1%
FY10	244,979	68,681	25,092	93,773	-7.6%	47.10	95.0%	100.2%	90,426	-10.9%
FY11	244,979	71,129	26,863	97,992	-3.4%	46.81	93.1%	99.7%	93,021	-8.3%
FY12	244,979	63,083	27,856	90,939	-10.4%	51.51	110.5%	97.9%	96,986	-4.4%
FY13	244,979	84,382	28,809	113,190	11.6%	47.29	94.6%	99.2%	108,367	6.8%
FY14	244,979	87,340	25,271	112,611	11.0%	44.58	84.0%	100.5%	98,755	-2.7%
FY15	244,979	86,930	23,698	110,628	9.0%	45.84	88.8%	100.3%	100,998	-0.5%
FY16	244,979	71,398	23,945	95,343	-6.0%	49.68	105.8%	99.4%	99,313	-2.1%
FY17	244,979	72,636	23,706	96,342	-5.0%	49.72	106.3%	98.8%	100,651	-0.8%
FY18	244,979	81,231	23,470	104,701	3.2%	46.66	89.0%	99.5%	95,650	-5.7%
FY19	244,979	83,280	16,719	99,999	-1.4%	45.87	88.7%	100.6%	90,714	-10.6%
FY20	244,979	67,516	18,381	85,897	-15.3%	48.08	96.3%	99.3%	83,264	-17.9%
FY21	244,979	63,503	16,494	79,997	-21.2%	47.61	94.1%	97.9%	75,896	-25.2%
FY22	244,979	73,644	21,158	94,802	-6.6%	48.04	91.8%	97.7%	88,264	-13.0%
FY23	244,979	75,064	20,498	95,562	-5.8%	48.63	100.2%	100.3%	95,750	-5.6%
FY24	244,979	67,890	21,218	89,108	-12.2%	50.95	110.4%	101.5%	96,489	-4.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

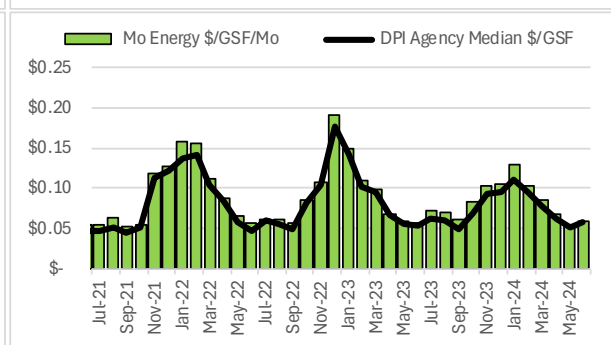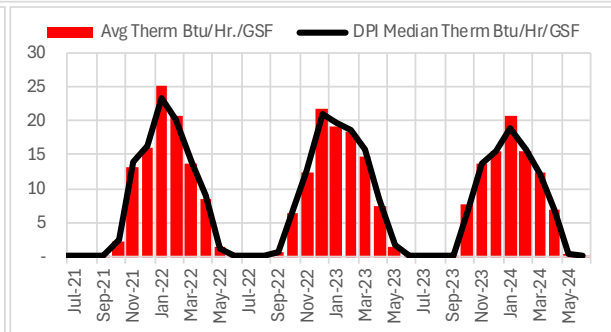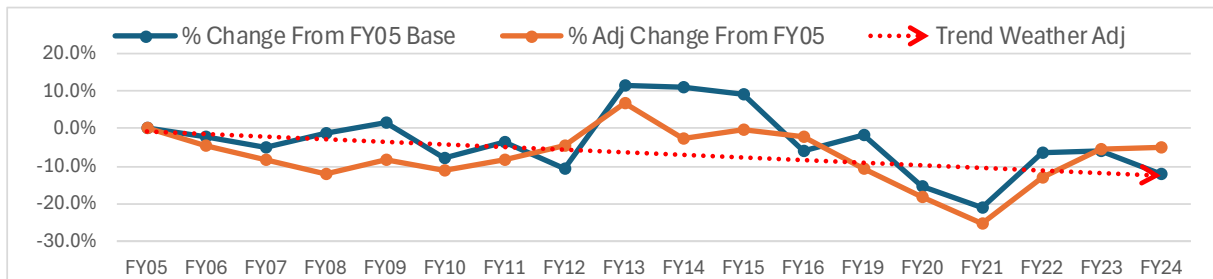

FY2024 DPI-Janesville State Facilities Energy Report

FY24 Electric kwh/GSF= 4.00			FY24 Therm/GSF = 0.64			FY24 Total Btu/GSF= 77,792			05-24 Thm -4.9%	
FY24 Electric \$/GSF= \$ 0.50			FY24 Thermal \$/GSF= \$ 0.27			FY24 Energy \$/GSF= \$ 0.77			05-24 kwh -29.1%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	196,204	74,458	19,222	93,680	0.0%	48.12	100.0%	100.0%	93,680	0.0%
FY06	196,204	70,768	18,642	89,410	-4.6%	48.65	98.5%	99.5%	88,258	-5.8%
FY07	196,204	80,169	17,460	97,630	4.2%	47.46	94.6%	99.2%	93,126	-0.6%
FY08	196,204	83,339	17,702	101,041	7.9%	46.19	85.8%	97.6%	88,794	-5.2%
FY09	196,204	83,937	16,172	100,109	6.9%	45.66	86.6%	98.9%	88,678	-5.3%
FY10	196,204	75,780	16,547	92,327	-1.4%	47.10	95.6%	100.4%	89,088	-4.9%
FY11	196,204	80,341	18,133	98,474	5.1%	46.81	86.3%	95.9%	86,729	-7.4%
FY12	196,204	68,052	16,366	84,418	-9.9%	51.51	108.7%	99.5%	90,227	-3.7%
FY13	196,204	86,319	15,780	102,099	9.0%	47.29	91.8%	99.1%	94,854	1.3%
FY14	196,204	93,100	16,520	109,620	17.0%	44.58	84.0%	98.4%	94,434	0.8%
FY15	196,204	86,668	15,725	102,393	9.3%	45.84	90.1%	99.4%	93,718	0.0%
FY16	196,204	74,848	15,696	90,544	-3.3%	49.68	106.0%	99.5%	94,949	1.4%
FY17	196,204	70,122	16,111	86,234	-7.9%	49.72	106.4%	98.7%	90,489	-3.4%
FY18	196,204	83,178	15,928	99,106	5.8%	46.66	88.2%	98.7%	89,036	-5.0%
FY19	196,204	87,804	13,771	101,575	8.4%	45.87	89.4%	99.6%	92,193	-1.6%
FY20	196,204	84,825	14,366	99,191	5.9%	48.08	97.2%	99.3%	96,688	3.2%
FY21	196,204	69,632	11,468	81,100	-13.4%	47.61	95.5%	97.3%	77,648	-17.1%
FY22	196,204	72,061	12,899	84,960	-9.3%	48.04	94.0%	98.7%	80,463	-14.1%
FY23	196,204	78,080	14,432	92,512	-1.2%	48.63	101.3%	99.7%	93,449	-0.2%
FY24	196,204	64,136	13,656	77,792	-17.0%	50.95	110.5%	99.8%	84,476	-9.8%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

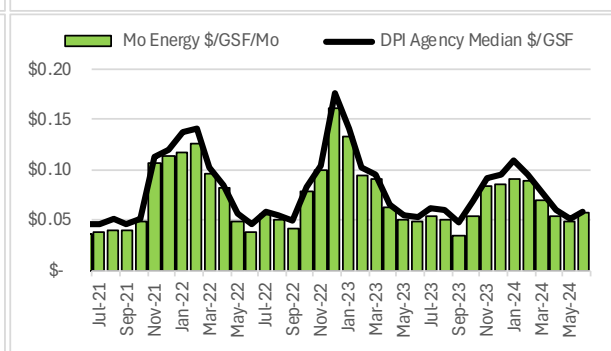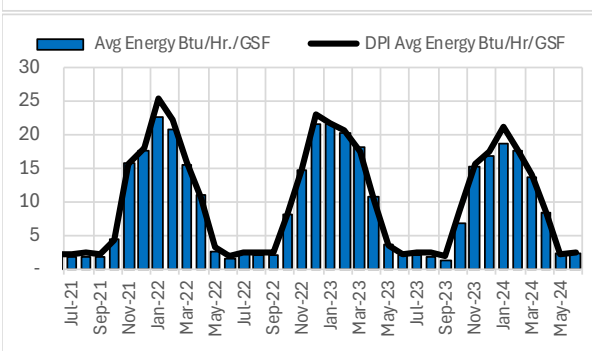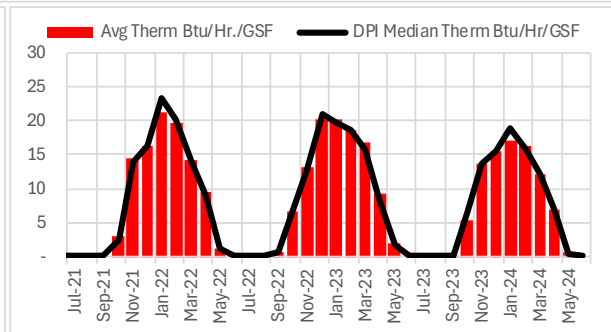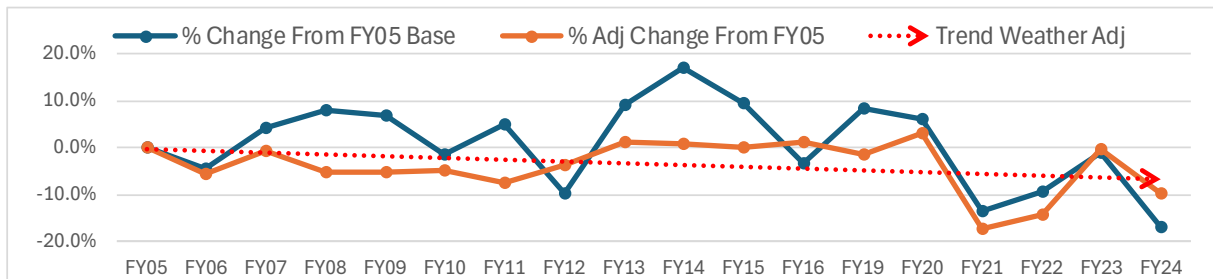

Agency Energy Use Summary



SCOPE

Includes the Wisconsin Veterans Home at King the long term and rehabilitative care facility caring for veterans, a veteran's spouse, the surviving spouse of a veteran, and Gold Star Parents (parents who have lost a son or daughter in combat)

Review Buildings Demolished and New Construction FY23-FY24

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 9.8 percent increase

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 7.8 percent increase

Energy use (BTU/GSF/Yr) for FY24 increase 7.8 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 0.5 percent increase per year.

On average, energy use (BTU/GSF/Yr) has increase 0.5 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: 0 percent increase.



Gross square footage (GSF) has not changed from the base fiscal year, FY05.

Consumption Change from Base: 0 percent decrease.

Total consumption was 0 percent greater when compared to FY05. Total energy (million BTU) purchases in FY24 were 8.7 percent greater than in the base year when adjusted for weather compared to FY05.


Veterans Affairs, Department of

Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024	
Electricity	\$	1,128,968	\$	863,275	\$	1,053,258	\$	1,321,377	\$	1,354,927
Coal	\$	-	\$	-	\$	-	\$	199	\$	-
Natural Gas	\$	394,606	\$	439,783	\$	728,322	\$	841,258	\$	458,028
Fuel Oil	\$	306	\$	-	\$	-	\$	-	\$	-
Other Fuels	\$	6,592	\$	11,696	\$	8,576	\$	29,609	\$	24,467
Steam/Heat	\$	351,778	\$	335,263	\$	270,054	\$	593,459	\$	602,859
Chilled Water	\$	71,889	\$	46,738	\$	46,076	\$	62,257	\$	109,692
Water & Sewage	\$	325,564	\$	205,137	\$	170,613	\$	234,317	\$	258,063
Total Utilities	\$	2,279,701	\$	1,901,892	\$	2,276,898	\$	3,082,477	\$	2,808,036

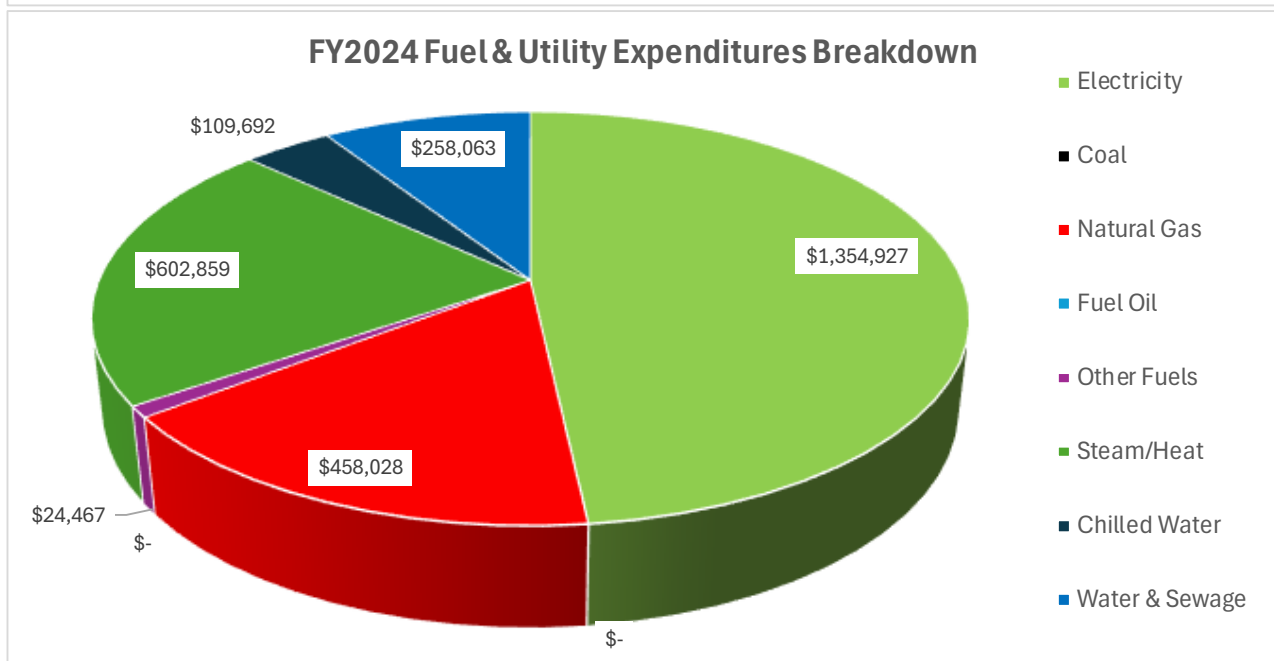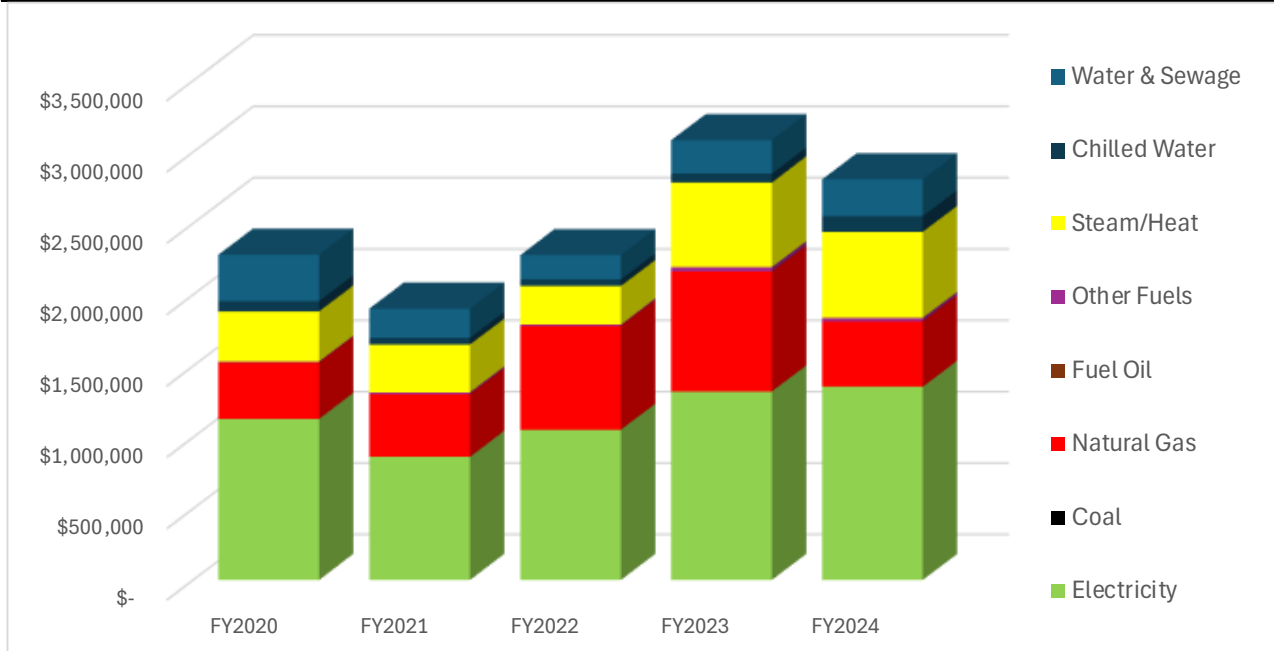

DVA Fiscal Year 2024 State Agency Energy Report


Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	733,728	156,662	40,749	197,411	0.0%	45.94	100.0%	100.0%	197,411	0.0%
FY06	733,728	148,953	43,635	192,588	-2.4%	47.26	103.9%	99.4%	198,159	0.4%
FY07	733,728	154,261	44,374	198,635	0.6%	46.64	102.5%	100.0%	202,432	2.5%
FY08	733,728	162,343	45,139	207,482	5.1%	45.02	97.2%	98.9%	202,473	2.6%
FY09	733,728	157,632	44,029	201,661	2.2%	43.47	94.0%	99.8%	192,062	-2.7%
FY10	733,728	133,891	43,308	177,199	-10.2%	45.98	100.9%	100.6%	178,671	-9.5%
FY11	733,728	142,187	45,433	187,620	-5.0%	44.58	96.3%	99.9%	182,378	-7.6%
FY12	733,728	128,442	45,496	173,938	-11.9%	49.86	109.3%	98.8%	185,404	-6.1%
FY13	733,728	140,005	45,722	185,726	-5.9%	45.29	98.2%	100.0%	183,279	-7.2%
FY14	733,728	147,437	45,185	192,623	-2.4%	41.95	89.2%	99.4%	176,438	-10.6%
FY15	733,728	134,553	45,441	179,994	-8.8%	43.98	95.9%	100.4%	174,625	-11.5%
FY16	733,728	133,028	47,139	180,168	-8.7%	48.11	105.9%	99.5%	187,783	-4.9%
FY17	733,728	130,932	46,822	177,753	-10.0%	48.65	107.5%	99.3%	187,275	-5.1%
FY18	733,728	139,595	47,896	187,491	-5.0%	45.41	98.4%	99.3%	184,959	-6.3%
FY19	733,728	128,343	45,909	174,252	-11.7%	44.90	98.0%	99.8%	171,552	-13.1%
FY20	733,728	122,167	41,684	163,851	-17.0%	46.40	101.5%	99.8%	165,617	-16.1%
FY21	733,728	137,835	41,583	179,418	-9.1%	47.28	103.0%	98.9%	183,156	-7.2%
FY22	733,728	156,013	47,807	203,819	3.2%	46.76	101.2%	98.3%	204,863	3.8%
FY23	733,728	153,565	41,868	195,433	-1.0%	47.58	103.6%	100.1%	201,074	1.9%
FY24	733,728	156,139	47,144	203,283	3.0%	49.93	108.9%	98.9%	216,709	9.8%

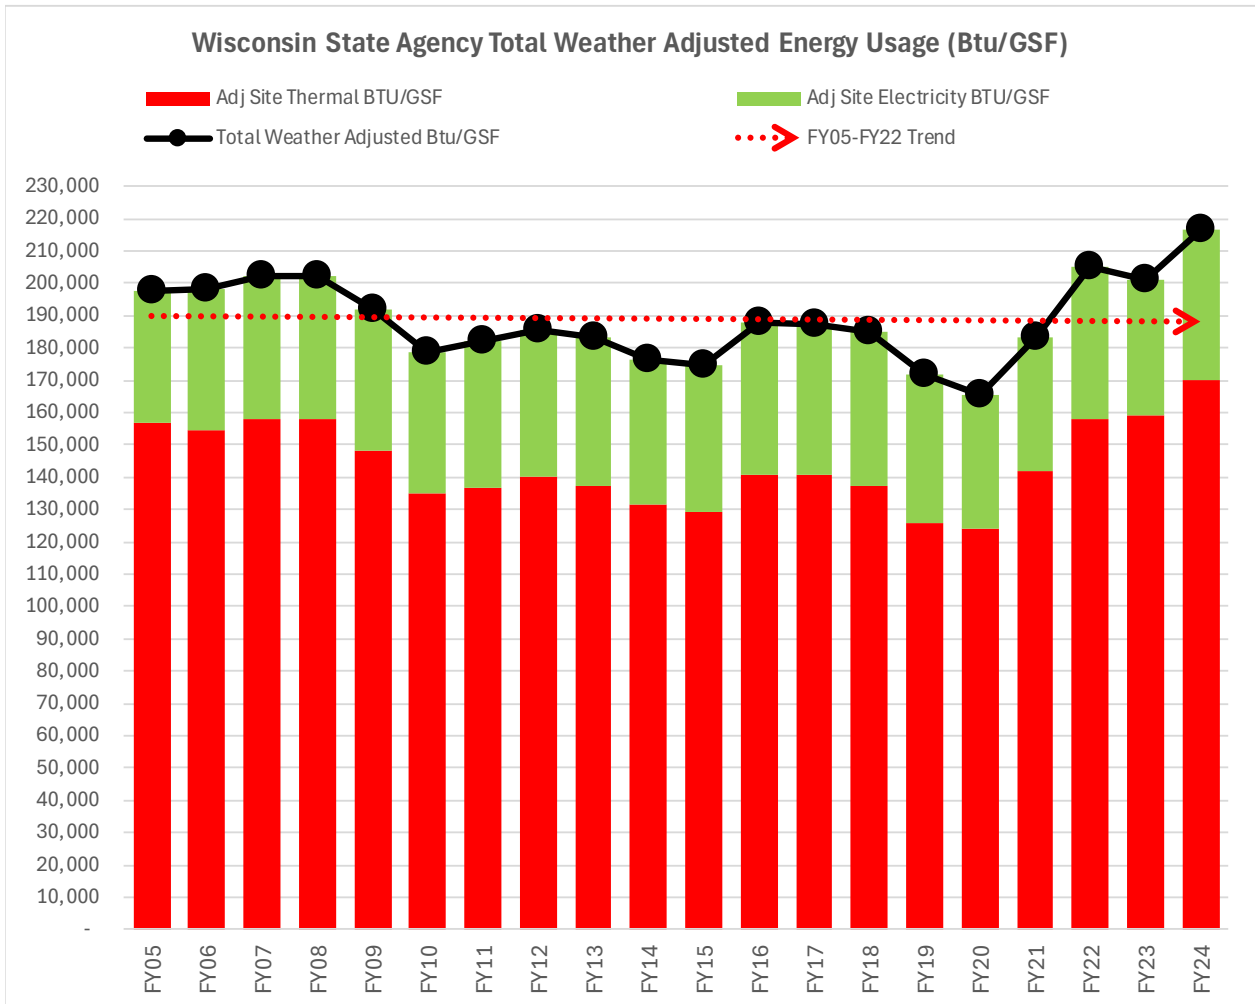

FY2024 DVA-King State Facilities Energy Report

FY24 Electric kwh/GSF= 13.81			FY24 Therm/GSF = 1.56			FY24 Total Btu/GSF= 203,283			05-24 Thm 8.6%	
FY24 Electric \$/GSF= \$ 1.30			FY24 Thermal \$/GSF= \$ 0.57			FY24 Energy \$/GSF= \$ 1.86			05-24 kwh 14.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	733,728	156,662	40,749	197,411	0.0%	45.94	100.0%	100.0%	197,411	0.0%
FY06	733,728	148,953	43,635	192,588	-2.4%	47.26	103.9%	99.4%	198,159	0.4%
FY07	733,728	154,261	44,374	198,635	0.6%	46.64	102.5%	100.0%	202,432	2.5%
FY08	733,728	162,343	45,139	207,482	5.1%	45.02	97.2%	98.9%	202,473	2.6%
FY09	733,728	157,632	44,029	201,661	2.2%	43.47	94.0%	99.8%	192,062	-2.7%
FY10	733,728	133,891	43,308	177,199	-10.2%	45.98	100.9%	100.6%	178,671	-9.5%
FY11	733,728	142,187	45,433	187,620	-5.0%	44.58	96.3%	99.9%	182,378	-7.6%
FY12	733,728	128,442	45,496	173,938	-11.9%	49.86	109.3%	98.8%	185,404	-6.1%
FY13	733,728	140,005	45,722	185,726	-5.9%	45.29	98.2%	100.0%	183,279	-7.2%
FY14	733,728	147,437	45,185	192,623	-2.4%	41.95	89.2%	99.4%	176,438	-10.6%
FY15	733,728	134,553	45,441	179,994	-8.8%	43.98	95.9%	100.4%	174,625	-11.5%
FY16	733,728	133,028	47,139	180,168	-8.7%	48.11	105.9%	99.5%	187,783	-4.9%
FY17	733,728	130,932	46,822	177,753	-10.0%	48.65	107.5%	99.3%	187,275	-5.1%
FY18	733,728	139,595	47,896	187,491	-5.0%	45.41	98.4%	99.3%	184,959	-6.3%
FY19	733,728	128,343	45,909	174,252	-11.7%	44.90	98.0%	99.8%	171,552	-13.1%
FY20	733,728	122,167	41,684	163,851	-17.0%	46.40	101.5%	99.8%	165,617	-16.1%
FY21	733,728	137,835	41,583	179,418	-9.1%	47.28	103.0%	98.9%	183,156	-7.2%
FY22	733,728	156,013	47,807	203,819	3.2%	46.76	101.2%	98.3%	204,863	3.8%
FY23	733,728	153,565	41,868	195,433	-1.0%	47.58	103.6%	100.1%	201,074	1.9%
FY24	733,728	156,139	47,144	203,283	3.0%	49.93	108.9%	98.9%	216,709	9.8%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

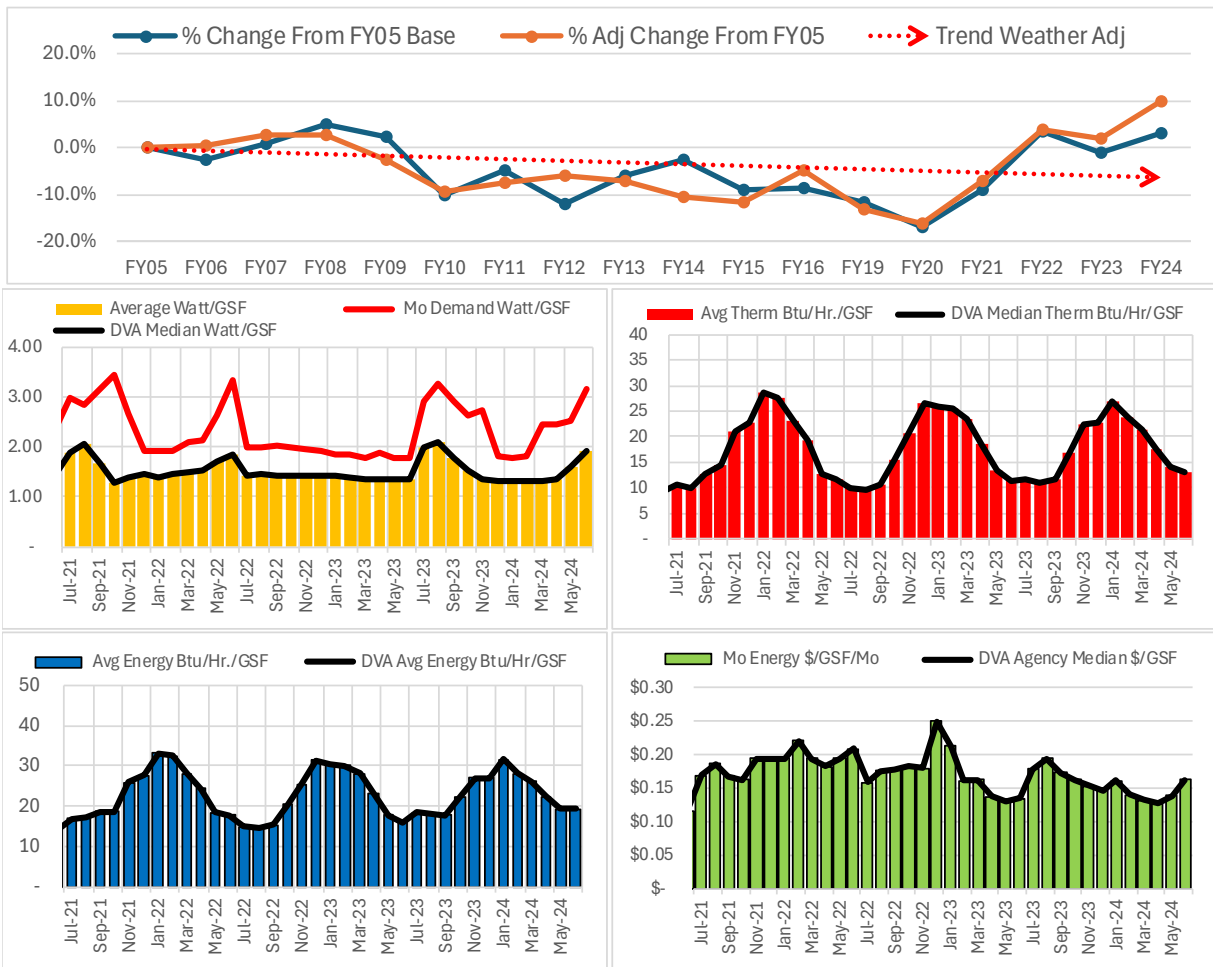

Agency Energy Use Summary

Department of Natural Resources



SCOPE

Includes the larger Department of Natural Resources facilities: DNR-South Central Office Madison; DNR-Darwin Road Madison; DNR-Green Bay Office (New FY2406); DNR-Tomahawk and DNR-Southeast Office (Milwaukee).

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 22.6 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 2.7 percent increase

Energy use (BTU/GSF/Yr) for FY24 increase 2.7 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 1.2 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 1.2 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: -9.4 percent decrease.



Gross square footage (GSF) has decreased 9.4% from the base fiscal year, FY05.

Consumption Change from Base: 32.6 percent decrease.

Total consumption was 32.6 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 24.6 percent less than in the base year when adjusted for weather compared to FY05.


Natural Resources, Department of

Subcategory Name	FY2020	FY2021	FY2022	FY2023	FY2024
Electricity	\$ 1,866,609	\$ 1,571,199	\$ 1,942,812	\$ 2,146,417	\$ 2,251,596
Coal	\$ 105	\$ 14	\$ -	\$ 45	\$ 111
Natural Gas	\$ 304,499	\$ 304,727	\$ 443,384	\$ 507,546	\$ 342,498
Fuel Oil	\$ 963	\$ 510	\$ 586	\$ 110	\$ 5,032
Other Fuels	\$ 490,941	\$ 468,415	\$ 701,326	\$ 725,318	\$ 619,377
Steam/Heat	\$ -	\$ 4,310	\$ 9,128	\$ 5,275	\$ 4,216
Chilled Water	\$ 63	\$ -	\$ -	\$ -	\$ -
Water & Sewage	\$ 374,863	\$ 538,740	\$ 605,019	\$ 726,381	\$ 771,523
Total Utilities	\$ 3,038,043	\$ 2,887,916	\$ 3,702,254	\$ 4,111,092	\$ 3,994,353

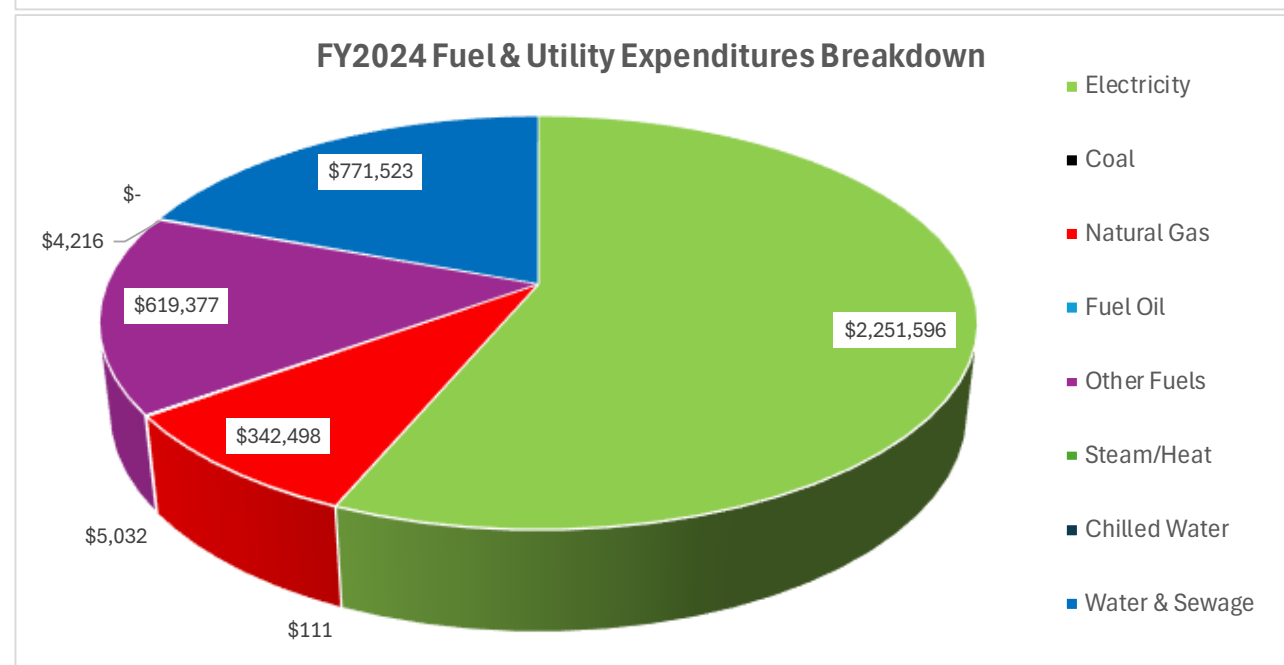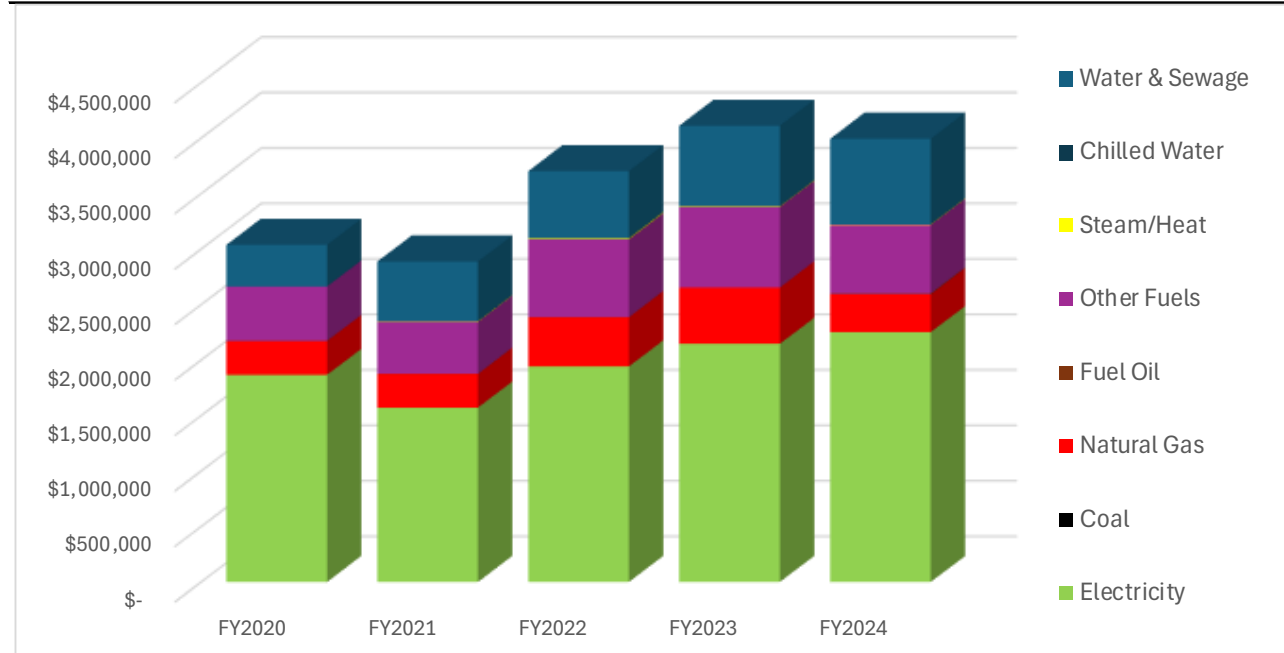

DNR Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	143,537	70,469	40,584	111,053	0.0%	47.31	100.0%	100.0%	111,053	0.0%
FY06	178,097	58,886	38,649	97,535	-12.2%	48.27	102.9%	99.0%	98,824	-11.0%
FY07	178,097	52,646	36,033	88,678	-20.1%	47.11	98.1%	99.4%	87,444	-21.3%
FY08	178,097	60,814	37,215	98,029	-11.7%	45.69	90.3%	98.3%	91,515	-17.6%
FY09	178,097	58,113	35,021	93,134	-16.1%	44.95	90.4%	98.8%	87,131	-21.5%
FY10	178,097	50,777	33,655	84,433	-24.0%	47.00	99.3%	100.0%	84,114	-24.3%
FY11	178,097	55,525	33,682	89,207	-19.7%	45.96	92.6%	98.3%	84,498	-23.9%
FY12	178,097	49,385	35,635	85,021	-23.4%	50.68	108.6%	99.0%	88,897	-20.0%
FY13	178,097	59,759	35,031	94,790	-14.6%	46.44	94.9%	98.9%	91,354	-17.7%
FY14	178,097	67,613	34,690	102,302	-7.9%	43.38	85.7%	98.2%	92,023	-17.1%
FY15	178,097	59,191	32,330	91,521	-17.6%	44.75	93.0%	100.3%	87,444	-21.3%
FY16	178,097	49,528	32,417	81,944	-26.2%	49.15	107.4%	99.9%	85,560	-23.0%
FY17	178,097	52,615	34,354	86,969	-21.7%	49.35	106.3%	98.2%	89,666	-19.3%
FY18	178,097	51,727	30,856	82,583	-25.6%	46.24	93.8%	98.8%	79,045	-28.8%
FY19	178,097	54,372	31,465	85,837	-22.7%	45.41	91.9%	99.2%	81,198	-26.9%
FY20	178,097	53,798	31,379	85,176	-23.3%	47.33	100.2%	99.7%	85,173	-23.3%
FY21	178,097	52,245	28,539	80,785	-27.3%	47.96	99.5%	97.7%	79,886	-28.1%
FY22	130,097	61,468	27,558	89,026	-19.8%	47.06	98.0%	98.0%	87,247	-21.4%
FY23	130,097	56,112	25,808	81,920	-26.2%	47.69	103.4%	99.6%	83,735	-24.6%
FY24	130,097	52,698	26,579	79,277	-28.6%	49.88	112.3%	100.8%	85,981	-22.6%

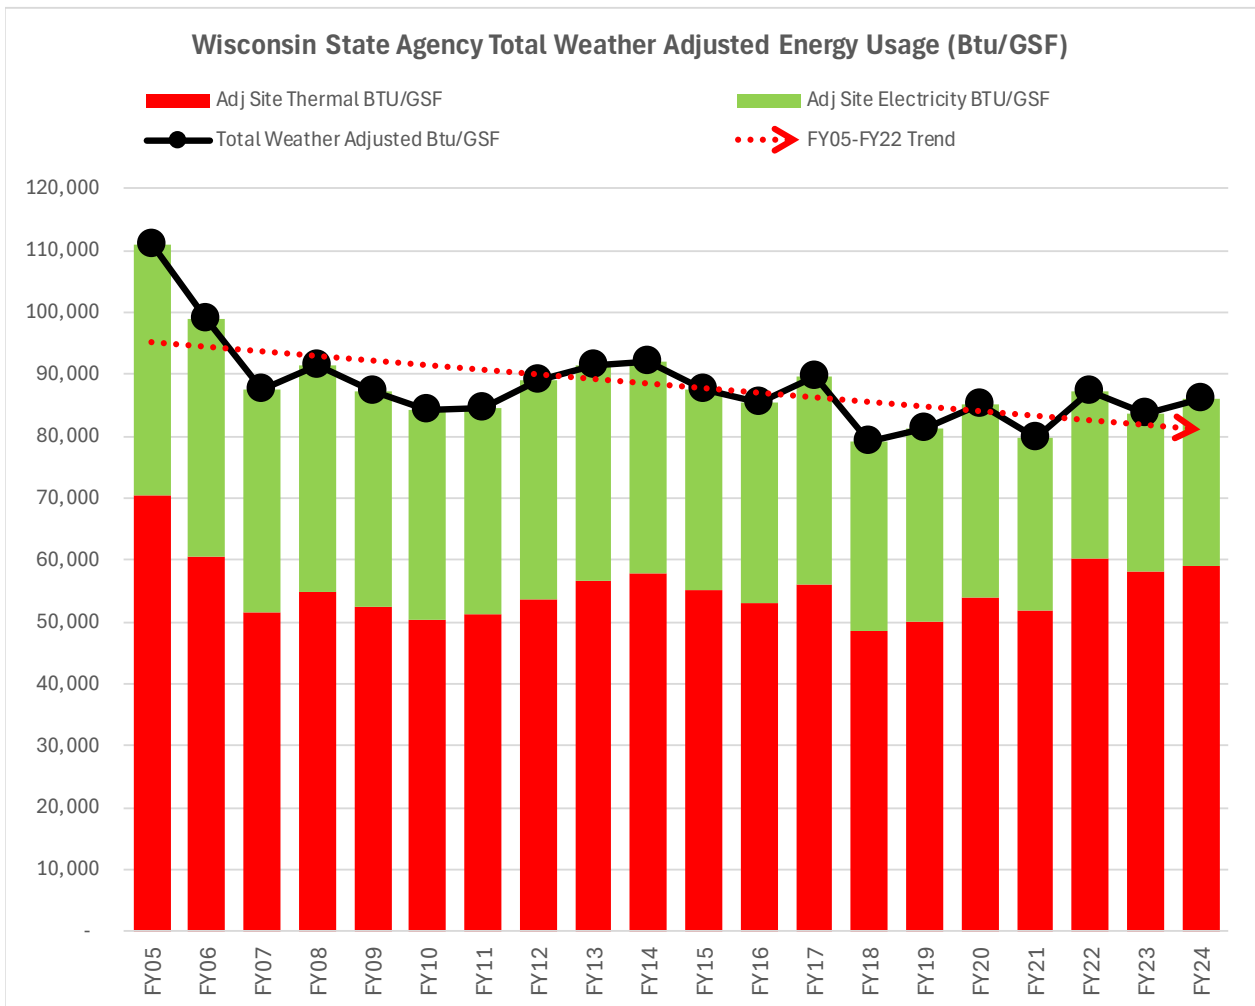

DNR Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 7.79			FY24 Therm/GSF = 0.53			FY24 Total Btu/GSF = 79,277			05-24 Thm -16.0%	
FY24 Electric \$/GSF = \$ 1.20			FY24 Thermal \$/GSF = \$ 0.34			FY24 Energy \$/GSF = \$ 1.54			05-24 kwh -34.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	143,537	70,469	40,584	111,053	0.0%	47.31	100.0%	100.0%	111,053	0.0%
FY06	178,097	58,886	38,649	97,535	-12.2%	48.27	102.9%	99.0%	98,824	-11.0%
FY07	178,097	52,646	36,033	88,678	-20.1%	47.11	98.1%	99.4%	87,444	-21.3%
FY08	178,097	60,814	37,215	98,029	-11.7%	45.69	90.3%	98.3%	91,515	-17.6%
FY09	178,097	58,113	35,021	93,134	-16.1%	44.95	90.4%	98.8%	87,131	-21.5%
FY10	178,097	50,777	33,655	84,433	-24.0%	47.00	99.3%	100.0%	84,114	-24.3%
FY11	178,097	55,525	33,682	89,207	-19.7%	45.96	92.6%	98.3%	84,498	-23.9%
FY12	178,097	49,385	35,635	85,021	-23.4%	50.68	108.6%	99.0%	88,897	-20.0%
FY13	178,097	59,759	35,031	94,790	-14.6%	46.44	94.9%	98.9%	91,354	-17.7%
FY14	178,097	67,613	34,690	102,302	-7.9%	43.38	85.7%	98.2%	92,023	-17.1%
FY15	178,097	59,191	32,330	91,521	-17.6%	44.75	93.0%	100.3%	87,444	-21.3%
FY16	178,097	49,528	32,417	81,944	-26.2%	49.15	107.4%	99.9%	85,560	-23.0%
FY17	178,097	52,615	34,354	86,969	-21.7%	49.35	106.3%	98.2%	89,666	-19.3%
FY18	178,097	51,727	30,856	82,583	-25.6%	46.24	93.8%	98.8%	79,045	-28.8%
FY19	178,097	54,372	31,465	85,837	-22.7%	45.41	91.9%	99.2%	81,198	-26.9%
FY20	178,097	53,798	31,379	85,176	-23.3%	47.33	100.2%	99.7%	85,173	-23.3%
FY21	178,097	52,245	28,539	80,785	-27.3%	47.96	99.5%	97.7%	79,886	-28.1%
FY22	130,097	61,468	27,558	89,026	-19.8%	47.06	98.0%	98.0%	87,247	-21.4%
FY23	130,097	56,112	25,808	81,920	-26.2%	47.69	103.4%	99.6%	83,735	-24.6%
FY24	130,097	52,698	26,579	79,277	-28.6%	49.88	112.3%	100.8%	85,981	-22.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

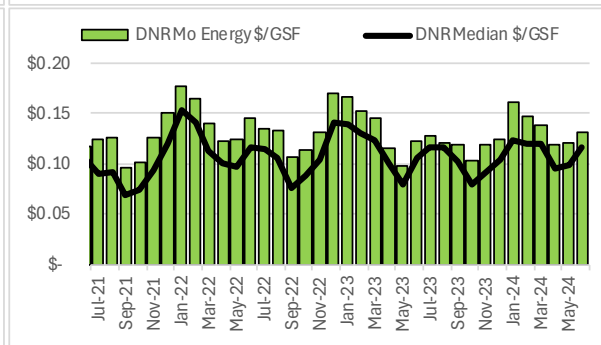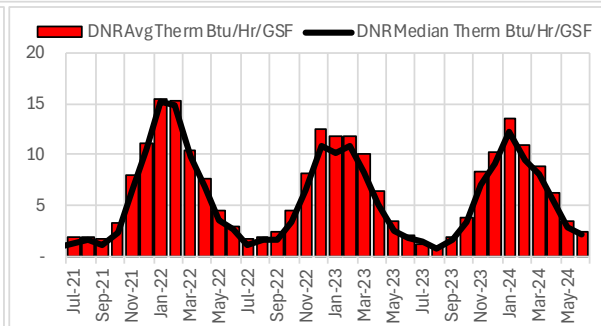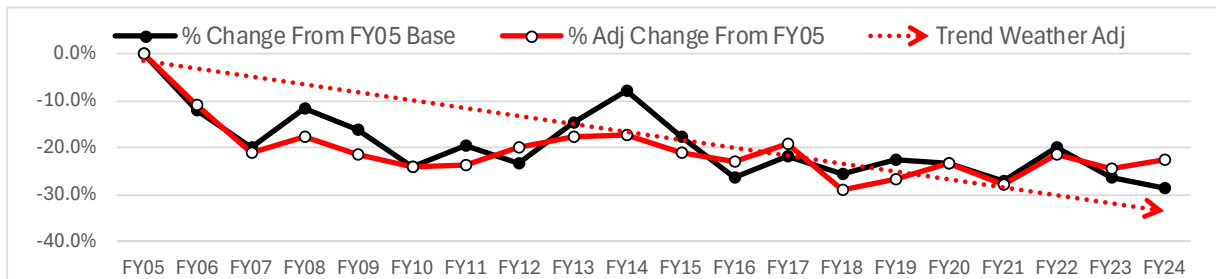

FY2024 DNR-Darwin Road State Facilities Energy Report

FY24 Electric kwh/GSF= 4.09			FY24 Therm/GSF = 0.28			FY24 Total Btu/GSF= 41,660			05-24 Thm -33.2%	
FY24 Electric \$/GSF= \$ 0.78			FY24 Thermal \$/GSF= \$ 0.20			FY24 Energy \$/GSF= \$ 0.99			05-24 kwh -37.7%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	24,820	46,623	22,302	68,925	0.0%	48.12	100.0%	100.0%	68,925	0.0%
FY06	24,820	43,866	22,777	66,642	-3.3%	48.65	101.2%	99.8%	67,098	-2.7%
FY07	24,820	44,688	22,031	66,719	-3.2%	47.46	97.9%	99.9%	65,746	-4.6%
FY08	24,820	51,369	22,736	74,105	7.5%	46.19	79.1%	99.2%	63,195	-8.3%
FY09	24,820	53,768	22,941	76,709	11.3%	45.66	81.8%	100.2%	66,960	-2.9%
FY10	24,820	44,952	20,915	65,867	-4.4%	47.10	93.7%	100.2%	63,088	-8.5%
FY11	24,820	31,265	20,476	51,741	-24.9%	46.81	84.4%	98.4%	46,519	-32.5%
FY12	24,820	22,433	19,756	42,189	-38.8%	51.51	113.7%	99.8%	45,229	-34.4%
FY13	24,820	34,456	20,075	54,530	-20.9%	47.29	88.5%	99.2%	50,398	-26.9%
FY14	24,820	41,689	21,749	63,438	-8.0%	44.58	74.7%	100.2%	52,923	-23.2%
FY15	24,820	37,404	20,977	58,381	-15.3%	45.84	89.0%	99.5%	54,186	-21.4%
FY16	24,820	29,694	19,488	49,182	-28.6%	49.68	102.0%	99.8%	49,729	-27.9%
FY17	24,820	30,437	19,444	49,881	-27.6%	49.72	106.5%	99.3%	51,730	-24.9%
FY18	24,820	32,720	18,976	51,696	-25.0%	46.66	85.4%	99.9%	46,909	-31.9%
FY19	24,820	34,139	18,616	52,755	-23.5%	45.87	86.5%	99.9%	48,125	-30.2%
FY20	24,820	37,091	17,568	54,658	-20.7%	48.08	99.6%	99.8%	54,481	-21.0%
FY21	24,820	34,634	16,317	50,951	-26.1%	47.61	93.1%	98.6%	48,323	-29.9%
FY22	24,820	40,405	15,568	55,973	-18.8%	48.04	92.6%	98.9%	52,818	-23.4%
FY23	24,820	31,972	14,133	46,105	-33.1%	48.63	101.9%	99.7%	46,680	-32.3%
FY24	24,820	27,688	13,972	41,660	-39.6%	50.95	112.5%	99.5%	45,036	-34.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

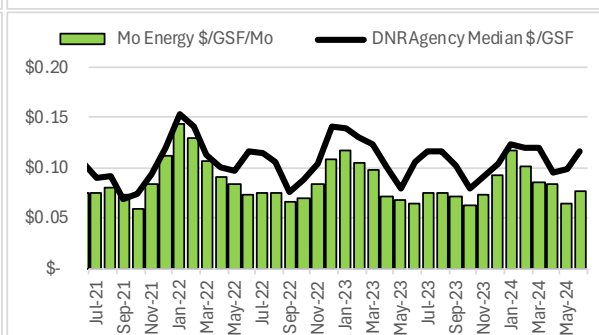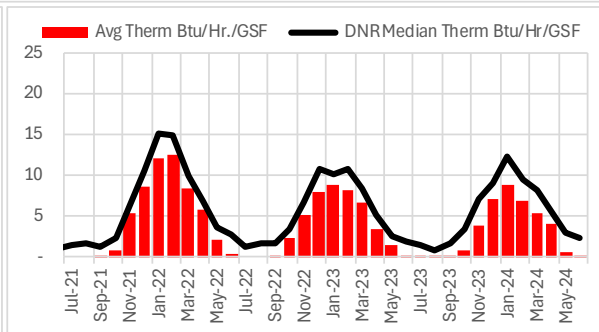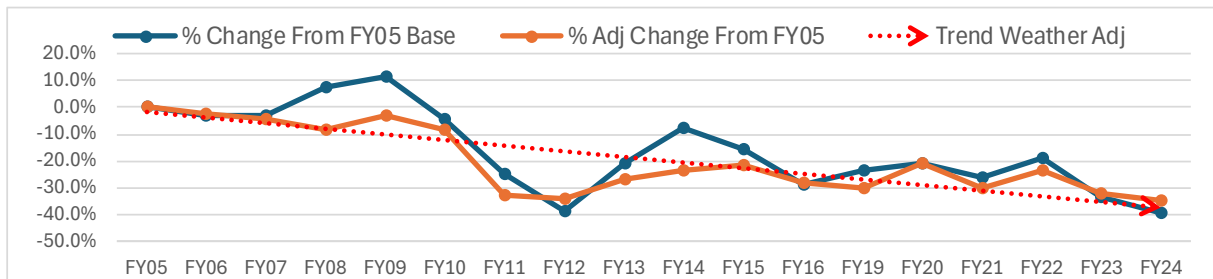

FY2024 DNR-Green Bay State Facilities Energy Report

FY24 Electric kwh/GSF= 9.33			FY24 Therm/GSF = 0.35			FY24 Total Btu/GSF= 66,547			05-24 Thm	
FY24 Electric \$/GSF= \$ 1.16			FY24 Thermal \$/GSF= \$ 0.19			FY24 Energy \$/GSF= \$ 1.35			05-24 kwh	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	-									
FY06	34,560	21,413	30,196	51,608	0.0%	47.26	103.7%	99.0%	52,094	0.0%
FY07	34,560	22,245	27,077	49,321	-4.4%	46.64	100.7%	100.0%	49,477	-5.0%
FY08	34,560	23,084	27,565	50,649	-1.9%	45.02	94.6%	97.4%	48,680	-6.6%
FY09	34,560	23,745	27,225	50,970	-1.2%	43.47	90.3%	98.2%	48,186	-7.5%
FY10	34,560	20,380	24,736	45,116	-12.6%	45.98	101.1%	101.7%	45,767	-12.1%
FY11	34,560	25,885	21,930	47,816	-7.3%	44.58	94.6%	98.5%	46,098	-11.5%
FY12	34,560	23,122	25,493	48,615	-5.8%	49.86	106.9%	100.2%	50,247	-3.5%
FY13	34,560	27,615	24,483	52,098	0.9%	45.29	97.9%	99.2%	51,317	-1.5%
FY14	34,560	35,477	24,798	60,275	16.8%	41.95	88.9%	96.5%	55,469	6.5%
FY15	34,560	33,515	22,464	55,979	8.5%	43.98	95.8%	100.1%	54,589	4.8%
FY16	34,560	27,640	21,836	49,476	-4.1%	48.11	106.1%	101.8%	51,540	-1.1%
FY17	34,560	29,956	25,409	55,365	7.3%	48.65	106.5%	100.6%	57,466	10.3%
FY18	34,560	34,804	22,813	57,617	11.6%	45.41	97.5%	98.1%	56,324	8.1%
FY19	34,560	39,129	25,974	65,102	26.1%	44.90	97.4%	97.5%	63,453	21.8%
FY20	34,560	32,929	25,114	58,043	12.5%	46.40	100.7%	101.7%	58,692	12.7%
FY21	34,560	40,157	27,851	68,008	31.8%	47.28	102.9%	97.9%	68,589	31.7%
FY22	34,560	28,941	28,247	57,188	10.8%	46.76	99.8%	97.4%	56,379	8.2%
FY23	34,560	32,340	24,256	56,596	9.7%	47.58	105.7%	99.4%	58,296	11.9%
FY24	34,560	34,701	31,846	66,547	28.9%	49.93	116.5%	103.2%	73,264	40.6%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

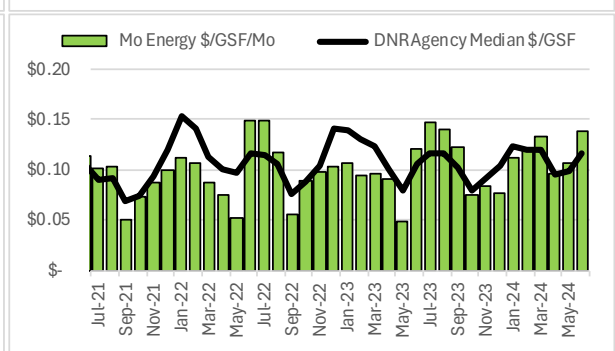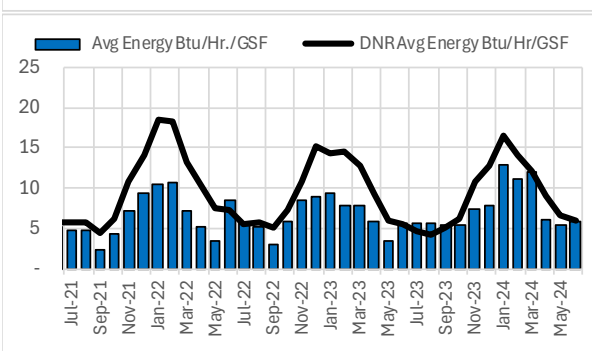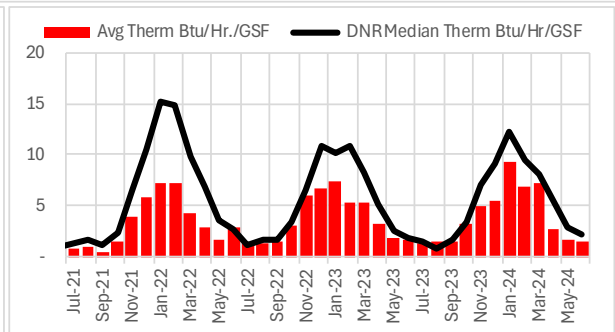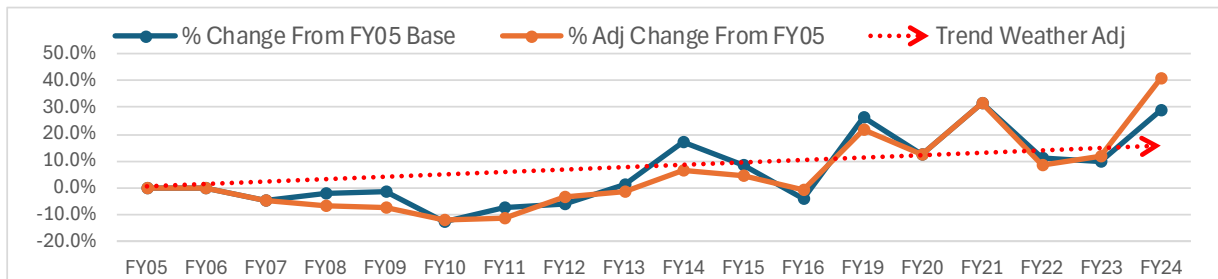

FY2024 DNR-South Central State Facilities Energy Report

FY24 Electric kwh/GSF= 9.90			FY24 Therm/GSF = 0.84			FY24 Total Btu/GSF= 117,310			05-24 Thm -30.8%	
FY24 Electric \$/GSF= \$ 1.90			FY24 Thermal \$/GSF= \$ 0.59			FY24 Energy \$/GSF= \$ 2.49			05-24 kwh -39.8%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	33,976	130,688	55,820	186,508	0.0%	48.12	100.0%	100.0%	186,508	0.0%
FY06	33,976	129,570	57,246	186,816	0.2%	48.65	102.3%	98.9%	189,149	1.4%
FY07	33,976	99,150	50,411	149,561	-19.8%	47.46	97.2%	99.4%	146,498	-21.5%
FY08	33,976	108,707	54,805	163,512	-12.3%	46.19	92.8%	97.9%	154,603	-17.1%
FY09	33,976	111,071	49,391	160,462	-14.0%	45.66	89.5%	97.4%	147,490	-20.9%
FY10	33,976	99,823	47,924	147,747	-20.8%	47.10	96.4%	99.7%	144,038	-22.8%
FY11	33,976	123,153	51,765	174,918	-6.2%	46.81	92.6%	97.5%	164,481	-11.8%
FY12	33,976	115,512	61,016	176,529	-5.4%	51.51	108.0%	98.2%	184,669	-1.0%
FY13	33,976	137,044	62,033	199,077	6.7%	47.29	95.5%	98.3%	191,859	2.9%
FY14	33,976	145,623	57,931	203,555	9.1%	44.58	87.1%	97.2%	183,114	-1.8%
FY15	33,976	127,213	50,043	177,256	-5.0%	45.84	93.1%	100.2%	168,549	-9.6%
FY16	33,976	118,703	54,830	173,532	-7.0%	49.68	107.4%	100.0%	182,343	-2.2%
FY17	33,976	122,605	60,787	183,392	-1.7%	49.72	104.4%	98.0%	187,515	0.5%
FY18	33,976	103,025	45,660	148,685	-20.3%	46.66	93.8%	98.4%	141,591	-24.1%
FY19	33,976	105,214	44,310	149,524	-19.8%	45.87	92.1%	99.4%	140,900	-24.5%
FY20	33,976	106,709	47,961	154,671	-17.1%	48.08	100.1%	98.7%	154,177	-17.3%
FY21	33,976	92,858	36,212	129,069	-30.8%	47.61	96.5%	97.3%	124,824	-33.1%
FY22	33,976	104,571	39,119	143,690	-23.0%	48.04	98.1%	97.4%	140,661	-24.6%
FY23	33,976	98,257	36,436	134,692	-27.8%	48.63	101.8%	99.6%	136,326	-26.9%
FY24	33,976	83,507	33,803	117,310	-37.1%	50.95	108.4%	99.4%	124,096	-33.5%


Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

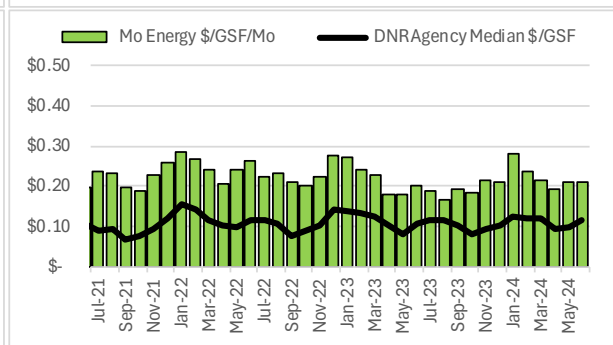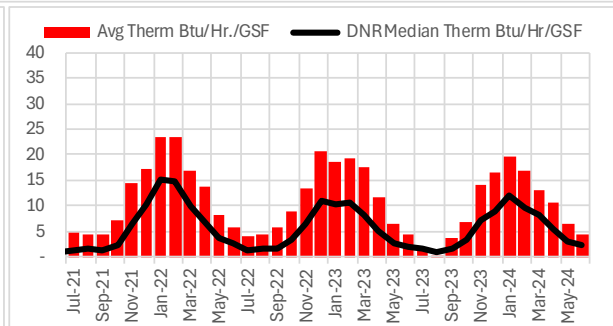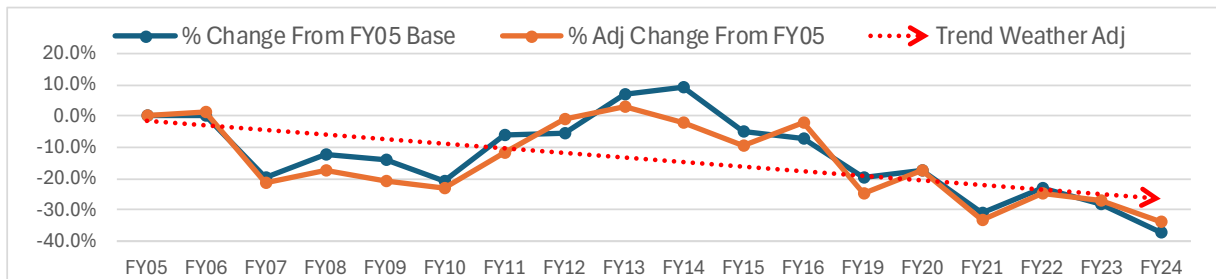

FY2024 DNR-Tomahawk State Facilities Energy Report

FY24 Electric kwh/GSF= 6.87			FY24 Therm/GSF = 0.58			FY24 Total Btu/GSF= 81,494			05-24 Thm 36.9%	
FY24 Electric \$/GSF= \$ 0.86			FY24 Thermal \$/GSF= \$ 0.34			FY24 Energy \$/GSF= \$ 1.20			05-24 kwh -10.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	36,741	48,814	26,236	75,049	0.0%	44.50	100.0%	100.0%	75,049	0.0%
FY06	36,741	52,654	26,536	79,190	5.5%	46.21	102.9%	100.2%	80,765	7.6%
FY07	36,741	47,737	24,294	72,031	-4.0%	44.70	98.6%	100.0%	71,371	-4.9%
FY08	36,741	60,931	27,939	88,870	18.4%	42.68	86.6%	99.7%	80,589	7.4%
FY09	36,741	49,901	26,866	76,768	2.3%	42.20	92.9%	99.6%	73,127	-2.6%
FY10	36,741	38,580	24,299	62,879	-16.2%	45.07	107.0%	99.8%	65,541	-12.7%
FY11	36,741	43,317	24,227	67,544	-10.0%	43.03	91.1%	99.8%	63,639	-15.2%
FY12	36,741	32,801	22,913	55,714	-25.8%	48.08	113.2%	102.2%	60,539	-19.3%
FY13	36,741	45,853	23,084	68,936	-8.1%	43.78	92.1%	99.6%	65,212	-13.1%
FY14	36,741	54,536	23,563	78,099	4.1%	40.42	84.3%	100.6%	69,667	-7.2%
FY15	36,741	52,465	23,561	76,026	1.3%	42.00	94.3%	99.5%	72,932	-2.8%
FY16	36,741	42,249	21,667	63,916	-14.8%	47.49	109.5%	100.1%	67,971	-9.4%
FY17	36,741	44,742	24,754	69,496	-7.4%	45.96	103.2%	100.1%	70,957	-5.5%
FY18	36,741	54,444	27,817	82,261	9.6%	43.03	92.4%	99.9%	78,097	4.1%
FY19	36,741	59,689	27,931	87,620	16.8%	41.93	91.0%	100.7%	82,408	9.8%
FY20	36,741	53,232	27,085	80,317	7.0%	43.74	99.2%	100.2%	79,950	6.5%
FY21	36,741	52,670	26,033	78,703	4.9%	45.40	100.0%	99.6%	78,590	4.7%
FY22	36,741	66,433	24,319	90,752	20.9%	45.76	99.5%	99.0%	90,147	20.1%
FY23	36,741	55,809	25,326	81,135	8.1%	46.29	105.4%	99.8%	84,063	12.0%
FY24	36,741	58,031	23,463	81,494	8.6%	48.13	115.2%	100.3%	90,358	20.4%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

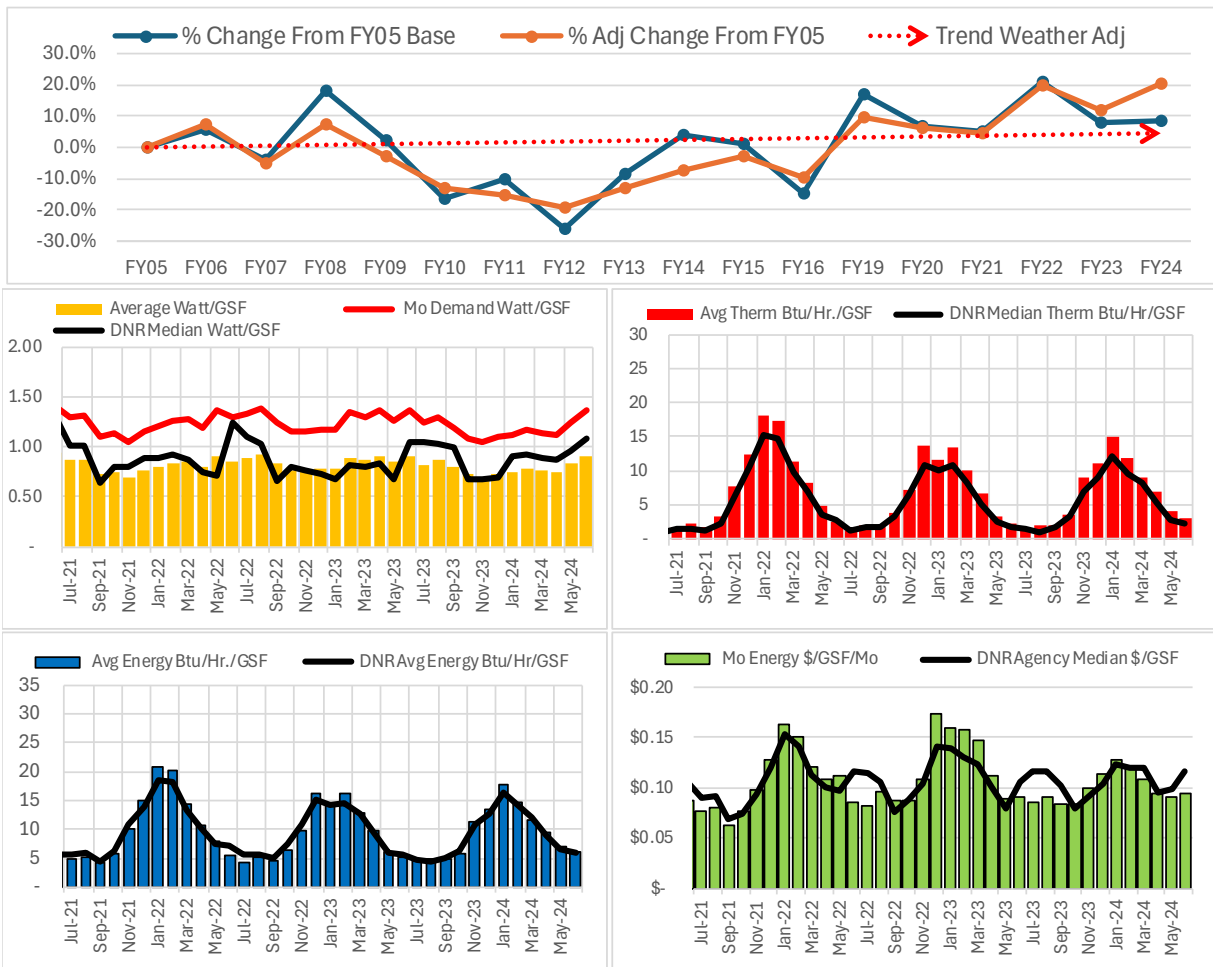

Agency Energy Use Summary

Department of Transportation



SCOPE

Includes the larger Department of Transportation facilities: DTD 1 Madison; DTD 1, Madison Lab; DTD 1, "A" Building Madison; DTD 1, "B" Building Madison; DTD 2, West Allis; and DTD 3, Green Bay.

ENERGY CONSUMPTION

Total Change from Base - Weather Adjusted: 32.7 percent decrease

Includes the major agency facilities listed in scope above.

Latest Year Change - Weather Adjusted: 7.6 percent increase

Energy use (BTU/GSF/Yr) for FY24 increase 7.6 percent from the previous fiscal year, FY23.

Average Annual Change - Weather Adjusted: 1.7 percent decrease per year.

On average, energy use (BTU/GSF/Yr) has decrease 1.7 percent since the base year, FY05.

GSF AND CONSUMPTION STATISTICS

GSF Change from Base: 0 percent increase.



Gross square footage (GSF) has not changed from the base fiscal year, FY05.

Consumption Change from Base: 38 percent decrease.

Total consumption was 38 percent less when compared to FY05. Total energy (million BTU) purchases in FY24 were 31.9 percent less than in the base year when adjusted for weather compared to FY05.


Transportation, Department of

Subcategory Name	FY2020	FY2021	FY2022	FY2023	FY2024
Electricity	\$ 1,315,760	\$ 1,127,352	\$ 1,248,790	\$ 1,370,371	\$ 1,484,239
Coal	\$ -	\$ -	\$ -	\$ 47	\$ -
Natural Gas	\$ 214,830	\$ 209,776	\$ 297,545	\$ 357,966	\$ 221,214
Fuel Oil	\$ 16,797	\$ -	\$ -	\$ -	\$ -
Other Fuels	\$ 31,950	\$ 67,745	\$ 79,196	\$ 87,184	\$ 53,785
Steam/Heat	\$ -	\$ -	\$ -	\$ -	\$ -
Chilled Water	\$ -	\$ -	\$ -	\$ -	\$ -
Water & Sewage	\$ 158,906	\$ 139,933	\$ 157,169	\$ 183,347	\$ 169,156
Total Utilities	\$ 1,738,242	\$ 1,544,806	\$ 1,782,700	\$ 1,998,916	\$ 1,928,395

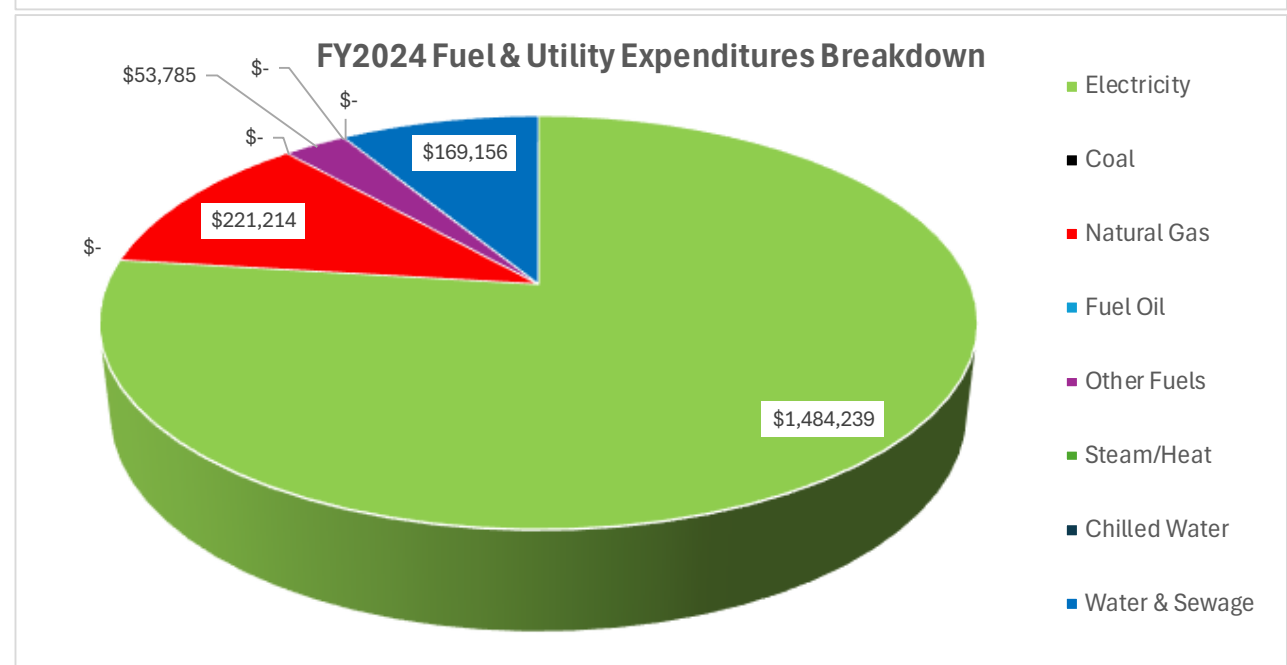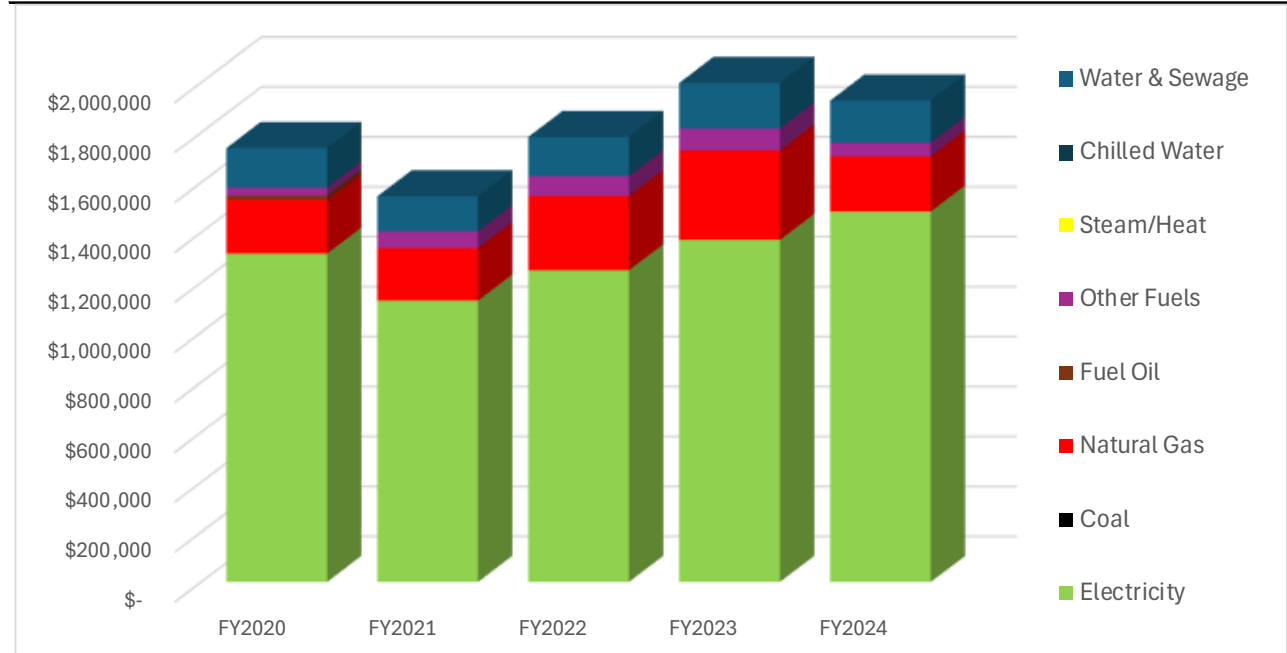

DOT Fiscal Year 2024 State Agency Energy Report






Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	274,395	64,561	41,794	106,355	0.0%	47.84	100.0%	100.0%	106,355	0.0%
FY06	274,395	57,610	41,548	99,158	-6.8%	48.62	99.7%	99.1%	98,618	-7.3%
FY07	274,395	65,171	41,538	106,709	0.3%	47.50	99.6%	99.7%	106,334	0.0%
FY08	274,395	67,726	42,663	110,389	3.8%	46.22	91.3%	98.8%	104,004	-2.2%
FY09	274,395	62,757	40,834	103,590	-2.6%	45.52	91.1%	99.9%	97,938	-7.9%
FY10	274,395	59,383	37,503	96,886	-8.9%	47.17	99.1%	100.9%	96,700	-9.1%
FY11	274,395	70,053	37,703	107,757	1.3%	46.64	94.0%	98.8%	103,100	-3.1%
FY12	274,395	51,774	35,398	87,172	-18.0%	51.35	108.0%	97.3%	90,370	-15.0%
FY13	274,395	67,300	36,543	103,843	-2.4%	47.11	93.6%	99.7%	99,418	-6.5%
FY14	274,395	68,335	35,671	104,007	-2.2%	44.26	87.9%	99.3%	95,498	-10.2%
FY15	274,395	54,348	31,732	86,080	-19.1%	45.59	94.0%	99.9%	82,767	-22.2%
FY16	274,395	44,153	32,442	76,595	-28.0%	49.54	104.4%	99.6%	78,403	-26.3%
FY17	274,395	48,895	32,161	81,056	-23.8%	49.83	105.2%	98.8%	83,235	-21.7%
FY18	274,395	53,899	31,572	85,471	-19.6%	46.73	94.3%	99.8%	82,302	-22.6%
FY19	274,395	58,741	32,680	91,421	-14.0%	45.96	91.7%	99.7%	86,474	-18.7%
FY20	274,395	65,598	32,478	98,076	-7.8%	48.03	100.5%	99.4%	98,170	-7.7%
FY21	274,395	45,369	25,907	71,276	-33.0%	47.94	97.8%	98.5%	69,882	-34.3%
FY22	274,395	45,056	28,245	73,300	-31.1%	48.19	96.8%	97.2%	71,080	-33.2%
FY23	274,395	37,056	28,604	65,660	-38.3%	48.76	102.5%	99.8%	66,535	-37.4%
FY24	274,395	39,863	27,579	67,442	-36.6%	51.06	110.5%	100.0%	71,599	-32.7%

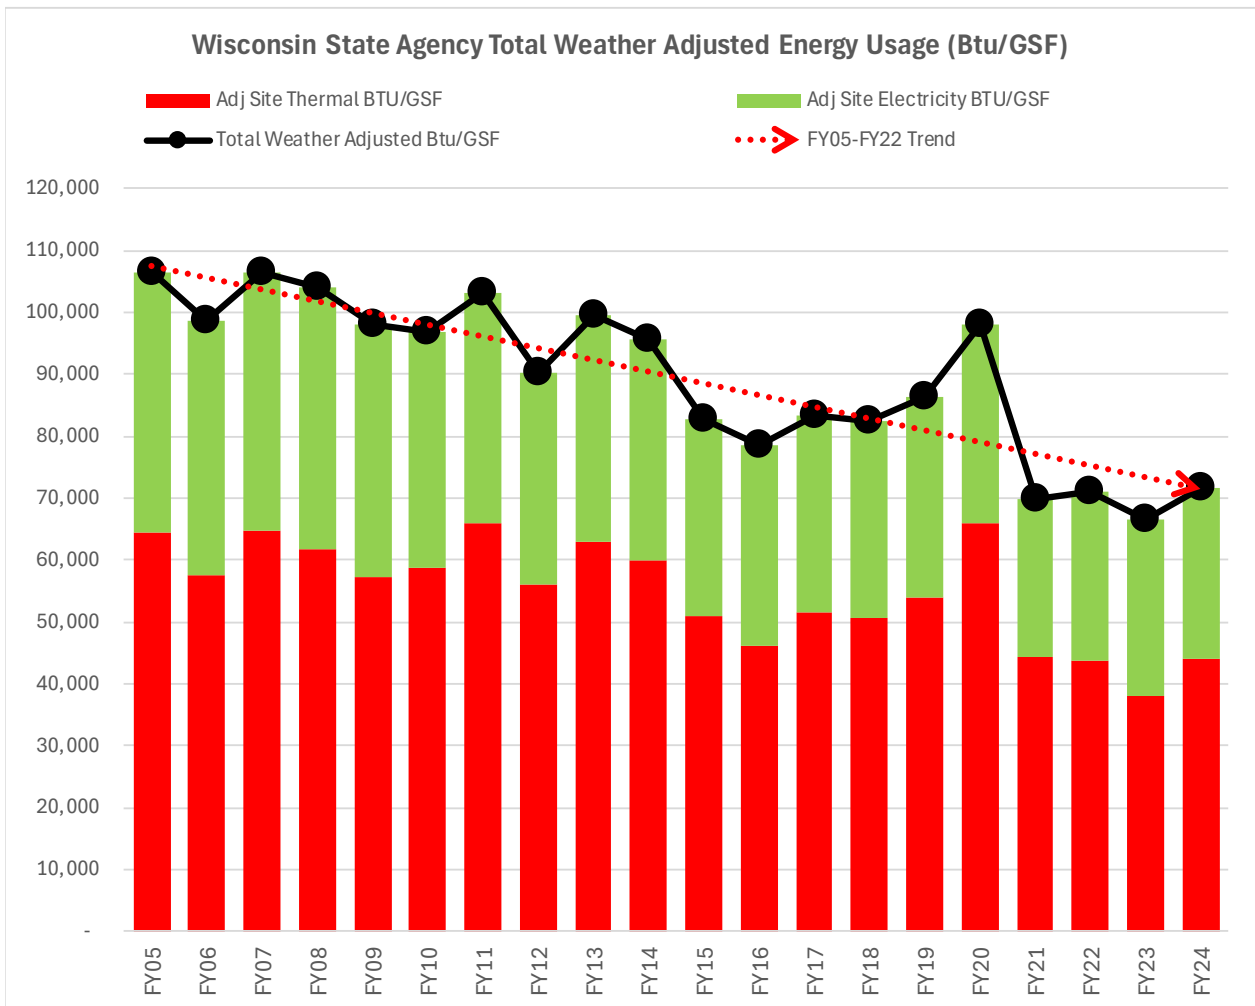

DOT Fiscal Year 2024 State Agency Energy Report

FY24 Electric kwh/GSF = 8.08			FY24 Therm/GSF = 0.40			FY24 Total Btu/GSF = 67,442			05-24 Thm -31.8%	
FY24 Electric \$/GSF = \$ 1.15			FY24 Thermal \$/GSF = \$ 0.25			FY24 Energy \$/GSF = \$ 1.40			05-24 kwh -34.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	274,395	64,561	41,794	106,355	0.0%	47.84	100.0%	100.0%	106,355	0.0%
FY06	274,395	57,610	41,548	99,158	-6.8%	48.62	99.7%	99.1%	98,618	-7.3%
FY07	274,395	65,171	41,538	106,709	0.3%	47.50	99.6%	99.7%	106,334	0.0%
FY08	274,395	67,726	42,663	110,389	3.8%	46.22	91.3%	98.8%	104,004	-2.2%
FY09	274,395	62,757	40,834	103,590	-2.6%	45.52	91.1%	99.9%	97,938	-7.9%
FY10	274,395	59,383	37,503	96,886	-8.9%	47.17	99.1%	100.9%	96,700	-9.1%
FY11	274,395	70,053	37,703	107,757	1.3%	46.64	94.0%	98.8%	103,100	-3.1%
FY12	274,395	51,774	35,398	87,172	-18.0%	51.35	108.0%	97.3%	90,370	-15.0%
FY13	274,395	67,300	36,543	103,843	-2.4%	47.11	93.6%	99.7%	99,418	-6.5%
FY14	274,395	68,335	35,671	104,007	-2.2%	44.26	87.9%	99.3%	95,498	-10.2%
FY15	274,395	54,348	31,732	86,080	-19.1%	45.59	94.0%	99.9%	82,767	-22.2%
FY16	274,395	44,153	32,442	76,595	-28.0%	49.54	104.4%	99.6%	78,403	-26.3%
FY17	274,395	48,895	32,161	81,056	-23.8%	49.83	105.2%	98.8%	83,235	-21.7%
FY18	274,395	53,899	31,572	85,471	-19.6%	46.73	94.3%	99.8%	82,302	-22.6%
FY19	274,395	58,741	32,680	91,421	-14.0%	45.96	91.7%	99.7%	86,474	-18.7%
FY20	274,395	65,598	32,478	98,076	-7.8%	48.03	100.5%	99.4%	98,170	-7.7%
FY21	274,395	45,369	25,907	71,276	-33.0%	47.94	97.8%	98.5%	69,882	-34.3%
FY22	274,395	45,056	28,245	73,300	-31.1%	48.19	96.8%	97.2%	71,080	-33.2%
FY23	274,395	37,056	28,604	65,660	-38.3%	48.76	102.5%	99.8%	66,535	-37.4%
FY24	274,395	39,863	27,579	67,442	-36.6%	51.06	110.5%	100.0%	71,599	-32.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

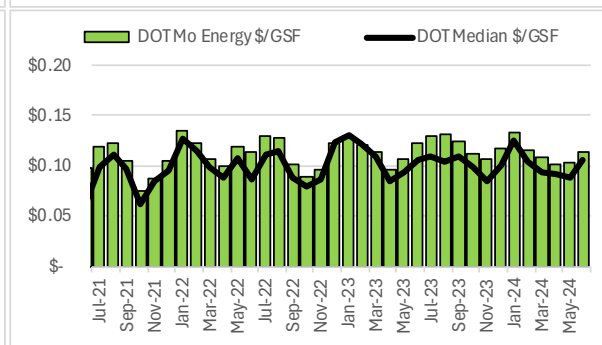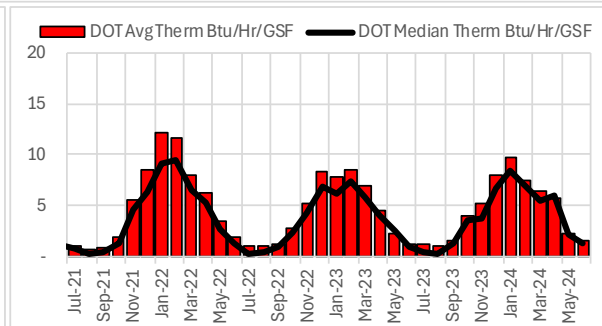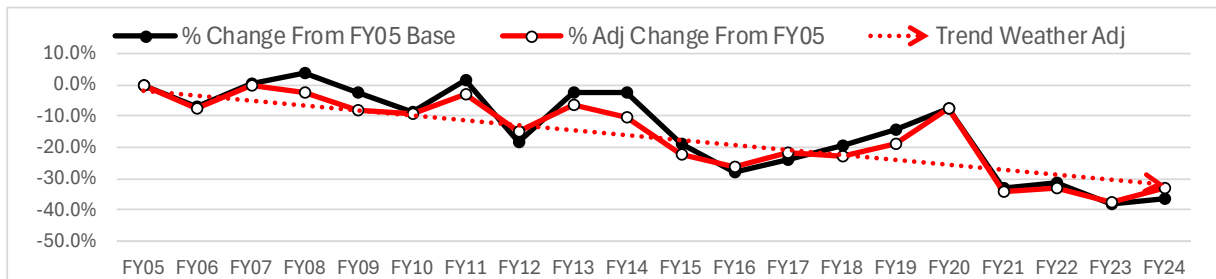

FY2024 DOT-DTD 1 Lab State Facilities Energy Report

FY24 Electric kwh/GSF= 18.97			FY24 Therm/GSF = 0.68			FY24 Total Btu/GSF= 132,746		05-24 Thm -55.4%		
FY24 Electric \$/GSF= \$ 2.88			FY24 Thermal \$/GSF= \$ 0.41			FY24 Energy \$/GSF= \$ 3.28		05-24 kwh -23.8%		
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	43,000	162,720	83,591	246,311	0.0%	48.12	100.0%	100.0%	246,311	0.0%
FY06	43,000	163,270	84,970	248,240	0.8%	48.65	99.9%	98.3%	246,561	0.1%
FY07	43,000	204,282	90,188	294,470	19.6%	47.46	100.2%	99.8%	294,820	19.7%
FY08	43,000	207,886	91,095	298,980	21.4%	46.19	95.1%	97.4%	286,398	16.3%
FY09	43,000	186,577	85,628	272,205	10.5%	45.66	95.5%	100.7%	264,373	7.3%
FY10	43,000	176,205	87,027	263,232	6.9%	47.10	98.9%	101.5%	262,627	6.6%
FY11	43,000	206,810	89,568	296,378	20.3%	46.81	96.7%	97.4%	287,149	16.6%
FY12	43,000	126,292	77,353	203,645	-17.3%	51.51	104.5%	94.1%	204,781	-16.9%
FY13	43,000	160,174	69,784	229,958	-6.6%	47.29	92.7%	98.7%	217,274	-11.8%
FY14	43,000	154,439	73,890	228,329	-7.3%	44.58	89.4%	98.5%	210,839	-14.4%
FY15	43,000	119,664	62,463	182,127	-26.1%	45.84	96.2%	100.4%	177,784	-27.8%
FY16	43,000	102,466	67,359	169,825	-31.1%	49.68	103.9%	98.8%	172,954	-29.8%
FY17	43,000	120,664	65,374	186,038	-24.5%	49.72	101.7%	97.7%	186,572	-24.3%
FY18	43,000	132,779	61,392	194,171	-21.2%	46.66	97.3%	100.8%	191,125	-22.4%
FY19	43,000	120,285	62,694	182,979	-25.7%	45.87	89.4%	100.8%	170,744	-30.7%
FY20	43,000	142,070	69,137	211,206	-14.3%	48.08	99.1%	99.3%	209,546	-14.9%
FY21	43,000	103,284	62,688	165,972	-32.6%	47.61	97.8%	98.7%	162,866	-33.9%
FY22	43,000	83,560	68,291	151,851	-38.3%	48.04	97.4%	97.2%	147,817	-40.0%
FY23	43,000	69,135	62,963	132,098	-46.4%	48.63	100.0%	99.6%	131,831	-46.5%
FY24	43,000	68,005	64,741	132,746	-46.1%	50.95	106.6%	98.4%	136,238	-44.7%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

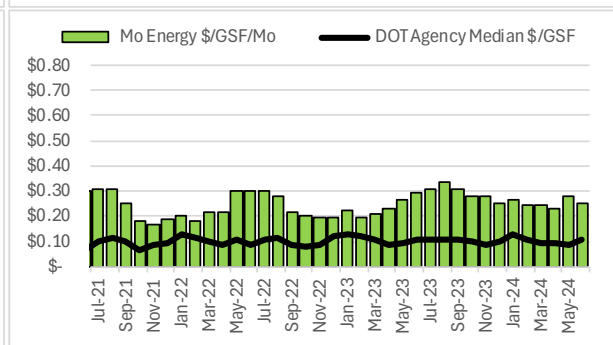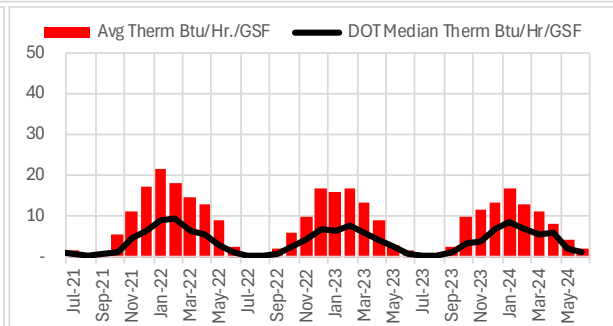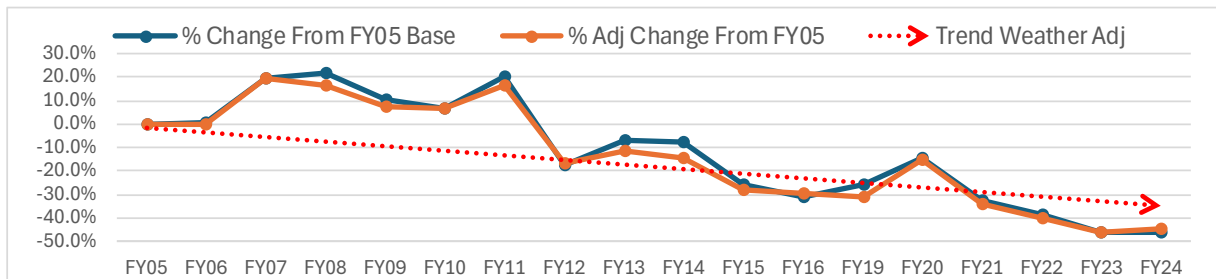

FY2024 DOT-DTD 1 Madison State Facilities Energy Report

FY24 Electric kwh/GSF= 7.62			FY24 Therm/GSF = 0.41			FY24 Total Btu/GSF= 67,167			05-24 Thm -25.5%	
FY24 Electric \$/GSF= \$ 1.30			FY24 Thermal \$/GSF= \$ 0.26			FY24 Energy \$/GSF= \$ 1.56			05-24 kwh -53.4%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	56,000	58,589	55,174	113,762	0.0%	48.12	100.0%	100.0%	113,762	0.0%
FY06	56,000	47,046	51,248	98,294	-13.6%	48.65	99.9%	98.8%	97,638	-14.2%
FY07	56,000	48,837	49,591	98,427	-13.5%	47.46	98.1%	99.7%	97,355	-14.4%
FY08	56,000	58,460	53,684	112,144	-1.4%	46.19	88.6%	99.9%	105,399	-7.4%
FY09	56,000	53,853	52,546	106,399	-6.5%	45.66	86.2%	99.7%	98,833	-13.1%
FY10	56,000	50,582	53,766	104,347	-8.3%	47.10	98.4%	100.7%	103,954	-8.6%
FY11	56,000	64,737	51,597	116,334	2.3%	46.81	96.7%	100.3%	114,337	0.5%
FY12	56,000	65,209	52,985	118,195	3.9%	51.51	106.4%	97.0%	120,766	6.2%
FY13	56,000	78,796	61,133	139,929	23.0%	47.29	97.1%	101.3%	138,439	21.7%
FY14	56,000	69,321	54,971	124,292	9.3%	44.58	99.6%	101.5%	124,832	9.7%
FY15	56,000	49,730	46,348	96,078	-15.5%	45.84	93.8%	100.4%	93,165	-18.1%
FY16	56,000	36,047	44,346	80,393	-29.3%	49.68	104.5%	98.8%	81,473	-28.4%
FY17	56,000	47,428	44,581	92,009	-19.1%	49.72	102.0%	98.1%	92,110	-19.0%
FY18	56,000	57,443	48,076	105,519	-7.2%	46.66	95.0%	99.7%	102,486	-9.9%
FY19	56,000	83,108	55,125	138,233	21.5%	45.87	94.0%	100.6%	133,577	17.4%
FY20	56,000	88,784	48,139	136,922	20.4%	48.08	101.4%	98.5%	137,392	20.8%
FY21	56,000	37,420	24,235	61,655	-45.8%	47.61	95.5%	98.4%	59,604	-47.6%
FY22	56,000	39,629	31,597	71,226	-37.4%	48.04	97.6%	96.3%	69,104	-39.3%
FY23	56,000	35,661	26,710	62,372	-45.2%	48.63	101.5%	99.4%	62,733	-44.9%
FY24	56,000	41,166	26,001	67,167	-41.0%	50.95	106.1%	98.9%	69,398	-39.0%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

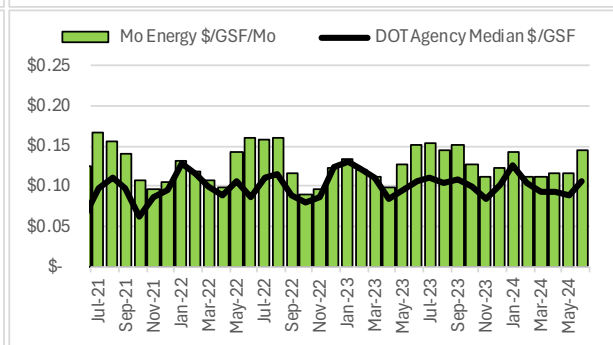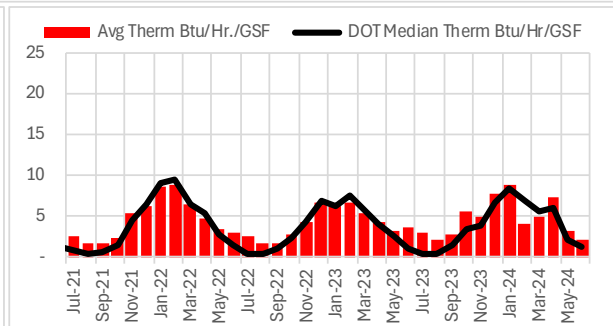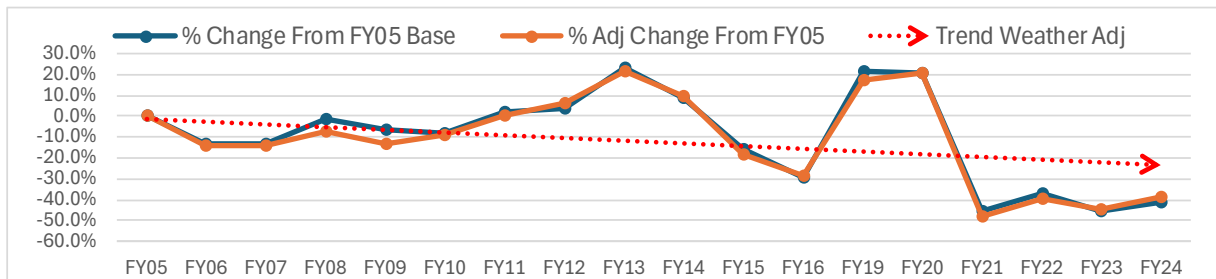

FY2024 DOT-Green Bay State Facilities Energy Report

FY24 Electric kwh/GSF= 14.79			FY24 Therm/GSF = 0.67			FY24 Total Btu/GSF= 117,325			05-24 Thm -9.1%	
FY24 Electric \$/GSF= \$ 1.44			FY24 Thermal \$/GSF= \$ 0.37			FY24 Energy \$/GSF= \$ 1.82			05-24 kwh -7.7%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	40,515	84,100	54,819	138,919	0.0%	45.94	100.0%	100.0%	138,919	0.0%
FY06	40,515	60,540	58,017	118,557	-14.7%	47.26	103.2%	99.4%	120,192	-13.5%
FY07	40,515	51,120	54,837	105,957	-23.7%	46.64	105.1%	99.5%	108,329	-22.0%
FY08	40,515	51,929	55,786	107,715	-22.5%	45.02	96.4%	100.0%	105,845	-23.8%
FY09	40,515	50,581	51,556	102,138	-26.5%	43.47	94.2%	99.7%	99,084	-28.7%
FY10	40,515	43,754	47,216	90,970	-34.5%	45.98	102.6%	100.1%	92,141	-33.7%
FY11	40,515	53,998	49,240	103,237	-25.7%	44.58	92.5%	100.3%	99,310	-28.5%
FY12	40,515	44,727	48,357	93,083	-33.0%	49.86	113.1%	97.3%	97,676	-29.7%
FY13	40,515	70,221	50,531	120,753	-13.1%	45.29	97.5%	100.3%	119,157	-14.2%
FY14	40,515	75,866	48,323	124,189	-10.6%	41.95	90.1%	100.2%	116,803	-15.9%
FY15	40,515	73,473	46,114	119,587	-13.9%	43.98	97.2%	100.7%	117,870	-15.2%
FY16	40,515	64,494	49,026	113,520	-18.3%	48.11	105.7%	99.9%	117,119	-15.7%
FY17	40,515	70,324	50,655	120,979	-12.9%	48.65	111.6%	99.1%	128,672	-7.4%
FY18	40,515	65,487	45,244	110,731	-20.3%	45.41	97.1%	99.2%	108,522	-21.9%
FY19	40,515	70,741	43,479	114,221	-17.8%	44.90	97.0%	97.8%	111,166	-20.0%
FY20	40,515	87,979	48,025	136,004	-2.1%	46.40	102.2%	99.7%	137,742	-0.8%
FY21	40,515	58,473	36,538	95,011	-31.6%	47.28	102.8%	97.4%	95,686	-31.1%
FY22	40,515	75,225	42,009	117,234	-15.6%	46.76	98.9%	96.7%	115,012	-17.2%
FY23	40,515	46,075	55,393	101,468	-27.0%	47.58	104.1%	99.0%	102,789	-26.0%
FY24	40,515	66,857	50,468	117,325	-15.5%	49.93	114.4%	100.2%	127,058	-8.5%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

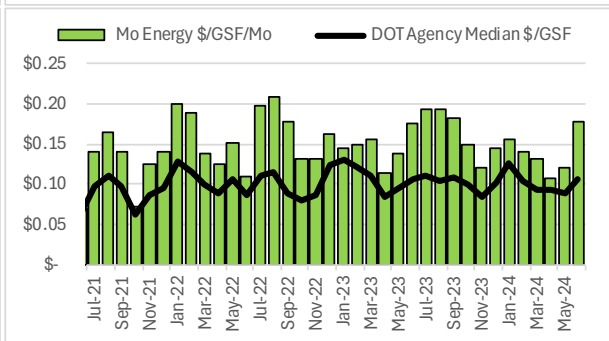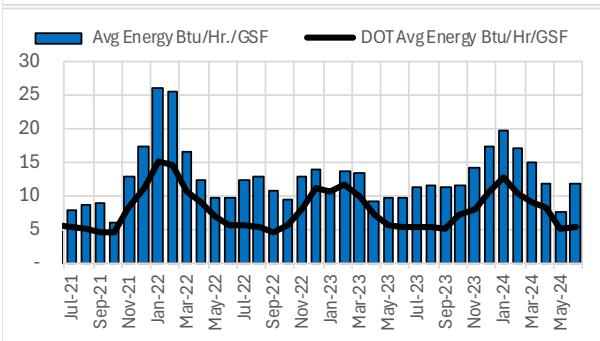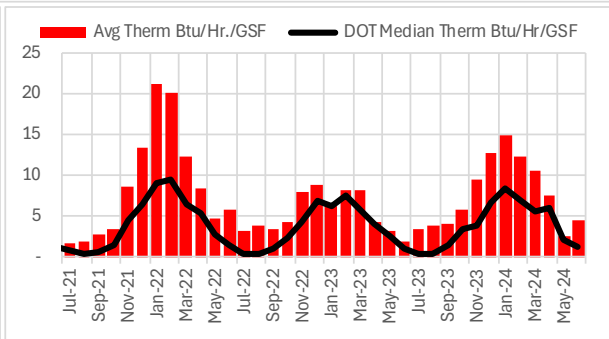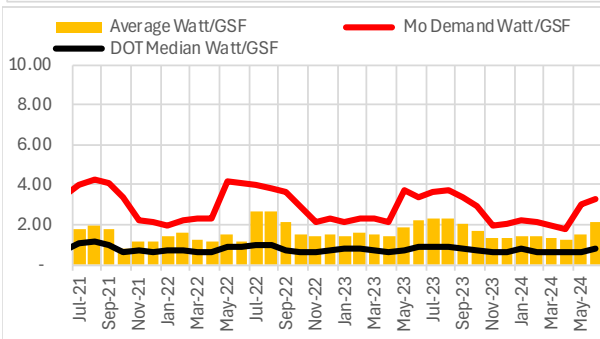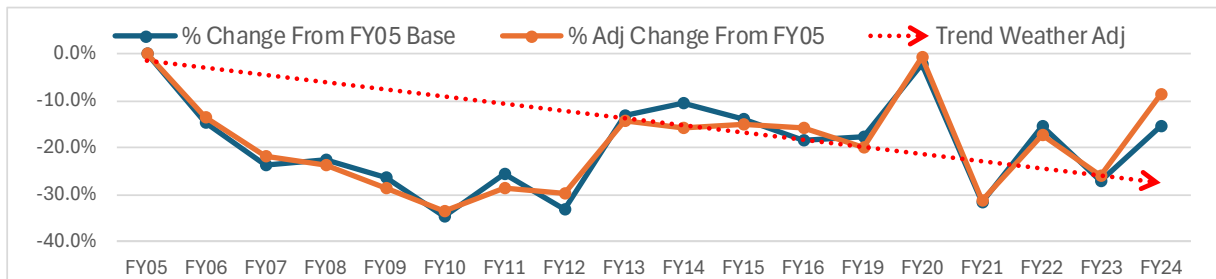

FY2024 DOT-PIERSTORFF A State Facilities Energy Report

FY24 Electric kwh/GSF= 2.82			FY24 Therm/GSF = 0.18			FY24 Total Btu/GSF= 28,051			05-24 Thm -4.7%	
FY24 Electric \$/GSF= \$ 0.46			FY24 Thermal \$/GSF= \$ 0.13			FY24 Energy \$/GSF= \$ 0.59			05-24 kwh -40.3%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	51,700	21,820	16,593	38,413	0.0%	48.12	100.0%	100.0%	38,413	0.0%
FY06	51,700	17,874	15,805	33,679	-12.3%	48.65	95.8%	99.6%	32,861	-14.5%
FY07	51,700	17,292	15,116	32,409	-15.6%	47.46	94.4%	99.7%	31,395	-18.3%
FY08	51,700	19,546	15,136	34,681	-9.7%	46.19	83.7%	99.8%	31,463	-18.1%
FY09	51,700	21,049	14,688	35,737	-7.0%	45.66	84.6%	99.9%	32,486	-15.4%
FY10	51,700	25,076	7,050	32,126	-16.4%	47.10	98.5%	99.8%	31,735	-17.4%
FY11	51,700	26,493	5,634	32,127	-16.4%	46.81	86.1%	96.6%	28,247	-26.5%
FY12	51,700	20,825	5,595	26,420	-31.2%	51.51	113.2%	104.1%	29,394	-23.5%
FY13	51,700	26,236	5,630	31,866	-17.0%	47.29	88.7%	98.3%	28,806	-25.0%
FY14	51,700	32,906	5,943	38,850	1.1%	44.58	76.8%	98.7%	31,150	-18.9%
FY15	51,700	24,705	7,718	32,423	-15.6%	45.84	88.3%	98.7%	29,439	-23.4%
FY16	51,700	19,248	8,100	27,348	-28.8%	49.68	104.0%	100.9%	28,190	-26.6%
FY17	51,700	16,269	8,910	25,179	-34.5%	49.72	105.9%	100.5%	26,188	-31.8%
FY18	51,700	19,982	8,323	28,305	-26.3%	46.66	82.4%	98.7%	24,688	-35.7%
FY19	51,700	21,906	7,982	29,887	-22.2%	45.87	85.8%	98.4%	26,662	-30.6%
FY20	51,700	21,244	7,568	28,813	-25.0%	48.08	98.4%	99.8%	28,446	-25.9%
FY21	51,700	18,460	8,962	27,421	-28.6%	47.61	92.6%	98.8%	25,952	-32.4%
FY22	51,700	20,643	9,008	29,651	-22.8%	48.04	91.0%	98.9%	27,689	-27.9%
FY23	51,700	20,399	9,520	29,918	-22.1%	48.63	101.2%	100.0%	30,171	-21.5%
FY24	51,700	18,421	9,630	28,051	-27.0%	50.95	112.9%	102.8%	30,695	-20.1%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

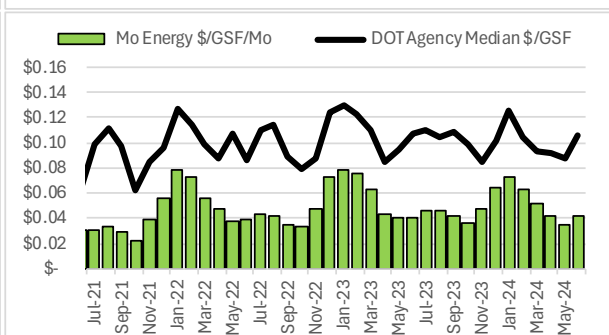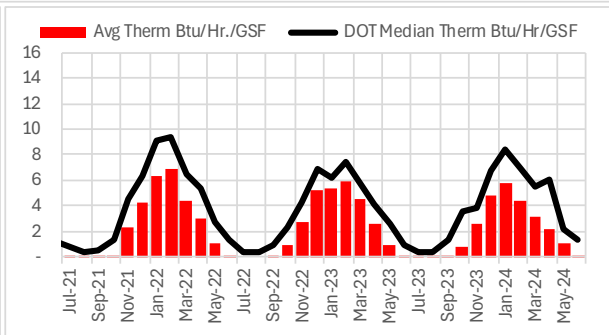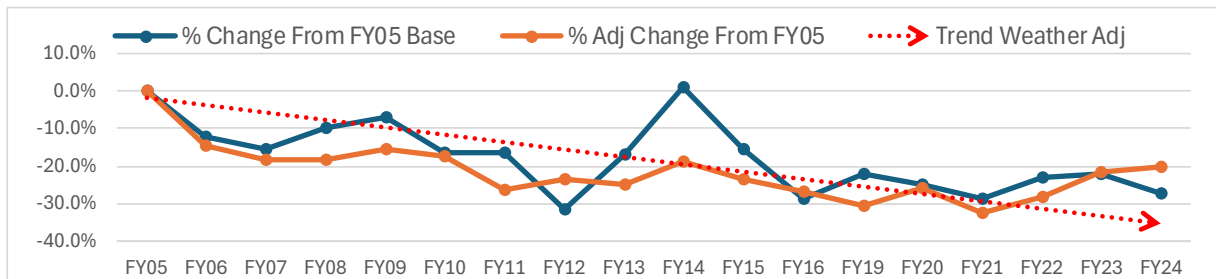

FY2024 DOT-PIERSTORFF B State Facilities Energy Report

FY24 Electric kwh/GSF= 1.27			FY24 Therm/GSF = 0.27			FY24 Total Btu/GSF= 31,269			05-24 Thm -11.3%	
FY24 Electric \$/GSF= \$ 0.26			FY24 Thermal \$/GSF= \$ 0.19			FY24 Energy \$/GSF= \$ 0.45			05-24 kwh -75.6%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	51,200	34,005	18,471	52,477	0.0%	48.12	100.0%	100.0%	52,477	0.0%
FY06	51,200	34,105	18,312	52,417	-0.1%	48.65	93.9%	99.5%	50,237	-4.3%
FY07	51,200	34,785	18,313	53,099	1.2%	47.46	94.3%	99.6%	51,051	-2.7%
FY08	51,200	38,093	18,159	56,252	7.2%	46.19	78.5%	98.9%	47,869	-8.8%
FY09	51,200	38,795	18,057	56,852	8.3%	45.66	82.4%	99.8%	49,973	-4.8%
FY10	51,200	37,770	9,926	47,697	-9.1%	47.10	96.1%	100.5%	46,281	-11.8%
FY11	51,200	41,260	8,743	50,003	-4.7%	46.81	86.7%	97.5%	44,292	-15.6%
FY12	51,200	33,145	8,074	41,219	-21.5%	51.51	111.9%	101.0%	45,254	-13.8%
FY13	51,200	42,499	8,561	51,060	-2.7%	47.29	88.6%	96.7%	45,918	-12.5%
FY14	51,200	49,041	8,731	57,772	10.1%	44.58	76.2%	97.3%	45,854	-12.6%
FY15	51,200	36,379	7,084	43,463	-17.2%	45.84	88.8%	98.3%	39,273	-25.2%
FY16	51,200	28,206	6,380	34,587	-34.1%	49.68	103.8%	100.3%	35,678	-32.0%
FY17	51,200	25,054	5,591	30,645	-41.6%	49.72	106.6%	100.4%	32,316	-38.4%
FY18	51,200	27,281	5,995	33,276	-36.6%	46.66	83.1%	98.3%	28,569	-45.6%
FY19	51,200	29,106	5,941	35,047	-33.2%	45.87	86.4%	97.7%	30,940	-41.0%
FY20	51,200	29,952	5,910	35,862	-31.7%	48.08	99.0%	99.9%	35,551	-32.3%
FY21	51,200	37,838	10,410	48,248	-8.1%	47.61	94.2%	97.3%	45,783	-12.8%
FY22	51,200	32,653	5,126	37,779	-28.0%	48.04	92.1%	97.7%	35,084	-33.1%
FY23	51,200	30,056	4,997	35,052	-33.2%	48.63	102.3%	101.2%	35,794	-31.8%
FY24	51,200	26,951	4,318	31,269	-40.4%	50.95	111.9%	104.5%	34,668	-33.9%






Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

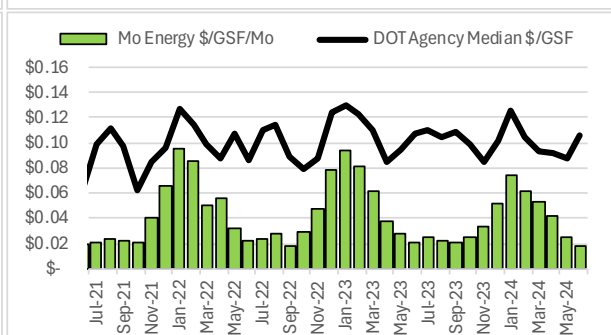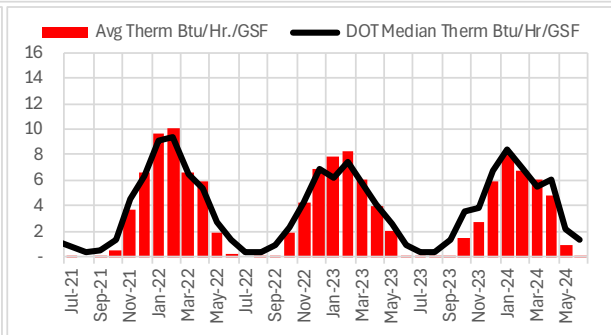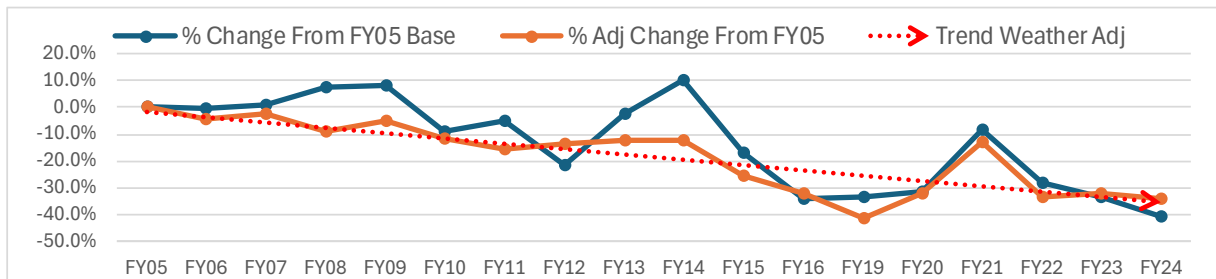

FY2024 DOT-West Allis State Facilities Energy Report



FY24 Electric kwh/GSF= 5.17			FY24 Therm/GSF = 0.21			FY24 Total Btu/GSF= 38,513			05-24 Thm -31.1%	
FY24 Electric \$/GSF= \$ 0.74			FY24 Thermal \$/GSF= \$ 0.15			FY24 Energy \$/GSF= \$ 0.89			05-24 kwh -22.0%	
Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	31,980	36,295	23,744	60,039	0.0%	48.47	100.0%	100.0%	60,039	0.0%
FY06	31,980	32,195	24,132	56,327	-6.2%	50.11	103.2%	102.0%	57,838	-3.7%
FY07	31,980	50,579	25,072	75,651	26.0%	48.88	100.1%	100.2%	75,753	26.2%
FY08	31,980	40,839	25,348	66,187	10.2%	47.87	89.2%	97.4%	61,129	1.8%
FY09	31,980	33,075	25,241	58,316	-2.9%	47.26	88.1%	97.5%	53,735	-10.5%
FY10	31,980	27,579	23,516	51,095	-14.9%	49.10	103.8%	101.1%	52,418	-12.7%
FY11	31,980	32,339	27,234	59,573	-0.8%	48.17	90.7%	97.6%	55,913	-6.9%
FY12	31,980	16,838	23,700	40,538	-32.5%	52.24	115.4%	107.3%	44,862	-25.3%
FY13	31,980	24,686	25,839	50,525	-15.8%	48.26	89.7%	97.8%	47,418	-21.0%
FY14	31,980	29,461	25,651	55,111	-8.2%	45.20	73.6%	93.1%	45,559	-24.1%
FY15	31,980	27,069	24,883	51,952	-13.5%	46.08	89.4%	96.3%	48,173	-19.8%
FY16	31,980	19,962	24,713	44,676	-25.6%	50.51	104.2%	103.7%	46,427	-22.7%
FY17	31,980	18,729	22,449	41,178	-31.4%	51.99	115.9%	103.4%	44,928	-25.2%
FY18	31,980	24,398	23,787	48,184	-19.7%	48.79	94.6%	98.8%	46,584	-22.4%
FY19	31,980	25,113	22,074	47,187	-21.4%	47.88	92.8%	98.3%	45,007	-25.0%
FY20	31,980	22,592	18,872	41,464	-30.9%	49.85	103.2%	102.1%	42,575	-29.1%
FY21	31,980	20,376	18,116	38,493	-35.9%	50.84	105.3%	101.1%	39,769	-33.8%
FY22	31,980	23,889	19,201	43,090	-28.2%	50.91	102.0%	99.5%	43,476	-27.6%
FY23	31,980	23,079	20,427	43,506	-27.5%	51.08	113.7%	103.9%	47,474	-20.9%
FY24	31,980	20,882	17,631	38,513	-35.9%	53.15	119.8%	105.1%	43,533	-27.5%

Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

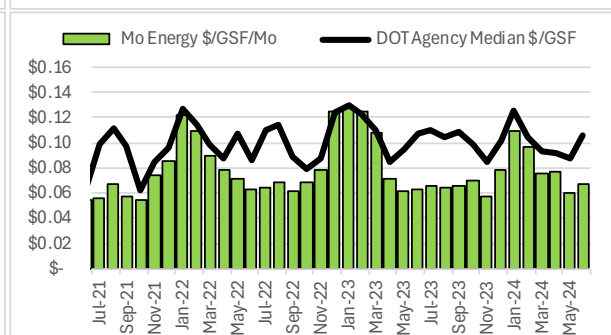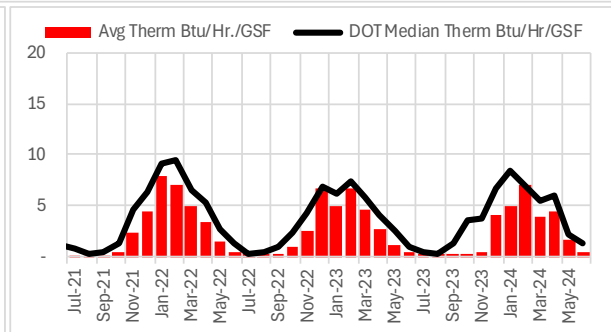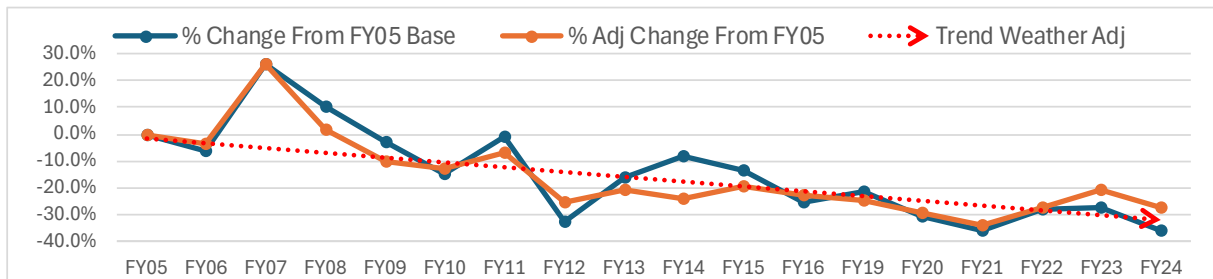



Military Affairs, Department of

Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024	
Electricity	\$	3,407,896	\$	3,091,147	\$	3,396,296	\$	3,949,214	\$	4,202,037
Coal	\$	-	\$	-	\$	-	\$	-	\$	-
Natural Gas	\$	1,365,815	\$	1,438,061	\$	2,018,340	\$	2,277,979	\$	1,512,402
Fuel Oil	\$	5,240	\$	-	\$	5,072	\$	2,033	\$	-
Other Fuels	\$	17,991	\$	23,292	\$	39,476	\$	50,036	\$	32,883
Steam/Heat	\$	43,260	\$	37,622	\$	88,283	\$	63,005	\$	90,691
Chilled Water	\$	-	\$	-	\$	-	\$	-	\$	-
Water & Sewage	\$	563,242	\$	537,150	\$	594,976	\$	644,795	\$	709,765
Total Utilities	\$	5,403,443	\$	5,127,272	\$	6,142,443	\$	6,987,062	\$	6,547,779

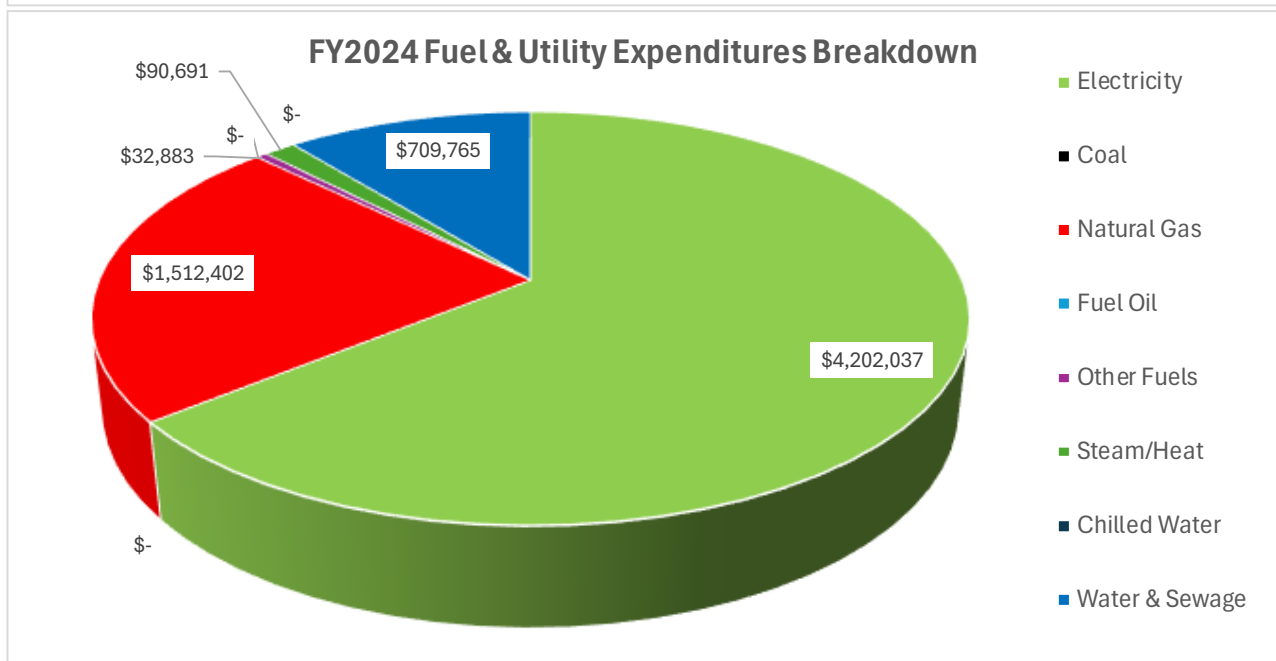
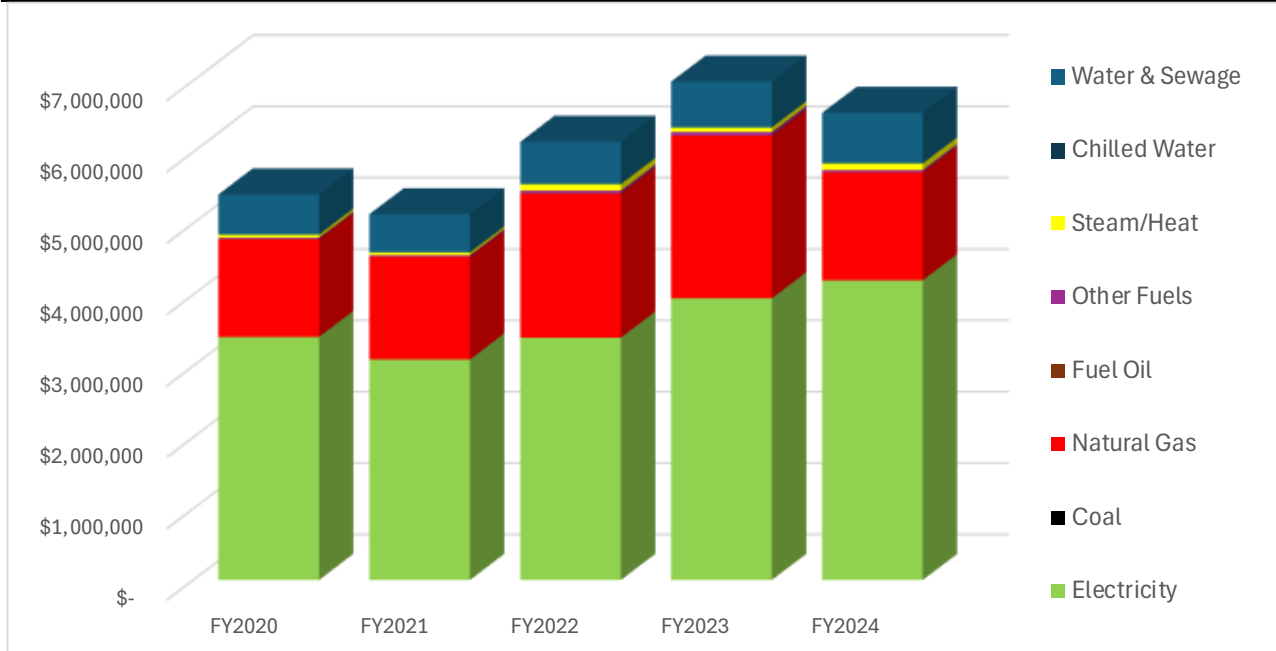


State Fair Park Board

Subcategory Name	FY2020	FY2021	FY2022	FY2023	FY2024
Electricity	\$ 828,698	\$ 1,006,173	\$ 965,131	\$ 1,445,350	\$ 1,114,171
Coal	\$ -	\$ -	\$ -	\$ -	\$ 1,373
Natural Gas	\$ 147,525	\$ 183,612	\$ 214,239	\$ 246,776	\$ 173,380
Fuel Oil	\$ -	\$ -	\$ -	\$ 2,920	\$ -
Other Fuels	\$ 38,222	\$ 10,973	\$ 16,785	\$ 32,048	\$ 3,517
Steam/Heat	\$ -	\$ -	\$ -	\$ -	\$ -
Chilled Water	\$ -	\$ -	\$ -	\$ -	\$ -
Water & Sewage	\$ 258,877	\$ 256,059	\$ 91,565	\$ 193,008	\$ 146,055
Total Utilities	\$ 1,273,322	\$ 1,456,817	\$ 1,287,721	\$ 1,920,102	\$ 1,438,495

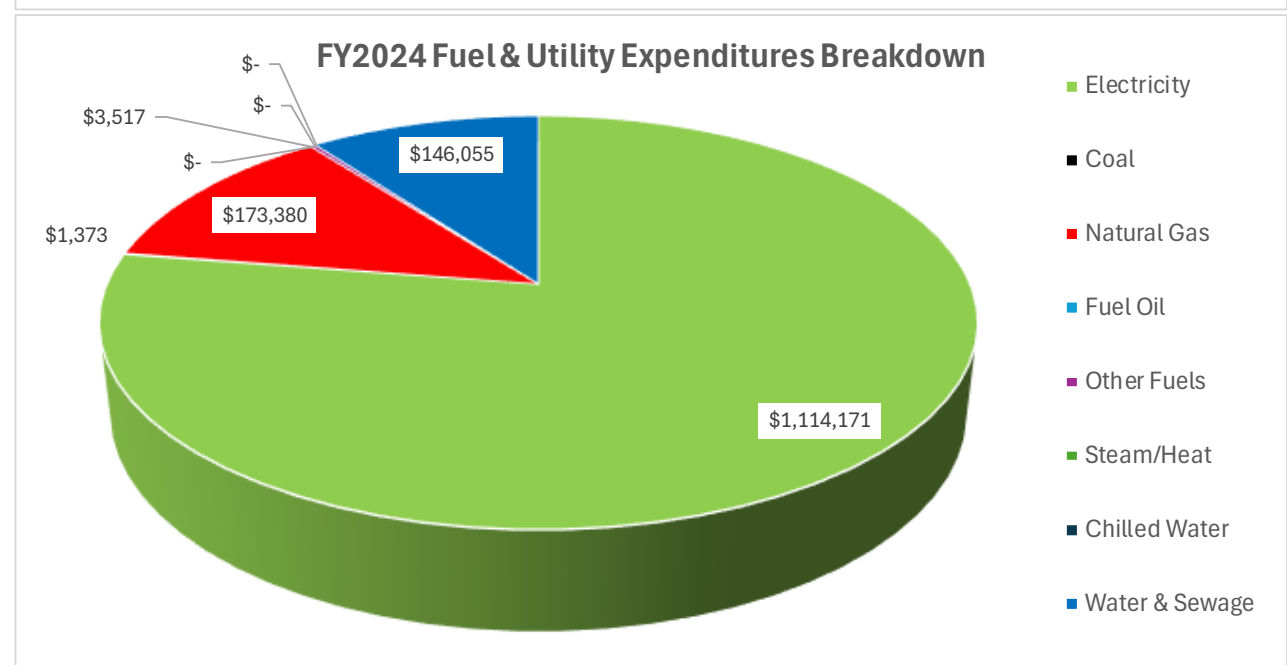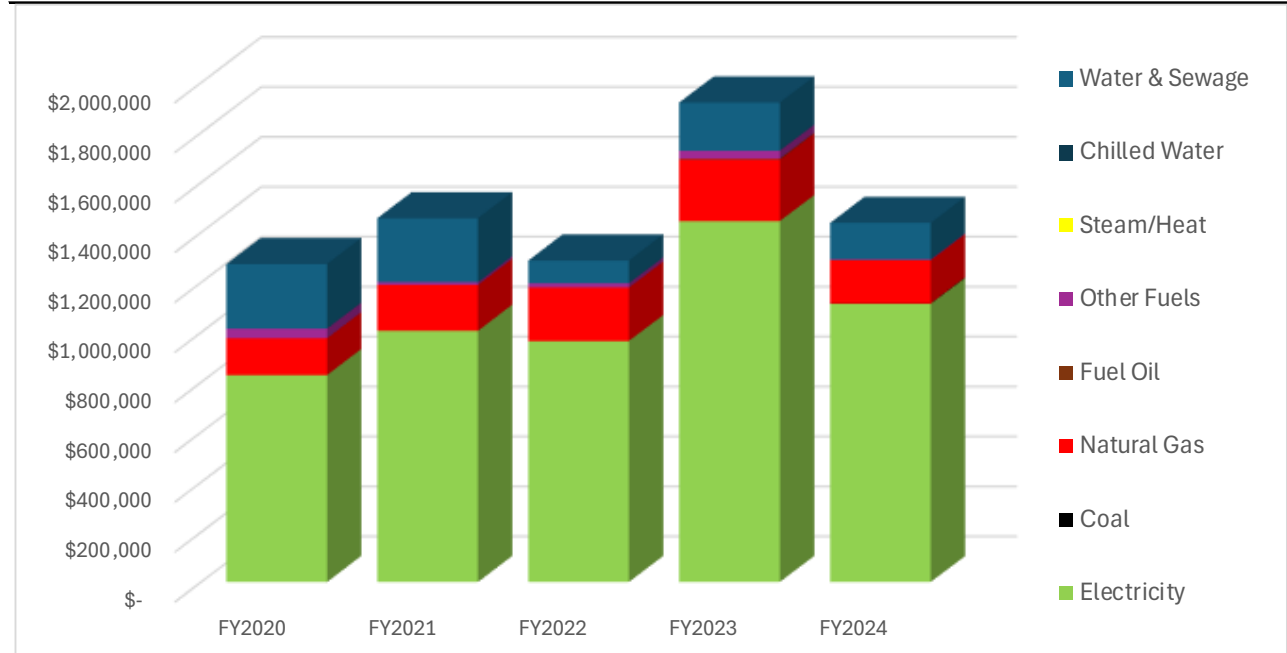

Historical Society									
Subcategory Name	FY2020		FY2021		FY2022		FY2023		FY2024
Electricity	\$	410,494	\$	302,582	\$	365,033	\$	470,378	\$ 451,764
Coal	\$	-	\$	-	\$	-	\$	-	\$ -
Natural Gas	\$	55,186	\$	53,050	\$	75,960	\$	94,808	\$ 60,027
Fuel Oil	\$	-	\$	469	\$	3,629	\$	6,495	\$ 897
Other Fuels	\$	45,703	\$	40,613	\$	67,639	\$	57,747	\$ 54,657
Steam/Heat	\$	61,800	\$	74,118	\$	82,857	\$	121,906	\$ 68,506
Chilled Water	\$	19,423	\$	12,983	\$	22,971	\$	27,454	\$ 18,669
Water & Sewage	\$	52,059	\$	43,063	\$	55,038	\$	55,256	\$ 57,043
Total Utilities	\$	644,664	\$	526,877	\$	673,127	\$	834,043	\$ 711,563

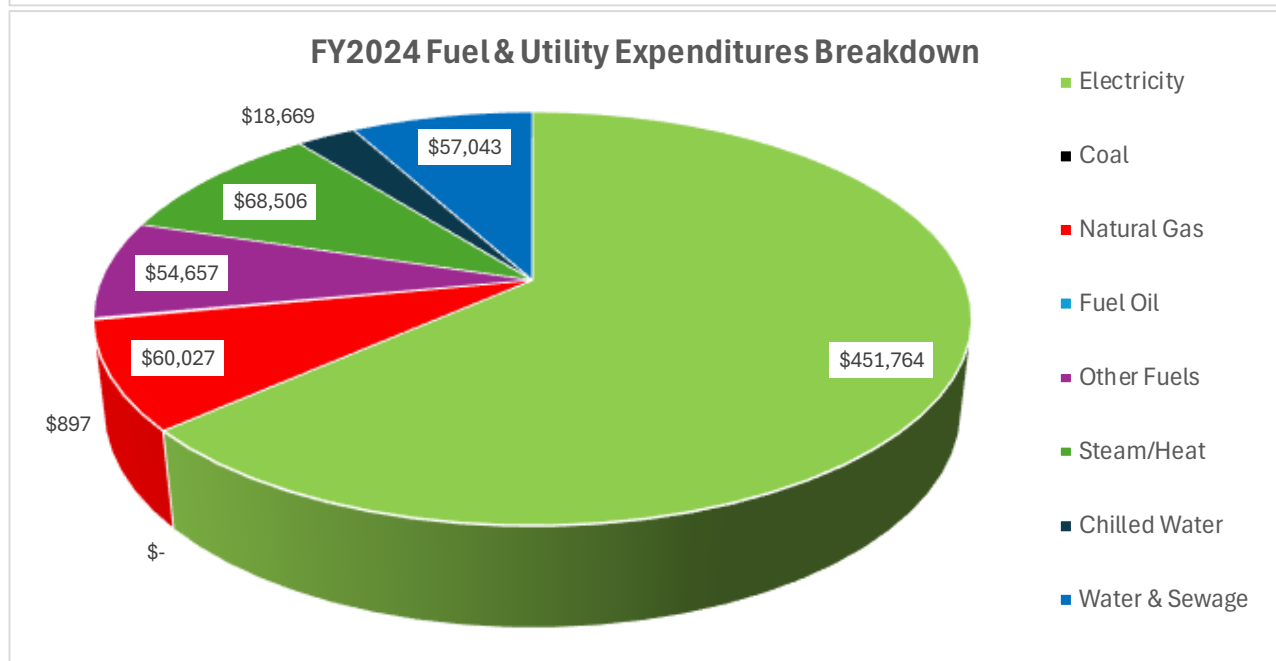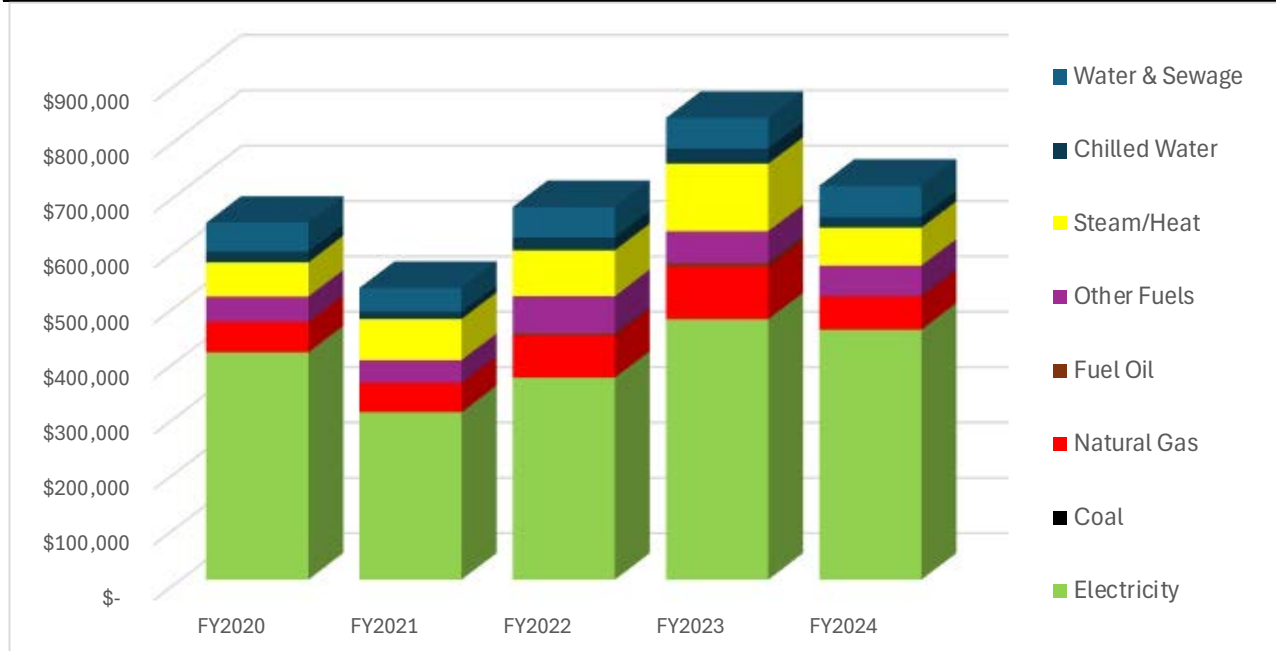

Benchmarking, Tracking and Managing Energy Use

Buildings that consistently benchmark energy performance save energy. The most common energy performance benchmarks are based on Btu energy use per Gross Square Feet (GSF) building area to measure the year-to-year changes in energy use and conservation efforts. Monitored building energy consumption is broken down into two categories:

- 1) Electricity, which includes utility purchases, central plant co-generated electricity & on-site renewable resource production such as PV solar; and
- 2) Thermal or Fossil Fuel, which includes natural gas, oil, propane, coal and other.

Energy consumption in these categories is checked through the coordination of monthly utility billings and energy consumption reports. All forms of energy consumption are converted to units of Btu/GSF/year. The conversion also removes any variation in energy use over time caused by changes in the size of an individual institution or facility. Electricity consumption is converted from metered kWh to Btu/GSF/Year by multiplying the total fiscal year metered kWh of electricity by 3,413 (Btu/kwh standard conversion factor) and then dividing the resulting number by the gross square footage (GSF) of serviced building area. Fossil fuel energy use is converted to units of Btu/GSF/Year by dividing the Btu value of the fossil fuel category energy consumption by the gross square footage of serviced building area.

Weather has a significant impact upon energy consumption and should be considered when evaluating efficiencies. Annual heating and cooling degree days can change dramatically from location to location and year to year. Such changes can significantly affect the demand for heating and cooling systems of a facility.

Site and Source Energy Use Intensity (EUI) - Site EUI may be familiar with from your bills. Site EUI has a mixture of what is called primary energy (i.e., a raw fuel like natural gas) and secondary energy (i.e., a converted product like electricity or district steam/chilled water). Source energy provides the most equitable way to combine primary and secondary energy types into a single common unit, ensuring that no building receives either a credit or a penalty based on its energy source or utility.

The annual State Energy Report Site Energy Use Intensity (EUI) monthly/annual measures and benchmarks include:

- Fiscal Year Electricity Use (BTU/GSF/YR) - rate of electricity use with 3413 BTU per kWh conversion factor for the fiscal year, Fiscal Year 2024 (FY2024 or FY24) July 1, 2023, through June 30, 2024.
- Fiscal Year Fossil Fuel Use (BTU/GSF/YR) - rate of fossil fuel use for the 2024 fiscal year.
- FY24 Total Energy Use (BTU/GSF/YR) - rate of energy use data for the 2024 fiscal year.
- Latest Year Percent Change - the percent change in energy consumption from fiscal year 2023 to fiscal year 2024.
- Base Year Energy Use (BTU/GSF/YR) - rate of energy use for the base fiscal year FY2005.
- GSF (Gross Square Feet) - values used represent monitored gross square footage present on the last day of the fiscal year. GSF data received from the agencies and institutions.
- Electricity (BTU/GSF/YR) - values were obtained by multiplying kWh of purchased electricity by 3,413 Btu/kWh (a standard conversion factor) and then dividing by GSF. This value includes electricity cogenerated on site at the following facilities: Waupun

Correctional, Mendota Mental Health Institute, Winnebago Mental Health Institute and UW-Madison.

- Fossil Fuel (BTU/GSF/YR) - values were obtained by dividing the fossil fuel energy use (Btu) by the gross square feet (GSF) for the indicated year. Fossil Fuel includes natural gas, fuel oil, coal, purchased steam, wood and paper pellets. This energy is used for heating, cooling, and adjusting for cogenerating electricity, depending upon the energy systems used in the facility.
- Total BTU/GSF/YR - sum of the fossil fuel (Btu/GSF/Yr.) and the electricity (Btu/GSF/Yr.).
- % Change from Base - percentage change in the Total Btu/GSF/Yr. for FY2024 from Total Btu/GSF/Yr. of the base year, FY2005.
- Electric kwh/GSF = electricity energy use (kwh) per building area gross square feet (GSF).
- Electric Watt/GSF = electric power (1000 watt = 1 kw) per building GSF.
- Therm/GSF = thermal energy use (therm = 100,000 Btu) per building area GSF.
- Total Btu/GSF = total energy use (Btu) per building area GSF.
- Energy \$/GSF = energy costs \$ per building area GSF.
- Energy Use Intensity = EUI per ft² = Gross Square Feet (GSF) building area; kBtu = 1000 Btu; kwh = 1000 watthours; and therm =100,000 Btu.

Energy consumption rates are calculated using end-of-year GSF values. Therefore, if the total monitored gross square footage of a facility changes during the fiscal year, values for the rates of energy consumption will not be 100% accurate. The numbers become less accurate as the magnitude of the GSF change increases and the date of the change falls nearer the end of the fiscal year.

Annual EUI Benchmarks and Monthly Assessments – multiple year trends and comparisons to measure and identify potential savings with goals:

- Reduce weather adjusted energy use and costs year-to-year.
- Identify changes in energy use and costs.
- Evaluate energy use changes: 1) Results from Energy Conservation Measures; 2) Changes in Building Occupancy and Schedules; and/or 3) Changes in Building System Operation, Equipment Schedules, Controls or Set-Points.
- Recommendations for Improvements with Metering and Verification.

Electric Demand - Electric Demand is the rate of using electricity. For most commercial buildings, demand is measured in kilowatts (kW). Utilities measure the highest rate of electricity for using each billing cycle to adequately size the generation, transmission and distribution capacity required to provide energy to each customer. The utility then recoups these costs by billing based on highest measured demand, and when that demand occurs relative to when the utility experiences peak demand on their system.

NOTE: External factors should be considered when viewing this data. External factors include weather, space use, hours of occupancy, number of occupants, available maintenance funds, differences in facility design, number of plant and maintenance staff, and conservation funds allocated to the site.

Electric kwh/GSF = electricity energy use (kwh) per building area gross square feet per year.

Therm/GSF = thermal energy use (therm = 100,000 Btu) per building area gross square feet per year.

Total Btu/GSF = total energy use (Btu) per building area gross square feet per year. FY05-18 Thermal % Change

State Fiscal Year 2024 State Energy Report

FY24 Electric kwh/GSF = 12.32	FY24 Therm/GSF = 1.02	FY24 Total Btu/GSF = 143,913	05-24 Thm -25.5%
FY24 Electric \$/GSF = \$ 1.38	FY24 Thermal \$/GSF = \$ 0.45	FY24 Energy \$/GSF = \$ 1.83	05-24 kwh -14.1%

Electric \$/GSF = electric cost per building area gross square feet per year.

Thermal \$/GSF = thermal energy cost per building area gross square feet per year.

Energy \$/GSF = total energy cost per building area gross sq. feet per year. FY05-18 Electric % Change

Fiscal Year – period from July 1st through July 31st. Fiscal Year 2005 (FY05) base July 1, 2004, through July 31, 2005.

Gross Square Feet (GSF) – monitored building area gross square footage on last day of the fiscal year.

Site Thermal Btu/GSF - fossil fuel energy use (Btu) divided by the gross square feet (GSF) for the indicated year.

Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Mo Avg Temp	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	64,753,150	148,686	49,704	198,390	0.0%	47.39	100.0%	100.0%	198,390	0.0%
FY06	65,405,533	145,097	51,086	196,183	-1.1%	48.45	101.2%	100.6%	198,224	-0.1%
FY22	74,879,851	112,978	43,140	156,118	-21.3%	47.78	99.0%	101.5%	155,640	-21.5%
FY23	75,112,842	109,144	42,137	151,282	-23.7%	48.39	102.2%	100.5%	153,916	-22.4%
FY24	75,165,711	101,862	42,051	143,913	-27.5%	50.79	108.7%	101.6%	153,458	-22.6%


Energy Btu/GSF Benchmark Heat Mapping Color Coding (Red High and Green Best) - M&V Goal trend from Red/Yellow to Green.

Site Electricity Btu/GSF – electric energy use (Btu) divided by the gross square feet (GSF) for the fiscal year.

Site Total Btu/GSF – total energy use (Btu) divided by the gross square feet (GSF) for the fiscal year.


Percent change from FY2005 Base with and without weather adjustments.

Trend in site total energy use gross square feet (GSF) change from fiscal year 2005 baseline.

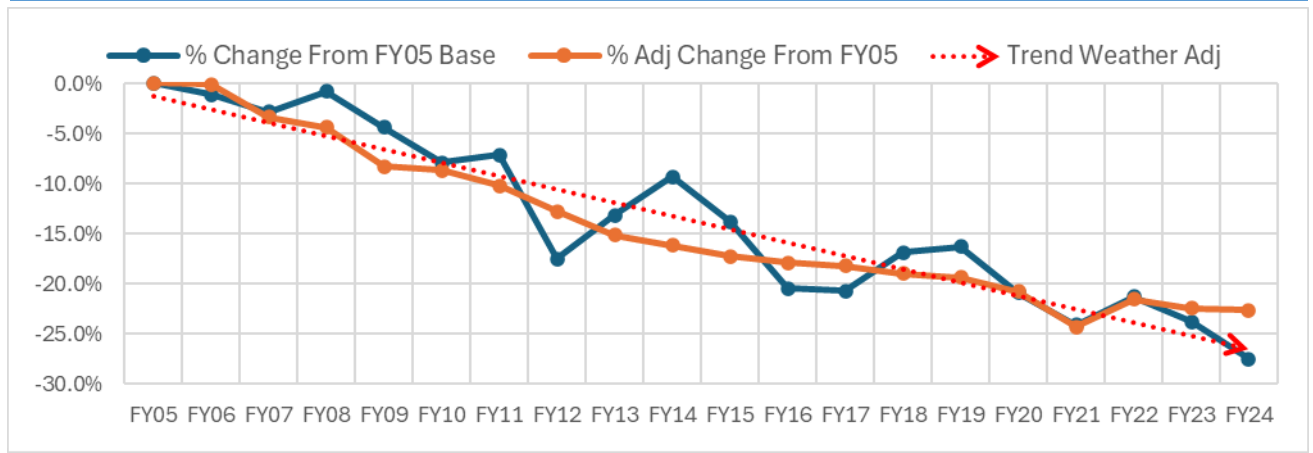

Below describe the monthly three year's monthly benchmarks and profiles presented below & herein:

- Monthly Electric Energy Use Average Watt per Gross Square Foot.
- Monthly Electric Demand Watt per Gross Square Foot.
- Monthly Agency Electric Median Average Watt per Gross Square Feet.
- Monthly Average Thermal Btu per Hour per Gross Square Feet.
- Monthly Agency Median Thermal Btu per Hour per Gross Square Feet.
- Monthly Total Energy Btu per Hour per Gross Square Feet.
- Monthly Agency Median Total Energy Btu per Hour per Gross Square Feet.
- Monthly Total Energy Cost per Hour per Gross Square Feet.
- Monthly Agency Median Total Energy Cost per Gross Square Feet.

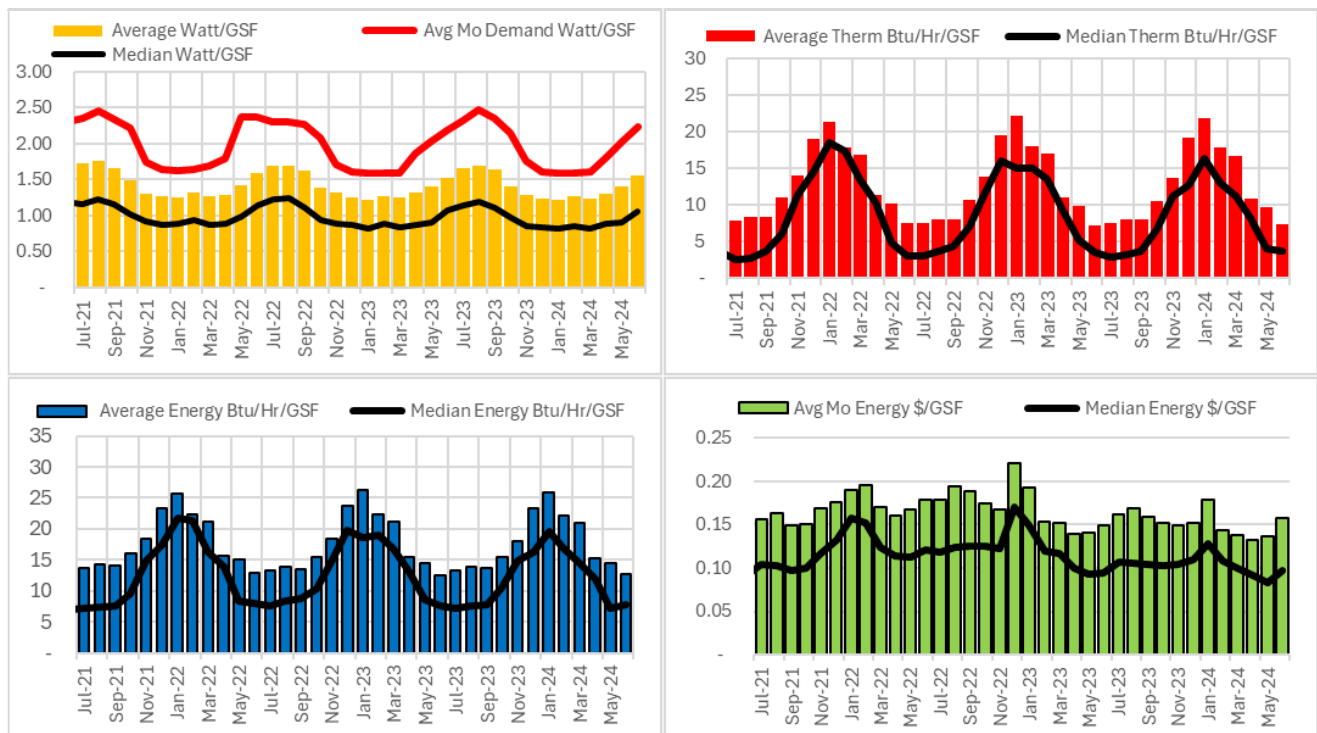

Facilities Energy Use Performance

Buildings with different functions and operating schedules have significantly different levels of energy use.

Examples:

The State Lab of Hygiene is a very highly ventilated laboratory space requiring 24/7 laboratory exhaust and supply to maintain safe operating conditions.

FY16 State Lab of Hygiene:

Building Area Gross Square Foot (GSF) = 160,344

Heating Energy Use = 196523 BTU per GSF

Electrical Energy Use = 141472 BTU per GSF

Total Rate of Energy Use = 337996 BTU per GSF

The DNR Northeast Regional Headquarters office in Green Bay and the DOA Green Bay State Office Building Have some of the lowest energy use per square foot of all the State of Wisconsin office buildings.

FY16 DNR Northeast Regional Headquarter:

Building Area Gross Square Foot (GSF) = 34,560

Heating Energy Use = 27640 BTU per GSF

Electrical Energy Use = 21836 BTU per GSF

Total Rate of Energy Use = 49476 BTU per GSF

FY16 DOA Green Bay State Office Building:

Building Area Gross Square Foot (GSF) = 69,052

Heating Energy Use = 19149 BTU per GSF

Electrical Energy Use = 24227 BTU per GSF

Total Rate of Energy Use = 43375 BTU per GSF

Fiscal Year 2024 State-Owned Facilities Energy Use and Cost Performance Benchmarks

Agency-Facility	FY2024 GSF	FY2024 Adjusted Thermal Btu/GSF/Yr	FY2024 Adjusted Electric Btu/GSF/Yr	FY2024 Adjusted Energy Btu/GSF/Yr	FY2005 Energy Btu/GSF/Yr	% FY05-FY24 Change Total Btu/GSF	FY2024 Thermal Cost \$/GSF	FY2024 Electric Cost \$/GSF	FY2024 Energy Cost \$/GSF
DHS-Mendota	1,320,211	191,340	29,401	220,741	273,839	-19.4%	\$ 0.71	\$ 1.08	\$ 1.79
DHS-Northern Center	523,226	121,238	32,140	153,378	169,938	-9.7%	\$ 0.53	\$ 0.90	\$ 1.43
DHS-Sand Ridge	308,828	92,519	48,977	141,497	155,053	-8.7%	\$ 0.36	\$ 1.27	\$ 1.63
DHS-Southern Center	1,023,235	117,076	28,999	146,075	177,385	-17.7%	\$ 0.40	\$ 0.94	\$ 1.34
DHS-Winnebago	983,900	113,952	33,082	147,035	174,596	-15.8%	\$ 0.38	\$ 0.85	\$ 1.23
DHS	4,159,400	138,609	31,971	170,580	204,184	-16.5%	\$ 0.51	\$ 0.98	\$ 1.49
DNR-Darwin Road	24,820	31,141	13,895	45,036	68,925	-34.7%	\$ 0.20	\$ 0.78	\$ 0.99
DNR-Green Bay	34,560	40,412	32,852	73,264			\$ 0.19	\$ 1.16	\$ 1.35
DNR-South Central	33,976	90,498	33,598	124,096	186,508	-33.5%	\$ 0.59	\$ 1.90	\$ 2.49
DNR-Tomahawk	36,741	66,829	23,530	90,358	75,049	20.4%	\$ 0.34	\$ 0.86	\$ 1.20
DNR	130,097	59,184	26,797	85,981	113,096	-24.0%	\$ 0.34	\$ 1.20	\$ 1.54
DOA-Air Services	17,898	78,803	10,908	89,711	115,262	-22.2%	\$ 0.51	\$ 0.53	\$ 1.04
DOA-Capitol Complex	2,013,307	110,773	30,804	141,577	169,826	-16.6%	\$ 0.35	\$ 1.20	\$ 1.55
DOA-Eau Claire SOB	56,206	48,315	20,965	69,280	77,936	-11.1%	\$ 0.29	\$ 0.82	\$ 1.11
DOA-Executive Residence	23,455	58,138	31,472	89,611	122,168	-26.6%	\$ 0.36	\$ 1.58	\$ 1.93
DOA-Green Bay SOB	69,206	33,387	13,987	47,374	57,083	-17.0%	\$ 0.17	\$ 0.54	\$ 0.71
DOA-Hill Farms	879,419	53,126	24,684	77,810	185,875	-58.1%	\$ 0.22	\$ 1.01	\$ 1.23
DOA-La Crosse SOB	45,965	31,483	18,876	50,360	67,468	-25.4%	\$ 0.19	\$ 0.72	\$ 0.90
DOA-Milwaukee SOB	201,200	32,588	28,423	61,011	76,115	-19.8%	\$ 0.45	\$ 1.26	\$ 1.71
DOA-Public Broadcasting	48,246	89,775	89,441	179,216	258,351	-30.6%	\$ 0.50	\$ 3.24	\$ 3.74
DOA-SE Crime Lab	43,935	101,648	88,907	190,555	120,490	58.2%	\$ 0.49	\$ 3.28	\$ 3.77
DOA-State Ag	118,011	42,297	23,252	65,549	90,538	-27.6%	\$ 0.21	\$ 1.31	\$ 1.52
DOA-State Hygiene Lab	160,344	214,375	150,864	365,239	473,969	-22.9%	\$ 0.87	\$ 5.91	\$ 6.78
DOA-State Revenue	247,224	38,293	21,795	60,088	134,734	-55.4%	\$ 0.18	\$ 0.98	\$ 1.16
DOA-Waukesha SOB	169,976	23,165	20,260	43,425	101,737	-57.3%	\$ 0.10	\$ 0.88	\$ 0.98
DOA-WI Rapids SOB	51,552	36,333	18,428	54,760	78,136	-29.9%	\$ 0.21	\$ 0.72	\$ 0.93
DOA-Femrite Data Center	56,987	55,075	389,167	444,242			\$ 0.31	\$ 13.28	\$ 13.60
DOA-Archive & Preservation	182,803	142,072	88,768	230,840			\$ 0.63	\$ 3.02	\$ 3.65
DOA-Thompson Center	155,823	55,560	42,796	98,356			\$ 0.26	\$ 1.64	\$ 1.90
DOA	4,541,557	85,158	40,383	125,542	160,181	-21.6%	\$ 0.33	\$ 1.57	\$ 1.90
DOC-Boscobel	195,000	108,663	58,683	167,346	183,488	-8.8%	\$ 0.54	\$ 1.39	\$ 1.93
DOC-Columbia	330,807	86,988	45,915	132,904	162,805	-18.4%	\$ 0.35	\$ 1.20	\$ 1.54
DOC-Fox Lake	533,407	149,468	33,144	182,612	189,382	-3.6%	\$ 0.53	\$ 0.94	\$ 1.46
DOC-Green Bay	453,750	138,906	30,813	169,719	178,856	-5.1%	\$ 0.46	\$ 0.79	\$ 1.24
DOC-Jackson	390,613	121,658	44,895	166,554	179,907	-7.4%	\$ 0.57	\$ 1.18	\$ 1.75
DOC-Kettle Moraine	361,612	148,711	42,973	191,685	194,910	-1.7%	\$ 0.48	\$ 0.92	\$ 1.40
DOC-Lincoln Hills	249,792	129,838	31,603	161,441	154,781	4.3%	\$ 0.44	\$ 0.79	\$ 1.23
DOC-Milwaukee Secure	413,011	59,210	27,459	86,669	88,479	-2.0%	\$ 0.81	\$ 0.95	\$ 1.77
DOC-New Lisbon	316,878	120,240	56,502	176,742	224,158	-21.2%	\$ 0.49	\$ 1.59	\$ 2.08
DOC-Oakhill	348,153	147,295	32,136	179,430	157,326	14.1%	\$ 0.54	\$ 0.90	\$ 1.43
DOC-Oshkosh	890,187	111,052	32,453	143,505	154,357	-7.0%	\$ 0.35	\$ 0.81	\$ 1.16
DOC-Prairie du Chien	383,100	70,044	15,859	85,903	121,679	-29.4%	\$ 0.29	\$ 0.44	\$ 0.73
DOC-Racine	409,046	95,237	49,094	144,331	174,029	-17.1%	\$ 0.32	\$ 1.49	\$ 1.81
DOC-Racine Youth	207,697	63,854	30,811	94,665	123,239	-23.2%	\$ 0.24	\$ 1.12	\$ 1.35
DOC-Redgranite	310,135	107,449	50,251	157,700	213,425	-26.1%	\$ 0.40	\$ 1.32	\$ 1.73
DOC-Stanley	411,897	117,390	45,126	162,516	204,540	-20.5%	\$ 0.50	\$ 1.39	\$ 1.89
DOC-Sturtevant	93,312	92,762	40,338	133,100	185,937	-28.4%	\$ 0.35	\$ 1.31	\$ 1.66
DOC-Taycheedah	380,940	70,685	31,141	101,826	118,910	-14.4%	\$ 0.25	\$ 0.85	\$ 1.10
DOC-Waupun	1,260,274	161,934	34,440	196,374	245,233	-19.9%	\$ 0.58	\$ 1.21	\$ 1.79
DOC	7,939,611	118,335	37,073	155,408	178,489	-12.9%	\$ 0.46	\$ 1.06	\$ 1.52

Fiscal Year 2024 State-Owned Facilities Energy Use and Cost Performance Benchmarks

Agency-Facility	FY2024 GSF	FY2024 Adjusted Thermal Btu/GSF/Yr	FY2024 Adjusted Electric Btu/GSF/Yr	FY2024 Adjusted Energy Btu/GSF/Yr	FY2005 Energy Btu/GSF/Yr	% FY05-FY24 Change Total Btu/GSF	FY2024 Thermal Cost \$/GSF	FY2024 Electric Cost \$/GSF	FY2024 Energy Cost \$/GSF
DOT-DTD 1 Lab	43,000	72,521	63,716	136,238	246,311	-44.7%	\$ 0.41	\$ 2.88	\$ 3.28
DOT-DTD 1 Madison	56,000	43,676	25,722	69,398	113,762	-39.0%	\$ 0.26	\$ 1.30	\$ 1.56
DOT-Green Bay	40,515	76,479	50,580	127,058	138,919	-8.5%	\$ 0.37	\$ 1.44	\$ 1.82
DOT-PIERSTORFF A	51,700	20,795	9,900	30,695	38,413	-20.1%	\$ 0.13	\$ 0.46	\$ 0.59
DOT-PIERSTORFF B	51,200	30,153	4,514	34,668	52,477	-33.9%	\$ 0.19	\$ 0.26	\$ 0.45
DOT-West Allis	31,980	25,011	18,522	43,533	60,039	-27.5%	\$ 0.15	\$ 0.74	\$ 0.89
DOT	274,395	44,030	27,569	71,599	106,355	-32.7%	\$ 0.25	\$ 1.15	\$ 1.40
DPI-Delavan	244,979	74,957	21,532	96,489	101,462	-4.9%	\$ 0.27	\$ 0.72	\$ 0.99
DPI-Janesville	196,204	70,842	13,634	84,476	93,680	-9.8%	\$ 0.27	\$ 0.50	\$ 0.77
DPI	441,183	73,127	18,020	91,147	98,001	-7.0%	\$ 0.27	\$ 0.62	\$ 0.89
DVA-King	733,728	170,079	46,631	216,709	197,411	9.8%	\$ 0.57	\$ 1.30	\$ 1.86
DVA-King	733,728	170,079	46,631	216,709	197,411	9.8%	\$ 0.57	\$ 1.30	\$ 1.86
UW-Eau Claire	2,729,192	74,709	26,198	100,907	149,148	-32.3%	\$ 0.31	\$ 0.77	\$ 1.08
UW-Green Bay	1,386,058	83,297	33,533	116,830	174,522	-33.1%	\$ 0.26	\$ 0.94	\$ 1.21
UW-La Crosse	3,209,701	89,755	33,145	122,900	150,442	-18.3%	\$ 0.42	\$ 1.00	\$ 1.42
UW-Madison	23,144,475	140,507	63,271	203,778	294,776	-30.9%	\$ 0.63	\$ 2.31	\$ 2.94
UW-Milwaukee	6,204,204	88,409	39,366	127,775	171,927	-25.7%	\$ 0.33	\$ 1.23	\$ 1.56
UW-Oshkosh	3,288,596	83,617	24,862	108,479	136,452	-20.5%	\$ 0.25	\$ 0.66	\$ 0.91
UW-Parkside	1,374,576	80,911	25,651	106,561	146,123	-27.1%	\$ 0.27	\$ 0.88	\$ 1.15
UW-Platteville	2,233,502	99,801	27,807	127,608	139,216	-8.3%	\$ 0.39	\$ 0.80	\$ 1.18
UW-River Falls	1,684,447	87,155	11,335	98,490	124,558	-20.9%	\$ 0.41	\$ 0.32	\$ 0.73
UW-Stevens Point	2,806,271	125,534	25,440	150,974	164,136	-8.0%	\$ 0.41	\$ 0.68	\$ 1.09
UW-Stout	2,456,060	73,619	25,799	99,418	113,062	-12.1%	\$ 0.32	\$ 0.79	\$ 1.11
UW-Superior	1,107,876	109,535	28,026	137,561	162,010	-15.1%	\$ 0.52	\$ 0.76	\$ 1.28
UW-Whitewater	3,114,162	102,042	36,515	138,557	145,867	-5.0%	\$ 0.35	\$ 1.12	\$ 1.48
UW-Eau Claire, Barron	146,683	78,934	21,640	100,575	93,920	7.1%	\$ 0.40	\$ 0.61	\$ 1.01
UW-Green Bay, Manitowoc	125,045	45,628	17,217	62,846	74,988	-16.2%	\$ 0.23	\$ 0.44	\$ 0.68
UW-Green Bay, Marinette	139,818	42,434	3,846	46,279	131,496	-64.8%	\$ 0.18	\$ 0.14	\$ 0.33
UW-Green Bay, Sheboygan	228,544	46,713	26,019	72,733	102,754	-29.2%	\$ 0.21	\$ 0.92	\$ 1.13
UW-Milwaukee, Washington	199,117	40,454	16,189	56,643	75,321	-24.8%	\$ 0.19	\$ 0.70	\$ 0.89
UW-Milwaukee, Waukesha	277,016	63,042	21,411	84,452	94,752	-10.9%	\$ 0.24	\$ 0.84	\$ 1.08
UW-Oshkosh, Fond du Lac	194,077	39,150	16,177	55,327	94,053	-41.2%	\$ 0.22	\$ 0.31	\$ 0.52
UW-Oshkosh, Fox Cities	277,988	23,047	23,590	46,637	113,923	-59.1%	\$ 0.10	\$ 0.84	\$ 0.93
UW-Platteville, Baraboo	179,291	45,018	20,834	65,852	88,823	-25.9%	\$ 0.27	\$ 0.68	\$ 0.95
UW-Platteville, Richland	-			-	116,252	-100.0%			\$ -
UW-Stevens Point, Marshfield	153,555	87,922	29,808	117,730	103,850	13.4%	\$ 0.41	\$ 0.84	\$ 1.24
UW-Stevens Point, Wausau	327,695	58,942	18,470	77,412	119,478	-35.2%	\$ 0.21	\$ 0.61	\$ 0.83
UW-Whitewater, Rock	191,592	47,163	17,186	64,349	73,445	-12.4%	\$ 0.21	\$ 0.66	\$ 0.87
UW	57,179,541	109,469	43,005	152,474	206,711	-26.2%	\$ 0.46	\$ 1.45	\$ 1.91
State Facilities Total	75,399,512	110,598	41,419	152,017	198,868	-23.6%	\$ 0.45	\$ 1.39	\$ 1.84

Appendix A - Weather Adjustments and Degree Days

Beginning in FY2024 the State Energy Report weather adjustments were recalculated and based on weather data for the closest first-order cities Milwaukee, Madison, Green Bay, Eau Claire, La Crosse, or Wausau because they have weather and climate data reporting stations based at airports operated by the National Weather Service (NWS) and Federal Aviation Administration (FAA). These stations collect hourly information and provide a more extensive variety of published climate data than the volunteer cooperative observer network. The historical degree day and monthly average daily average temperature data was obtained from the Wisconsin State Climatology Office.

<https://climatology.nelson.wisc.edu/wisconsin-historic-climate-data/>

A degree-day is a unit of measure representing one degree of declination from 65°F in the mean daily outdoor temperature. It is simply a way of measuring how hot or cold it has been over a 24-hour period. Whenever the average (or mean) temperature is below 65 degrees Fahrenheit, you have a heating degree day. Whenever the average is above 65-degree Fahrenheit, you have a cooling degree day.


If in a 24-hour period the high outside temperature was 70 degrees and the low was 50 degrees, then the mean temperature for that day was 60 degrees - halfway between 70 and 50 degrees. This is 5 degrees less than the base temperature of 65. Therefore, we can say that there was 5 heating degree days (HDD) for the period.

If in a 24-hour period the high outside temperature was 80 degrees and the low was 60 degrees, then the mean temperature for that day was 70 degrees - halfway between 60 and 80 degrees. This is 5 degrees more than the base temperature of 65. Therefore, we can say that there were 5 cooling degree days (CDD) for the period.


There is a direct relationship between heating degree days and the amount of energy required to heat a residence. As HDD increases, the fuel bills to heat a typical building will also likely increase. The opposite is true for CDD. Once the average daily temperature is above 65°, homes start using air conditioning. Higher cooling degree days mean the air conditioner stays on longer to keep the occupant comfortable resulting in higher cooling costs.

Similar to a modified degree day method, the state energy reports weather adjustments were based on polynomial equation curve fits of thermal and electric energy use versus mean monthly temperatures curve fit “models” to determine the weather adjustment factors. A widely used statistic to gauge the goodness-of-fit of the model is the coefficient of determination R^2 . A value of $R^2 = 1$ indicates a perfect correlation between actual data and the regression equation; a value of $R^2 = 0$ indicates no correlation. As a rule of thumb, the value of R^2 should never be less than 0.75. In general, the thermal energy use for winter heating resulted in good correlation with R^2 greater than 0.90 while electric energy use correlation did not correlate as well with R^2 around 0.75. However, the weather-adjusted electric factors were small and did not significantly affect overall weather-adjustments.

The relationships between thermal energy use to degree days and temperatures for a sample facility (DOA-Milwaukee State Office Building) are shown graphically below:

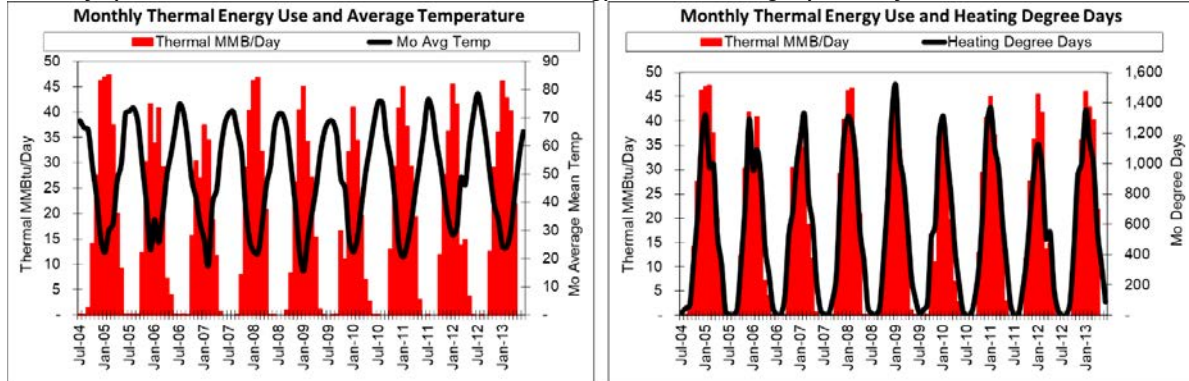

The relationships between electric energy use to degree days and temperatures for a sample facility (DOA-Milwaukee State Office Building) are shown graphically below:

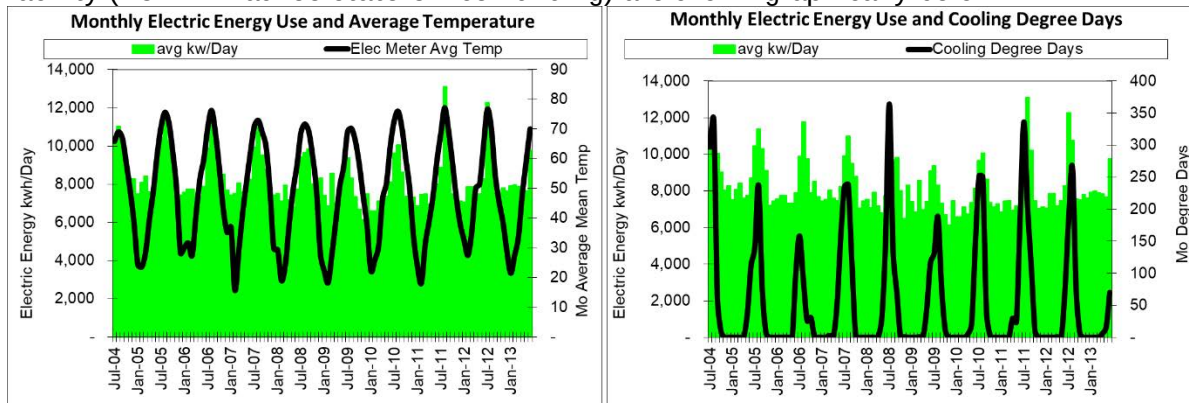

As can be seen above, close to 100% of thermal energy is dependent on weather for winter space heating. However, approximately 10% of electric use is dependent on weather and varies with summer temperature for air conditioning building cooling. The ratio of annual Wisconsin heating degree day comparisons to FY2005 base year provides an indication of anticipated weather adjustments for a building's thermal energy:

HDD Comparison to FY2005 Baseline							
Fiscal Year	Milwaukee Daily HDD	Madison Daily HDD	Green Bay Daily HDD	Eau Claire Daily HDD	La Crosse Daily HDD	Wausau Daily HDD	Average HDD
FY2005	100%	100%	100%	100%	100%	100%	100%
FY2006	94%	99%	94%	93%	95%	94%	95%
FY2007	100%	104%	97%	100%	101%	99%	100%
FY2008	105%	112%	106%	113%	114%	109%	110%
FY2009	107%	113%	112%	114%	113%	110%	112%
FY2010	96%	103%	97%	100%	103%	95%	99%
FY2011	105%	110%	108%	112%	112%	108%	109%
FY2012	85%	87%	84%	88%	86%	86%	86%
FY2013	105%	109%	105%	112%	112%	106%	108%
FY2014	119%	121%	120%	124%	122%	120%	121%
FY2015	110%	111%	107%	110%	106%	109%	109%
FY2016	91%	93%	90%	92%	89%	87%	90%
FY2017	86%	94%	88%	95%	86%	93%	90%
FY2018	101%	109%	103%	112%	104%	107%	106%
FY2019	106%	113%	106%	117%	111%	112%	111%
FY2020	97%	103%	100%	103%	100%	104%	101%
FY2021	93%	106%	96%	102%	99%	98%	99%
FY2022	92%	103%	98%	106%	102%	97%	100%
FY2023	89%	99%	94%	102%	99%	94%	96%
FY2024	79%	88%	82%	86%	83%	84%	84%


The ratio of annual cooling degree day comparisons to FY2005 base year provides an indication of anticipated weather adjustments for approximately 10% of a building's electrical energy:

CDD Comparison to FY2005 Baseline							
Fiscal Year	Milwaukee Daily HDD	Madison Daily HDD	Green Bay Daily HDD	Eau Claire Daily HDD	La Crosse Daily HDD	Wausau Daily HDD	Average HDD
FY2005	100%	100%	100%	100%	100%	100%	100%
FY2006	146%	128%	119%	147%	129%	137%	134%
FY2007	131%	118%	121%	151%	131%	121%	129%
FY2008	123%	116%	115%	107%	112%	112%	114%
FY2009	105%	97%	100%	95%	95%	95%	98%
FY2010	93%	72%	62%	66%	78%	66%	74%
FY2011	144%	139%	127%	126%	125%	122%	131%
FY2012	168%	163%	160%	144%	141%	148%	154%
FY2013	148%	157%	141%	136%	126%	151%	142%
FY2014	112%	128%	108%	133%	132%	120%	123%
FY2015	77%	93%	71%	82%	103%	62%	84%
FY2016	122%	120%	117%	111%	127%	120%	120%
FY2017	170%	128%	120%	109%	134%	101%	129%
FY2018	134%	111%	119%	115%	155%	105%	126%
FY2019	134%	113%	119%	100%	127%	113%	119%
FY2020	149%	127%	133%	110%	142%	101%	129%
FY2021	173%	141%	157%	152%	159%	151%	156%
FY2022	175%	138%	139%	126%	147%	162%	148%
FY2023	143%	121%	135%	130%	137%	149%	136%
FY2024	156%	133%	126%	113%	122%	113%	128%

Sample Monthly Weather Adjustment Calculation:

To account for the facility's weather adjustment energy use, the relationship between monthly temperature and energy use were evaluated by graphing the energy use as a function of temperature and calculating the curve fit. The example results shown to the right indicate that no heating energy is required above 61.5 degrees (temperature curve intercept). The R-Squared (R^2) is a statistical term saying how good one term is at predicting another. Note the R^2 for this example is 0.91 close to 1.0 and good curve fit. For this example, if the temperature was 25 degrees in FY05 base year month and 20 degrees in FY16, the adjustment factor would be calculated as:

- FY05 Month Thermal Use = $-0.92 * 25 + 62.03 = 39.03$ MMBtu/Day
- FY16 Month Thermal Use = $-0.92 * 20 + 62.03 = 43.63$ MMBtu/Day
- FY16 Adjustment Factor = $39.03 / 43.63 = 0.895$, the FY13 adjustment multiplier
- FY16 Weather Adjusted Use = $43.63 * 0.895 = 39.05$ MMBtu/Day or FY05 Base

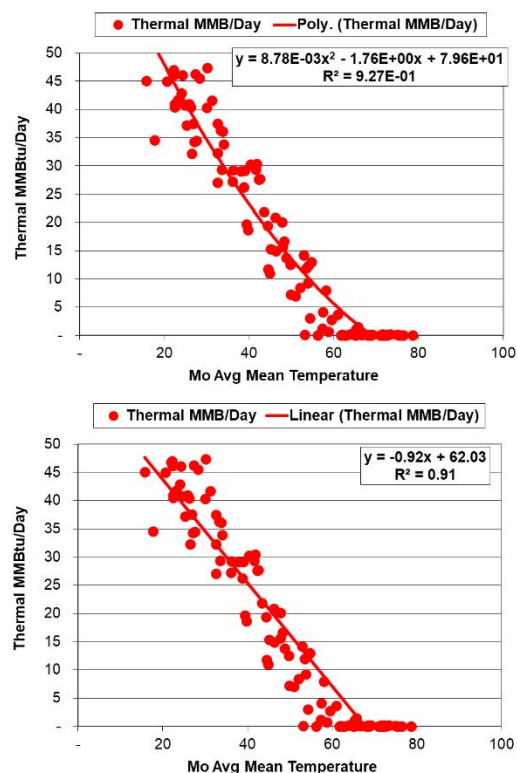

Similar method was used for monthly weather adjustments presented in this report but were based on second order polynomial equation curve fit. The same data above is plotted with at left with second order polynomial curve fit with a somewhat better R^2 than the linear equation in the above example. The weather-adjusted electric factors were small and did not significantly affect overall weather-adjustments.

Appendix B - Degree Days Data for Wisconsin First Order Weather Stations

Wisconsin Fiscal Year Heating Degree Days with Comparison to FY2005 Baseline								
Fiscal Year	Milwaukee Daily HDD	Madison Daily HDD	Green Bay Daily HDD	Eau Claire Daily HDD	La Crosse Daily HDD	Wausau Daily HDD	Average HDD	Ratio to FY05 Base
FY2005	6,517	6,642	7,323	7,410	6,691	7,809	7,065	100%
FY2006	6,155	6,587	6,886	6,904	6,384	7,309	6,704	95%
FY2007	6,488	6,928	7,111	7,440	6,761	7,765	7,082	100%
FY2008	6,872	7,453	7,743	8,382	7,606	8,530	7,764	110%
FY2009	6,962	7,512	8,203	8,418	7,566	8,607	7,878	112%
FY2010	6,236	6,828	7,107	7,413	6,861	7,431	6,979	99%
FY2011	6,849	7,320	7,921	8,295	7,469	8,401	7,709	109%
FY2012	5,527	5,773	6,173	6,484	5,783	6,720	6,077	86%
FY2013	6,829	7,237	7,714	8,300	7,471	8,252	7,634	108%
FY2014	7,742	8,057	8,771	9,167	8,136	9,340	8,536	121%
FY2015	7,197	7,367	7,833	8,134	7,066	8,485	7,680	109%
FY2016	5,909	6,198	6,622	6,843	5,953	6,813	6,390	90%
FY2017	5,634	6,218	6,414	7,006	5,771	7,267	6,385	90%
FY2018	6,559	7,207	7,569	8,285	6,988	8,323	7,489	106%
FY2019	6,893	7,501	7,750	8,688	7,450	8,752	7,839	111%
FY2020	6,299	6,826	7,313	7,630	6,664	8,094	7,138	101%
FY2021	6,030	7,013	7,057	7,559	6,647	7,647	6,992	99%
FY2022	6,028	6,853	7,164	7,864	6,820	7,576	7,051	100%
FY2023	5,795	6,551	6,867	7,552	6,592	7,351	6,785	96%
FY2024	5,151	5,819	5,998	6,342	5,553	6,552	5,903	84%
Wisconsin Fiscal Year Cooling Degree Days with Comparison to FY2005 Baseline								
Fiscal Year	Milwaukee Daily CDD	Madison Daily CDD	Green Bay Daily CDD	Eau Claire Daily CDD	La Crosse Daily CDD	Wausau Daily CDD	Average CDD	Ratio to FY05 Base
FY2005	588	589	474	527	748	435	560	100%
FY2006	857	753	563	773	966	598	752	134%
FY2007	768	693	573	796	983	527	723	129%
FY2008	721	683	545	562	839	488	640	114%
FY2009	618	571	474	500	709	413	548	98%
FY2010	549	424	294	349	580	285	414	74%
FY2011	849	819	604	662	935	530	733	131%
FY2012	986	958	760	760	1,055	642	860	154%
FY2013	873	922	667	716	942	659	797	142%
FY2014	658	752	514	700	984	520	688	123%
FY2015	455	548	335	431	773	268	468	84%
FY2016	719	706	555	586	953	521	673	120%
FY2017	998	751	567	573	1,006	441	723	129%
FY2018	786	655	564	606	1,159	455	704	126%
FY2019	788	667	564	528	947	492	664	119%
FY2020	874	749	632	580	1,059	438	722	129%
FY2021	1,018	829	742	800	1,193	658	873	156%
FY2022	1,031	815	659	664	1,099	706	829	148%
FY2023	843	715	640	686	1,024	650	760	136%
FY2024	919	782	595	597	912	492	716	128%

Wisconsin FY24 Monthly Heating Degree Days with Comparison to FY05 Baseline							
FY2005	Milwaukee Daily HDD	Madison Daily HDD	Green Bay Daily HDD	Eau Claire Daily HDD	La Crosse Daily HDD	Wausau Daily HDD	Average Daily HDD
Jul-04	19	11	30	16	9	34	20
Aug-04	48	72	89	104	54	123	82
Sep-04	66	82	82	93	64	98	81
Oct-04	369	418	458	475	422	534	446
Nov-04	675	738	770	831	766	853	772
Dec-04	1,161	1,200	1,288	1,363	1,274	1,394	1,280
Jan-05	1,318	1,400	1,480	1,517	1,466	1,582	1,461
Feb-05	973	995	1,083	1,117	1,014	1,147	1,055
Mar-05	997	1,010	1,168	1,134	1,002	1,194	1,084
Apr-05	518	419	521	450	374	495	463
May-05	344	283	337	305	246	347	310
Jun-05	29	14	17	5	-	8	12
FY2005	6,517	6,642	7,323	7,410	6,691	7,809	7,065
FY2024	Milwaukee Daily HDD	Madison Daily HDD	Green Bay Daily HDD	Eau Claire Daily HDD	La Crosse Daily HDD	Wausau Daily HDD	Average Daily HDD
Jul-23	-	-	-	12	1	8	4
Aug-23	6	14	23	13	1	25	14
Sep-23	26	57	81	65	24	98	59
Oct-23	329	432	451	485	392	520	435
Nov-23	674	809	826	882	773	894	810
Dec-23	783	927	926	979	912	991	920
Jan-24	1,145	1,296	1,259	1,335	1,271	1,318	1,271
Feb-24	814	898	917	955	848	981	902
Mar-24	743	787	825	878	772	902	818
Apr-24	455	476	503	532	456	566	498
May-24	154	106	166	182	100	205	152
Jun-24	22	17	21	24	3	44	22
FY2024	5,151	5,819	5,998	6,342	5,553	6,552	5,903
FY24/FY05 Ratio	Milwaukee Daily HDD	Madison Daily HDD	Green Bay Daily HDD	Eau Claire Daily HDD	La Crosse Daily HDD	Wausau Daily HDD	Average Daily HDD
Oct	89%	103%	98%	102%	93%	97%	97%
Nov	100%	110%	107%	106%	101%	105%	105%
Dec	67%	77%	72%	72%	72%	71%	72%
Jan	87%	93%	85%	88%	87%	83%	87%
Feb	84%	90%	85%	85%	84%	86%	86%
Mar	75%	78%	71%	77%	77%	76%	75%
	79%	88%	82%	86%	83%	84%	84%

Wisconsin FY24 Monthly Cooling Degree Days with Comparison to FY05 Baseline							
FY2005	Milwaukee Daily CDD	Madison Daily CDD	Green Bay Daily CDD	Eau Claire Daily CDD	La Crosse Daily CDD	Wausau Daily CDD	Average Daily CDD
Jul-04	151	155	116	159	198	115	149
Aug-04	105	91	73	71	114	58	85
Sep-04	93	93	78	100	136	69	95
Oct-04	2	2	-	1	3	-	1
Nov-04	-	-	-	-	-	-	-
Dec-04	-	-	-	-	-	-	-
Jan-05	-	-	-	-	-	-	-
Feb-05	-	-	-	-	-	-	-
Mar-05	-	-	-	-	-	-	-
Apr-05	4	2	1	4	5	-	3
May-05	4	7	3	4	7	2	5
Jun-05	229	239	203	188	285	191	223
FY2005	588	589	474	527	748	435	560
FY2024	Milwaukee Daily CDD	Madison Daily CDD	Green Bay Daily CDD	Eau Claire Daily CDD	La Crosse Daily CDD	Wausau Daily CDD	Average Daily CDD
Jul-23	288	237	202	175	248	157	218
Aug-23	257	204	143	192	294	157	208
Sep-23	130	108	77	97	140	77	105
Oct-23	42	26	29	27	35	17	29
Nov-23	-	-	-	-	-	-	-
Dec-23	-	-	-	-	-	-	-
Jan-24	-	-	-	-	-	-	-
Feb-24	-	-	-	-	-	-	-
Mar-24	-	-	-	-	-	-	-
Apr-24	-	6	-	-	-	-	1
May-24	12	16	8	15	31	7	15
Jun-24	190	185	136	91	164	77	141
FY2024	919	782	595	597	912	492	716
FY24/FY05 Ratio	Milwaukee Daily CDD	Madison Daily CDD	Green Bay Daily CDD	Eau Claire Daily CDD	La Crosse Daily CDD	Wausau Daily CDD	Average Daily CDD
Jul	52%	65%	57%	91%	80%	73%	68%
Aug	41%	45%	51%	37%	39%	37%	41%
Sep	72%	86%	101%	103%	97%	90%	90%
Apr	0%	300%	0%	0%	0%		38%
May	300%	229%	267%	375%	443%	350%	330%
Jun	83%	77%	67%	48%	58%	40%	63%
	156%	133%	126%	113%	122%	113%	128%


Major Agency Comparison FY2024 to FY1973*

Agency	FY1973 GSF	FY1973 Thermal Btu/GSF	FY1973 Electric Btu/GSF	FY1973 Total Btu/GSF
Universities of Wisconsin	31,498,261	192,180	42,581	234,761
Department of Administration	1,966,150	225,697	42,447	268,144
Department of Corrections	2,279,108	317,387	16,662	334,049
Department of Health Services	4,475,139	279,061	25,221	304,282
Department of Public Instruction	358,663	177,888	20,858	198,746
Department of Veterans Affairs	535,072	244,085	29,714	273,799
Agencies Total	41,112,393	210,732	38,891	249,623

Agency	FY2024 GSF	FY2024 Thermal Btu/GSF	FY2024 Electric Btu/GSF	FY2024 Total Btu/GSF
Universities of Wisconsin	57,179,541	101,352	43,774	145,127
Department of Administration	4,541,557	79,065	40,988	120,052
Department of Corrections	7,939,611	108,686	37,034	145,719
Department of Health Services	4,159,400	131,105	32,415	163,520
Department of Public Instruction	441,183	66,221	17,855	84,076
Department of Veterans Affairs	733,728	156,139	47,144	203,283
Agencies Total	74,995,020	102,758	42,142	144,901



Agency	GSF % Change FY24 from FY73	Thermal % Change FY24 from FY73	Electric % Change FY24 from FY73	Energy % Change FY24 from FY73
Universities of Wisconsin	81.53%	-47.26%	2.80%	-38.18%
Department of Administration	130.99%	-64.97%	-3.44%	-55.23%
Department of Corrections	248.36%	-65.76%	122.26%	-56.38%
Department of Health Services	-7.06%	-53.02%	28.52%	-46.26%
Department of Public Instruction	23.01%	-62.77%	-14.40%	-57.70%
Department of Veterans Affairs	37.13%	-36.03%	58.66%	-25.75%
Agencies Total	82.41%	-51.24%	8.36%	-41.95%

* FY1973 was start of State of Wisconsin Energy Conservation Program and State Energy Report monitoring.

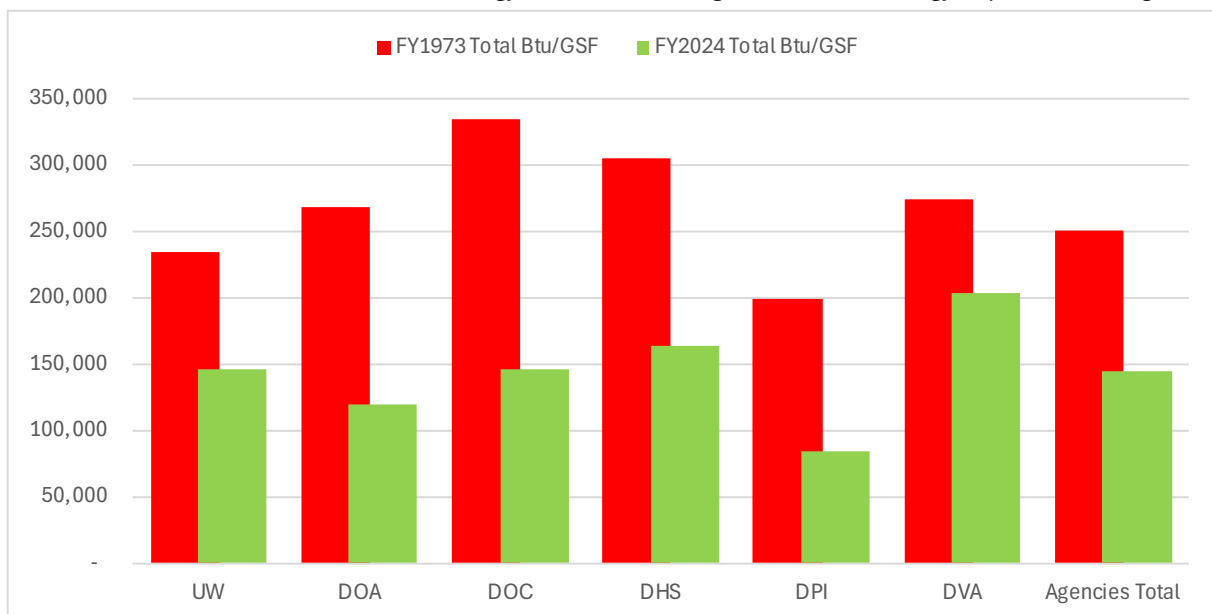

Statewide Facilities Total Fiscal Year 2024 Total State Agency Total (FY05 Base)

Fiscal Year	Gross Square Feet (GSF)	Site Thermal BTU/GSF	Site Electricity BTU/GSF	Site Total BTU/GSF	% Change From FY05 Base	Weather Thermal Adjusted FY05 Base	Weather Electric Adjusted FY05 Base	Total Weather Adjusted Btu/GSF	% Adj Change From FY05
FY05	64,753,150	148,686	49,704	198,390	0.0%	148,686	49,704	198,390	0.0%
FY06	65,405,533	145,097	51,086	196,183	-1.1%	146,330	50,794	197,123	-0.6%
FY07	66,508,886	141,908	50,876	192,785	-2.8%	141,030	50,775	191,805	-3.3%
FY08	67,703,290	145,897	50,932	196,829	-0.8%	138,426	50,690	189,117	-4.7%
FY09	68,186,861	139,820	49,815	189,636	-4.4%	132,101	49,798	181,899	-8.3%
FY10	68,774,525	133,168	49,479	182,648	-7.9%	131,773	49,602	181,375	-8.6%
FY11	69,655,003	133,843	50,379	184,223	-7.1%	127,173	50,114	177,287	-10.6%
FY12	71,400,599	114,015	49,671	163,686	-17.5%	120,245	48,922	169,167	-14.7%
FY13	72,698,283	124,481	47,863	172,344	-13.1%	120,184	47,667	167,852	-15.4%
FY14	73,275,335	132,369	47,479	179,848	-9.3%	118,706	47,268	165,974	-16.3%
FY15	73,553,273	124,210	46,752	170,962	-13.8%	117,828	46,815	164,642	-17.0%
FY16	74,064,464	111,046	46,512	157,558	-20.6%	115,620	46,217	161,837	-18.4%
FY17	74,080,246	111,028	46,293	157,321	-20.7%	115,165	45,737	160,902	-18.9%
FY18	73,838,150	119,429	45,532	164,961	-16.9%	114,981	45,420	160,400	-19.1%
FY19	74,054,921	121,297	44,753	166,051	-16.3%	115,319	44,765	160,084	-19.3%
FY20	74,749,271	114,087	42,821	156,908	-20.9%	114,303	42,629	156,933	-20.9%
FY21	75,060,520	109,400	41,179	150,580	-24.1%	108,812	40,735	149,547	-24.6%
FY22	74,879,851	112,947	43,137	156,084	-21.3%	111,591	42,516	154,107	-22.3%
FY23	75,451,468	109,147	42,162	151,308	-23.7%	111,384	41,952	153,336	-22.7%
FY24	75,399,512	102,443	42,063	144,506	-27.2%	110,598	41,419	152,017	-23.4%

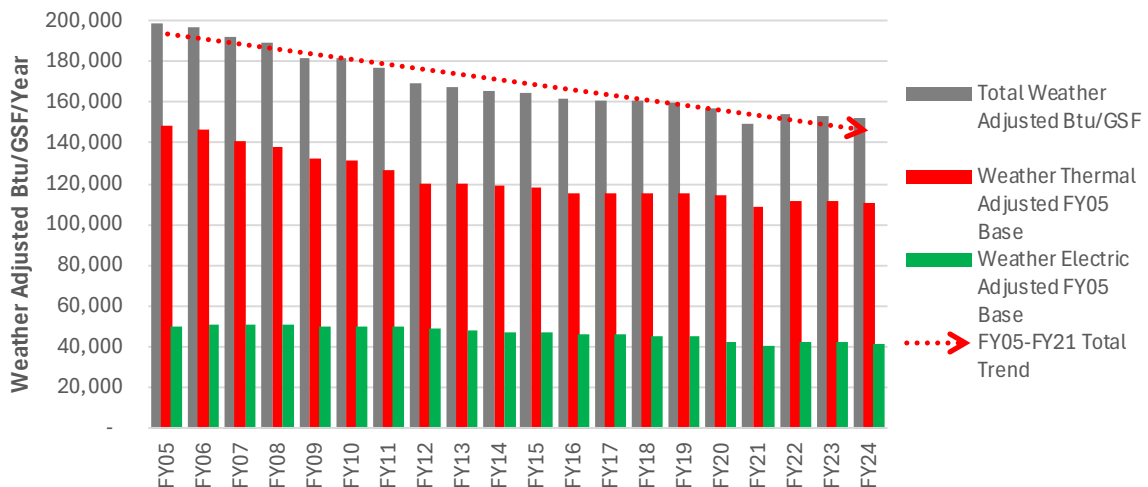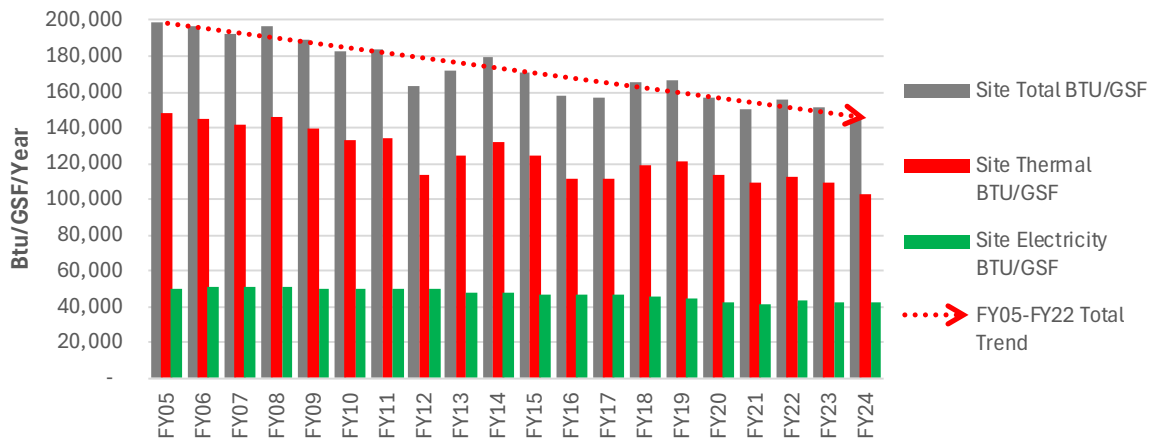

Appendix D - Facility and Building Data/Cost Reports

The success of the state's energy and fuel management efforts are directly dependent on the efforts of the people who operate and maintain the central plants and distribution systems, as well as those managers and occupants of individual buildings. The Wisconsin State Energy Office and Department of Administration have leadership roles in developing and overseeing these efforts. Energy Use in State Facilities Report support includes assisting agencies in providing benchmarking and monitoring analysis reports to measure impact of State Energy Conservation Program and energy conservation efforts.

The State Energy Report services include review and benchmarking analysis of institutions, facilities and buildings' energy use and renewable resources. As previously discussed, benchmarking is the process of accounting for and comparing a metered building's current energy performance with its historical energy use and trends. Benchmarking is used to compare performance over time to evaluate energy use changes:

- Changes in Building Area from Demolitions, Additions & Remodeling.
- Results from Energy Conservation Measures.
- Changes in Building Occupancy and Schedules.
- Changes in Building System Operation and Equipment Schedules.
- Controls or Temperature Set-Points.
- Measure Renewable Energy Solar PV & Purchase Contributions.

Energy Use Intensity (EUI) benchmarks are used to compare energy use to similar facilities and measure the year-to-year changes in energy use from conservation efforts. Monitored building energy consumption includes electricity and thermal or natural gas. Site Energy Use Intensity (EUI) are calculated and presented as Btu per building area gross square feet per year (Btu/GSF or Btu/Ft²). Similar benchmarks include electric kwh/GSF and fuel use therm/GSF benchmarks. The facilities' energy use and costs may trend upward because of changes in the building system's operation, equipment schedules, controls or set points. These modifications are often made to maintain occupant comfort in certain areas, requiring increased overall building HVAC, fan and reheat systems energy use. System adjustments and summer boiler shutdown may be made by building operating staff that resulted in significant savings that can be seen in the monthly EUI Btu/GSF benchmarks. Five to ten-year monthly (Mo.) energy use benchmarks Btu/GSF/Year are summarized and evaluated to identify actual changes in energy use and trends. Also, it can be used to evaluate the energy use associated with Covid-19 shutdowns and unoccupied facilities.

Attached are sample benchmarking analysis and data reports provided for facility and building energy managers:

- State Facility & Agency FY05-FY24 Thermal Analysis Therm/GSF Benchmarks.
- State Facility & Agency FY05-FY24 Electric Analysis kwh/GSF Benchmarks.
- State Facility & Agency Average Electric Energy Prices (\$/kwh).
- State Facility & Agency Average Thermal Energy Prices (\$/MMBtu).

Note - Thermal Fuel Use = 1 Therm = 100,000 Btu = 0.1 MMBtu (million Btu) = 100 kBtu (1000 Btu).

Thermal Energy Prices (\$/MMBtu)		\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu
Agency	Agency-Facility	FY15	FY16	FY17	FY18	FY19	FY20	FY21	FY22	FY23	FY24
DHS	DHS-Mendota	\$ 3.47	\$ 3.48	\$ 3.65	\$ 4.02	\$ 4.01	\$ 3.15	\$ 3.58	\$ 6.58	\$ 6.14	\$ 3.77
DHS	DHS-Northern Center	\$ 4.61	\$ 3.91	\$ 4.21	\$ 4.12	\$ 4.11	\$ 3.68	\$ 4.25	\$ 7.18	\$ 6.26	\$ 4.64
DHS	DHS-Sand Ridge	\$ 4.76	\$ 3.77	\$ 4.51	\$ 4.11	\$ 4.14	\$ 3.37	\$ 3.81	\$ 6.66	\$ 6.62	\$ 4.32
DHS	DHS-Southern Center	\$ 4.31	\$ 3.39	\$ 4.01	\$ 3.59	\$ 3.87	\$ 3.03	\$ 3.86	\$ 6.63	\$ 5.93	\$ 3.74
DHS	DHS-Winnebago	\$ 4.21	\$ 3.29	\$ 3.97	\$ 3.54	\$ 3.91	\$ 2.98	\$ 3.34	\$ 5.88	\$ 5.73	\$ 3.76
DNR	DNR-Darwin Road	\$ 5.17	\$ 3.91	\$ 4.47	\$ 4.25	\$ 4.45	\$ 5.42	\$ 6.01	\$ 8.94	\$ 9.58	\$ 7.26
DNR	DNR-Green Bay	\$ 6.64	\$ 4.81	\$ 5.26	\$ 4.83	\$ 4.96	\$ 4.53	\$ 4.85	\$ 7.52	\$ 8.74	\$ 5.61
DNR	DNR-South Central	\$ 4.88	\$ 3.75	\$ 4.12	\$ 4.06	\$ 4.18	\$ 5.23	\$ 7.53	\$ 9.05	\$ 9.42	\$ 7.11
DNR	DNR-Tomahawk	\$ 6.37	\$ 4.87	\$ 5.39	\$ 4.97	\$ 5.09	\$ 4.60	\$ 5.53	\$ 7.65	\$ 9.18	\$ 5.82
DOA	DOA-Air Services	\$ 6.71	\$ 5.55	\$ 6.20	\$ 5.71	\$ 6.03	\$ 5.23	\$ 6.03	\$ 8.77	\$ 9.35	\$ 7.24
DOA	DOA-Capitol Complex	\$ 4.29	\$ 3.31	\$ 3.88	\$ 3.50	\$ 3.78	\$ 3.20	\$ 3.36	\$ 6.32	\$ 5.77	\$ 3.39
DOA	DOA-Eau Claire SOB	\$ 7.33	\$ 7.68	\$ 8.80	\$ 8.05	\$ 6.71	\$ 5.92	\$ 6.49	\$ 10.59	\$ 10.15	\$ 6.77
DOA	DOA-Executive Residence	\$ 6.74	\$ 4.81	\$ 5.41	\$ 5.25	\$ 5.30	\$ 4.63	\$ 5.57	\$ 8.88	\$ 8.98	\$ 6.61
DOA	DOA-Green Bay SOB	\$ 6.58	\$ 4.98	\$ 5.64	\$ 5.19	\$ 5.35	\$ 4.73	\$ 5.34	\$ 7.67	\$ 9.04	\$ 5.90
DOA	DOA-Hill Farms	\$ 4.31	\$ 3.47	\$ 4.06	\$ 3.66	\$ 3.95	\$ 3.46	\$ 3.99	\$ 5.84	\$ 7.94	\$ 4.39
DOA	DOA-La Crosse SOB	\$ 7.93	\$ 5.69	\$ 6.11	\$ 6.18	\$ 6.48	\$ 5.97	\$ 6.56	\$ 10.91	\$ 10.13	\$ 6.77
DOA	DOA-Milwaukee SOB	\$ 12.87	\$ 11.51	\$ 11.77	\$ 12.33	\$ 14.55	\$ 11.05	\$ 13.60	\$ 16.65	\$ 17.03	\$ 16.52
DOA	DOA-Public Broadcasting	\$ 5.70	\$ 4.53	\$ 5.03	\$ 5.05	\$ 5.07	\$ 4.32	\$ 5.14	\$ 8.31	\$ 8.35	\$ 5.60
DOA	DOA-SE Crime Lab	\$ 6.73	\$ 6.14	\$ 6.34	\$ 5.93	\$ 5.83	\$ 3.40	\$ 5.49	\$ 7.77	\$ 6.62	\$ 5.63
DOA	DOA-State Ag	\$ 5.49	\$ 4.55	\$ 4.34	\$ 3.99	\$ 3.83	\$ 4.44	\$ 5.37	\$ 7.76	\$ 2.28	\$ 5.45
DOA	DOA-State Hygiene Lab	\$ 5.14	\$ 4.18	\$ 4.90	\$ 4.26	\$ 4.46	\$ 3.49	\$ 4.60	\$ 7.02	\$ 6.49	\$ 4.53
DOA	DOA-State Revenue	\$ 5.90	\$ 4.19	\$ 4.79	\$ 4.53	\$ 4.73	\$ 3.96	\$ 5.04	\$ 4.87	\$ 7.58	\$ 4.95
DOA	DOA-Waukesha SOB	\$ 6.00	\$ 4.10	\$ 5.03	\$ 4.81	\$ 4.50	\$ 3.92	\$ 6.42	\$ 5.76	\$ 4.58	\$ 4.91
DOA	DOA-WI Rapids SOB	\$ 7.20	\$ 6.24	\$ 6.45	\$ 6.34	\$ 6.17	\$ 5.65	\$ 5.98	\$ 8.21	\$ 9.50	\$ 6.72
DOA	DOA-Femrite Data Center	\$ 10.00	\$ 9.65	\$ 5.52	\$ 5.35	\$ 5.34	\$ 4.57	\$ 5.33	\$ 8.46	\$ 8.45	\$ 5.92
DOA	DOA-Archive & Preservation									\$ 6.83	\$ 4.46
DOA	DOA-Thompson Center									\$ 7.16	\$ 5.08
DOC	DOC-Boscobel	\$ 4.98	\$ 4.24	\$ 4.84	\$ 4.33	\$ 4.43	\$ 3.98	\$ 4.65	\$ 6.97	\$ 7.19	\$ 5.44
DOC	DOC-Columbia	\$ 4.76	\$ 3.80	\$ 4.37	\$ 3.94	\$ 4.15	\$ 3.42	\$ 3.80	\$ 6.88	\$ 6.50	\$ 4.32
DOC	DOC-Fox Lake	\$ 4.43	\$ 3.42	\$ 4.17	\$ 3.74	\$ 3.81	\$ 3.16	\$ 3.56	\$ 6.70	\$ 5.94	\$ 3.75
DOC	DOC-Green Bay	\$ 4.36	\$ 3.35	\$ 4.03	\$ 3.59	\$ 3.95	\$ 3.04	\$ 3.48	\$ 6.46	\$ 5.76	\$ 3.70
DOC	DOC-Jackson	\$ 4.83	\$ 4.17	\$ 4.72	\$ 4.16	\$ 4.21	\$ 3.75	\$ 4.46	\$ 6.76	\$ 7.02	\$ 5.09
DOC	DOC-Kettle Moraine	\$ 4.35	\$ 3.36	\$ 4.07	\$ 3.62	\$ 3.71	\$ 3.08	\$ 3.44	\$ 6.50	\$ 5.81	\$ 3.61
DOC	DOC-Lincoln Hills	\$ 4.51	\$ 3.56	\$ 4.21	\$ 3.78	\$ 3.81	\$ 3.18	\$ 3.55	\$ 6.61	\$ 5.96	\$ 3.76
DOC	DOC-Milwaukee Secure	\$ 12.63	\$ 11.86	\$ 12.43	\$ 12.36	\$ 11.63	\$ 11.54	\$ 13.11	\$ 16.17	\$ 23.79	\$ 15.89
DOC	DOC-New Lisbon	\$ 4.68	\$ 3.61	\$ 4.31	\$ 3.92	\$ 4.04	\$ 3.24	\$ 3.71	\$ 6.83	\$ 6.30	\$ 4.25
DOC	DOC-Oakhill	\$ 4.64	\$ 3.69	\$ 4.33	\$ 3.92	\$ 4.10	\$ 3.48	\$ 4.01	\$ 6.91	\$ 5.93	\$ 3.92
DOC	DOC-Oshkosh	\$ 4.23	\$ 3.28	\$ 4.07	\$ 3.50	\$ 3.55	\$ 2.99	\$ 3.31	\$ 6.41	\$ 5.74	\$ 3.46
DOC	DOC-Prairie du Chien	\$ 4.64	\$ 3.83	\$ 3.83	\$ 4.13	\$ 4.36	\$ 3.69	\$ 4.21	\$ 6.92	\$ 6.25	\$ 4.39
DOC	DOC-Racine	\$ 4.25	\$ 3.27	\$ 3.92	\$ 3.53	\$ 3.73	\$ 3.11	\$ 3.53	\$ 6.64	\$ 5.71	\$ 3.86
DOC	DOC-Racine Youth	\$ 4.37	\$ 3.79	\$ 4.49	\$ 4.04	\$ 4.12	\$ 3.11	\$ 5.17	\$ 6.87	\$ 6.21	\$ 4.23
DOC	DOC-Redgranite	\$ 4.90	\$ 3.59	\$ 4.44	\$ 4.04	\$ 4.16	\$ 4.16	\$ 3.93	\$ 6.98	\$ 6.09	\$ 4.20
DOC	DOC-Stanley	\$ 4.79	\$ 3.77	\$ 4.45	\$ 4.02	\$ 4.04	\$ 3.44	\$ 3.89	\$ 6.86	\$ 10.33	\$ 4.62
DOC	DOC-Sturtevant	\$ 4.10	\$ 3.85	\$ 4.66	\$ 4.15	\$ 4.38	\$ 4.27	\$ 5.38	\$ 6.95	\$ 6.31	\$ 4.34
DOC	DOC-Taycheedah	\$ 4.56	\$ 3.45	\$ 4.42	\$ 3.79	\$ 4.03	\$ 3.26	\$ 3.74	\$ 7.15	\$ 6.31	\$ 4.04
DOC	DOC-Waupun	\$ 4.07	\$ 3.55	\$ 4.19	\$ 3.72	\$ 3.85	\$ 3.28	\$ 3.96	\$ 4.55	\$ 5.91	\$ 3.79

Thermal Energy Prices (\$/MMBtu)		\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu	\$/MMBtu
Agency	Agency-Facility	FY15	FY16	FY17	FY18	FY19	FY20	FY21	FY22	FY23	FY24
DOT	DOT-DTD 1 Lab	\$ 6.33	\$ 9.73	\$ 6.30	\$ 5.40	\$ 5.55	\$ 4.76	\$ 2.04	\$ 2.37	\$ 2.64	\$ 5.97
DOT	DOT-DTD 1 Madison	\$ 6.41	\$ 5.41	\$ 5.86	\$ 5.47	\$ 5.43	\$ 4.77	\$ 5.83	\$ 8.79	\$ 8.92	\$ 6.32
DOT	DOT-Green Bay	\$ 6.80	\$ 4.99	\$ 5.39	\$ 5.21	\$ 5.30	\$ 4.56	\$ 5.27	\$ 7.54	\$ 8.75	\$ 5.57
DOT	DOT-PIERSTORFF A	\$ 6.67	\$ 5.53	\$ 6.20	\$ 6.01	\$ 6.18	\$ 5.32	\$ 6.02	\$ 8.97	\$ 9.50	\$ 7.11
DOT	DOT-PIERSTORFF B	\$ 6.79	\$ 5.59	\$ 6.06	\$ 5.89	\$ 6.07	\$ 5.16	\$ 5.85	\$ 8.85	\$ 9.34	\$ 7.02
DOT	DOT-West Allis	\$ 7.40	\$ 6.55	\$ 6.80	\$ 6.58	\$ 6.46	\$ 5.79	\$ 6.42	\$ 8.39	\$ 9.68	\$ 7.13
DPI	DPI-Delavan	\$ 4.58	\$ 3.59	\$ 4.35	\$ 3.80	\$ 4.03	\$ 3.39	\$ 3.84	\$ 6.65	\$ 5.99	\$ 4.01
DPI	DPI-Janesville	\$ 4.75	\$ 3.49	\$ 4.54	\$ 4.01	\$ 4.29	\$ 3.57	\$ 3.89	\$ 6.71	\$ 6.10	\$ 4.26
DVA	DVA-King	\$ 4.55	\$ 3.70	\$ 4.23	\$ 3.95	\$ 3.93	\$ 3.30	\$ 3.71	\$ 6.79	\$ 5.97	\$ 3.64
UW	UW-Eau Claire	\$ 5.09	\$ 5.08	\$ 4.85	\$ 4.69	\$ 4.82	\$ 4.19	\$ 4.23	\$ 6.52	\$ 6.37	\$ 4.55
UW	UW-Green Bay	\$ 4.22	\$ 3.33	\$ 3.99	\$ 3.46	\$ 3.91	\$ 2.97	\$ 3.42	\$ 5.94	\$ 5.79	\$ 3.52
UW	UW-La Crosse	\$ 4.79	\$ 3.85	\$ 4.50	\$ 4.38	\$ 4.37	\$ 4.03	\$ 3.99	\$ 6.86	\$ 7.11	\$ 5.13
UW	UW-Madison	\$ 5.72	\$ 4.68	\$ 4.68	\$ 4.27	\$ 4.78	\$ 3.58	\$ 4.49	\$ 7.27	\$ 7.29	\$ 4.73
UW	UW-Milwaukee	\$ 5.52	\$ 4.76	\$ 5.26	\$ 4.63	\$ 5.17	\$ 3.67	\$ 4.38	\$ 7.09	\$ 5.96	\$ 4.25
UW	UW-Oshkosh	\$ 4.58	\$ 3.69	\$ 4.21	\$ 2.78	\$ 4.10	\$ 3.46	\$ 3.70	\$ 5.88	\$ 5.72	\$ 3.39
UW	UW-Parkside	\$ 4.56	\$ 3.63	\$ 4.29	\$ 3.80	\$ 3.95	\$ 3.14	\$ 3.27	\$ 5.84	\$ 5.95	\$ 3.84
UW	UW-Platteville	\$ 5.27	\$ 4.31	\$ 4.55	\$ 4.20	\$ 4.38	\$ 3.83	\$ 4.04	\$ 6.30	\$ 6.17	\$ 4.21
UW	UW-River Falls	\$ 4.58	\$ 3.77	\$ 4.53	\$ 3.75	\$ 4.39	\$ 3.84	\$ 5.01	\$ 7.45	\$ 7.35	\$ 5.22
UW	UW-Stevens Point	\$ 5.42	\$ 4.68	\$ 5.36	\$ 3.75	\$ 4.19	\$ 3.49	\$ 4.22	\$ 5.80	\$ 5.72	\$ 3.63
UW	UW-Stout	\$ 5.13	\$ 4.33	\$ 5.01	\$ 4.33	\$ 4.72	\$ 3.91	\$ 3.85	\$ 6.56	\$ 6.74	\$ 4.77
UW	UW-Superior	\$ 5.19	\$ 4.77	\$ 5.31	\$ 4.57	\$ 4.69	\$ 3.98	\$ 4.33	\$ 7.34	\$ 6.80	\$ 5.17
UW	UW-Whitewater	\$ 2.05	\$ 1.93	\$ 1.77	\$ 1.77	\$ 2.34	\$ 1.65	\$ 1.65	\$ 6.00	\$ 6.07	\$ 3.69
UW	UW-Eau Claire, Barron	\$ 6.80	\$ 5.77	\$ 5.99	\$ 5.68	\$ 6.05	\$ 5.12	\$ 5.47	\$ 7.65	\$ 8.78	\$ 5.79
UW	UW-Green Bay, Manitowoc	\$ 6.46	\$ 4.94	\$ 3.92	\$ 5.13	\$ 5.25	\$ 4.61	\$ 5.14	\$ 7.45	\$ 8.73	\$ 5.81
UW	UW-Green Bay, Marinette	\$ 6.26	\$ 4.76	\$ 5.42	\$ 4.20	\$ 4.22	\$ 4.31	\$ 4.62	\$ 4.92	\$ 6.35	\$ 5.02
UW	UW-Green Bay, Sheboygan	\$ 6.49	\$ 4.65	\$ 5.84	\$ 3.79	\$ 4.69	\$ 3.70	\$ 4.93	\$ 5.83	\$ 6.59	\$ 5.09
UW	UW-Milwaukee, Washington	\$ 6.40	\$ 4.81	\$ 5.47	\$ 4.89	\$ 4.88	\$ 4.14	\$ 5.33	\$ 7.02	\$ 6.86	\$ 5.40
UW	UW-Milwaukee, Waukesha	\$ 4.56	\$ 3.77	\$ 4.36	\$ 3.97	\$ 4.00	\$ 3.43	\$ 5.07	\$ 6.67	\$ 6.30	\$ 4.19
UW	UW-Oshkosh, Fond du Lac	\$ 6.55	\$ 5.17	\$ 6.53	\$ 5.21	\$ 5.12	\$ 4.44	\$ 4.99	\$ 7.25	\$ 8.49	\$ 6.39
UW	UW-Oshkosh, Fox Cities	\$ 5.57	\$ 3.45	\$ 3.90	\$ 3.17	\$ 3.12	\$ 2.93	\$ 3.59	\$ 4.46	\$ 7.35	\$ 4.88
UW	UW-Platteville, Baraboo	\$ 6.25	\$ 5.04	\$ 5.25	\$ 5.18	\$ 5.14	\$ 4.51	\$ 4.95	\$ 7.29	\$ 8.60	\$ 6.40
UW	UW-Platteville, Richland	\$ 8.39	\$ 6.11	\$ 6.79	\$ 6.53	\$ 6.27	\$ 5.62	\$ 6.22	\$ 7.98	\$ 9.45	
UW	UW-Stevens Point, Marshfield	\$ 6.24	\$ 4.52	\$ 5.30	\$ 4.82	\$ 4.83	\$ 4.10	\$ 5.01	\$ 6.84	\$ 6.83	\$ 5.21
UW	UW-Stevens Point, Wausau	\$ 5.19	\$ 3.62	\$ 4.44	\$ 3.88	\$ 4.03	\$ 3.32	\$ 3.81	\$ 6.62	\$ 6.11	\$ 4.17
UW	UW-Whitewater, Rock	\$ 4.89	\$ 4.12	\$ 4.91	\$ 4.54	\$ 4.42	\$ 3.71	\$ 4.98	\$ 7.09	\$ 6.68	\$ 4.95
		\$ 5.14	\$ 4.25	\$ 4.53	\$ 4.08	\$ 4.47	\$ 3.54	\$ 4.17	\$ 6.83	\$ 6.74	\$ 4.41
	DHS	\$ 3.96	\$ 3.48	\$ 3.87	\$ 3.87	\$ 3.97	\$ 3.15	\$ 3.67	\$ 6.53	\$ 6.06	\$ 3.88
	DNR	\$ 5.50	\$ 4.15	\$ 4.58	\$ 4.44	\$ 4.59	\$ 4.99	\$ 6.31	\$ 8.42	\$ 9.27	\$ 6.46
	DOA	\$ 5.11	\$ 3.99	\$ 4.48	\$ 4.12	\$ 4.49	\$ 3.68	\$ 4.27	\$ 6.79	\$ 6.65	\$ 4.17
	DOC	\$ 4.61	\$ 3.75	\$ 4.42	\$ 4.01	\$ 4.12	\$ 3.53	\$ 4.05	\$ 6.46	\$ 6.74	\$ 4.27
	DOT	\$ 6.59	\$ 6.98	\$ 6.01	\$ 5.53	\$ 5.61	\$ 4.83	\$ 4.42	\$ 6.61	\$ 7.23	\$ 6.25
	DPI	\$ 4.66	\$ 3.54	\$ 4.43	\$ 3.90	\$ 4.15	\$ 3.48	\$ 3.86	\$ 6.68	\$ 6.04	\$ 4.12
	DVA	\$ 4.55	\$ 3.70	\$ 4.23	\$ 3.95	\$ 3.93	\$ 3.30	\$ 3.71	\$ 6.79	\$ 5.97	\$ 3.64
	UW	\$ 5.33	\$ 4.42	\$ 4.62	\$ 4.10	\$ 4.57	\$ 3.57	\$ 4.24	\$ 6.91	\$ 6.82	\$ 4.50
		\$ 5.14	\$ 4.25	\$ 4.53	\$ 4.08	\$ 4.47	\$ 3.54	\$ 4.17	\$ 6.83	\$ 6.74	\$ 4.41

Electric Energy Prices (\$/kwh)		\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh
Agency	Agency-Facility	FY15	FY16	FY17	FY18	FY19	FY20	FY21	FY22	FY23	FY24
DHS	DHS-Mendota	\$0.0880	\$0.0915	\$0.0876	\$0.0913	\$0.0910	\$0.0894	\$0.0971	\$0.1029	\$0.1162	\$0.1245
DHS	DHS-Northern Center	\$0.0759	\$0.0778	\$0.0782	\$0.0802	\$0.0779	\$0.0781	\$0.0784	\$0.0825	\$0.0927	\$0.0959
DHS	DHS-Sand Ridge	\$0.0795	\$0.0796	\$0.0824	\$0.0804	\$0.0845	\$0.0845	\$0.0891	\$0.0890	\$0.0881	\$0.0882
DHS	DHS-Southern Center	\$0.0900	\$0.0899	\$0.0878	\$0.0872	\$0.0873	\$0.0883	\$0.0914	\$0.0959	\$0.1010	\$0.1056
DHS	DHS-Winnebago	\$0.0674	\$0.0696	\$0.0685	\$0.0700	\$0.0681	\$0.0685	\$0.0705	\$0.0751	\$0.0834	\$0.0868
DNR	DNR-Darwin Road	\$0.1464	\$0.1534	\$0.1489	\$0.1486	\$0.1469	\$0.1481	\$0.1554	\$0.1652	\$0.1686	\$0.1916
DNR	DNR-Green Bay	\$0.1233	\$0.1219	\$0.1203	\$0.1146	\$0.1130	\$0.1150	\$0.1036	\$0.1065	\$0.1252	\$0.1241
DNR	DNR-South Central	\$0.1388	\$0.1359	\$0.1216	\$0.1544	\$0.1463	\$0.1485	\$0.1570	\$0.1652	\$0.1631	\$0.1918
DNR	DNR-Tomahawk	\$0.1061	\$0.1064	\$0.1026	\$0.1024	\$0.1003	\$0.0991	\$0.0984	\$0.1064	\$0.1187	\$0.1248
DOA	DOA-Air Services	\$0.1524	\$0.1618	\$0.1560	\$0.1573	\$0.1630	\$0.1593	\$0.1192	\$0.1489	\$0.1779	\$0.1761
DOA	DOA-Capitol Complex	\$0.1056	\$0.1104	\$0.1031	\$0.1047	\$0.1046	\$0.1031	\$0.1040	\$0.1047	\$0.1175	\$0.1304
DOA	DOA-Eau Claire SOB	\$0.1049	\$0.1120	\$0.1106	\$0.1119	\$0.1032	\$0.1060	\$0.1170	\$0.1272	\$0.1280	\$0.1339
DOA	DOA-Executive Residence	\$0.1390	\$0.1408	\$0.1348	\$0.1398	\$0.1373	\$0.1339	\$0.1341	\$0.1424	\$0.1564	\$0.1677
DOA	DOA-Green Bay SOB	\$0.0928	\$0.0932	\$0.0940	\$0.0990	\$0.0996	\$0.0991	\$0.0987	\$0.1133	\$0.1222	\$0.1298
DOA	DOA-Hill Farms	\$0.1058	\$0.1090	\$0.1054	\$0.1052	\$0.1155	\$0.1122	\$0.1107	\$0.1170	\$0.1241	\$0.1378
DOA	DOA-La Crosse SOB	\$0.1002	\$0.0972	\$0.0962	\$0.0959	\$0.0945	\$0.0938	\$0.1007	\$0.1100	\$0.1266	\$0.1304
DOA	DOA-Milwaukee SOB	\$0.1165	\$0.1165	\$0.1110	\$0.1123	\$0.1131	\$0.1152	\$0.1252	\$0.1277	\$0.1395	\$0.1492
DOA	DOA-Public Broadcasting	\$0.0985	\$0.0994	\$0.0952	\$0.0994	\$0.0988	\$0.0974	\$0.0996	\$0.1041	\$0.1155	\$0.1237
DOA	DOA-SE Crime Lab	\$0.1026	\$0.0970	\$0.0950	\$0.0941	\$0.0967	\$0.0975	\$0.0982	\$0.1043	\$0.1146	\$0.1233
DOA	DOA-State Ag	\$0.1410	\$0.1503	\$0.1525	\$0.1551	\$0.1505	\$0.1560	\$0.1603	\$0.1574	\$0.1727	\$0.1881
DOA	DOA-State Hygiene Lab	\$0.1085	\$0.1094	\$0.1042	\$0.1063	\$0.1071	\$0.1040	\$0.1062	\$0.1105	\$0.1218	\$0.1300
DOA	DOA-State Revenue	\$0.1182	\$0.1244	\$0.1162	\$0.1250	\$0.1215	\$0.1224	\$0.1249	\$0.1305	\$0.1423	\$0.1498
DOA	DOA-Waukesha SOB	\$0.1073	\$0.1132	\$0.1175	\$0.1148	\$0.1146	\$0.1167	\$0.1197	\$0.1285	\$0.1400	\$0.1492
DOA	DOA-WI Rapids SOB	\$0.1077	\$0.1149	\$0.1157	\$0.1179	\$0.1120	\$0.1128	\$0.1249	\$0.1246	\$0.1279	\$0.1338
DOA	DOA-Femrite Data Center	\$0.0940	\$0.0948	\$0.0906	\$0.0909	\$0.0923	\$0.0899	\$0.0938	\$0.0982	\$0.1092	\$0.1160
DOA	DOA-Archive & Preservation									\$0.1070	\$0.1153
DOA	DOA-Thompson Center									\$0.1197	\$0.1293
DOC	DOC-Boscobel	\$0.0834	\$0.0778	\$0.0800	\$0.0804	\$0.0769	\$0.0763	\$0.0753	\$0.0860	\$0.0887	\$0.0804
DOC	DOC-Columbia	\$0.0743	\$0.0782	\$0.0798	\$0.0779	\$0.0776	\$0.0763	\$0.0746	\$0.0770	\$0.0831	\$0.0890
DOC	DOC-Fox Lake	\$0.0788	\$0.0813	\$0.0845	\$0.0832	\$0.0831	\$0.0822	\$0.0805	\$0.0847	\$0.0919	\$0.0971
DOC	DOC-Green Bay	\$0.0693	\$0.0710	\$0.0689	\$0.0717	\$0.0711	\$0.0694	\$0.0694	\$0.0749	\$0.0839	\$0.0882
DOC	DOC-Jackson	\$0.0743	\$0.0858	\$0.0852	\$0.0858	\$0.0878	\$0.0866	\$0.0901	\$0.0903	\$0.0903	\$0.0903
DOC	DOC-Kettle Moraine	\$0.0824	\$0.0790	\$0.0779	\$0.0761	\$0.0717	\$0.0723	\$0.0703	\$0.0786	\$0.0834	\$0.0754
DOC	DOC-Lincoln Hills	\$0.0680	\$0.0716	\$0.0695	\$0.0697	\$0.0677	\$0.0663	\$0.0655	\$0.0712	\$0.0816	\$0.0859
DOC	DOC-Milwaukee Secure	\$0.0977	\$0.0960	\$0.0953	\$0.0947	\$0.0942	\$0.0942	\$0.0963	\$0.0996	\$0.1072	\$0.1121
DOC	DOC-New Lisbon	\$0.0821	\$0.0831	\$0.0809	\$0.0743	\$0.0735	\$0.0734	\$0.0682	\$0.0736	\$0.0907	\$0.0953
DOC	DOC-Oakhill	\$0.0764	\$0.0808	\$0.0836	\$0.0818	\$0.0822	\$0.0803	\$0.0797	\$0.0817	\$0.0878	\$0.0946
DOC	DOC-Oshkosh	\$0.0657	\$0.0677	\$0.0662	\$0.0719	\$0.0654	\$0.0661	\$0.0669	\$0.0722	\$0.0819	\$0.0857
DOC	DOC-Prairie du Chien	\$0.0763	\$0.0788	\$0.0817	\$0.0816	\$0.0807	\$0.0806	\$0.0786	\$0.0817	\$0.0893	\$0.0954
DOC	DOC-Racine	\$0.0844	\$0.0844	\$0.0834	\$0.0829	\$0.0838	\$0.0837	\$0.0868	\$0.0897	\$0.0976	\$0.1041
DOC	DOC-Racine Youth	\$0.1047	\$0.1051	\$0.0996	\$0.0994	\$0.0985	\$0.0992	\$0.1014	\$0.1079	\$0.1173	\$0.1204
DOC	DOC-Redgranite	\$0.0744	\$0.0773	\$0.0790	\$0.0782	\$0.0788	\$0.0768	\$0.0765	\$0.0780	\$0.0844	\$0.0900
DOC	DOC-Stanley	\$0.0915	\$0.0926	\$0.0942	\$0.0955	\$0.0920	\$0.0917	\$0.0898	\$0.0969	\$0.1071	\$0.1069
DOC	DOC-Sturtevant	\$0.0987	\$0.0991	\$0.0996	\$0.0993	\$0.1021	\$0.0888	\$0.0916	\$0.0987	\$0.1058	\$0.1109
DOC	DOC-Taycheedah	\$0.0746	\$0.0780	\$0.0822	\$0.0821	\$0.0799	\$0.0789	\$0.0771	\$0.0807	\$0.0865	\$0.0934
DOC	DOC-Waupun	\$0.1100	\$0.1100	\$0.1100	\$0.1100	\$0.1100	\$0.1100	\$0.1100	\$0.1100	\$0.1200	\$0.1200

Electric Energy Prices (\$/kwh)		\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh	\$/kwh
Agency	Agency-Facility	FY15	FY16	FY17	FY18	FY19	FY20	FY21	FY22	FY23	FY24
DOT	DOT-DTD 1 Lab	\$0.1262	\$0.1289	\$0.1293	\$0.1364	\$0.1254	\$0.1205	\$0.1276	\$0.1308	\$0.1425	\$0.1516
DOT	DOT-DTD 1 Madison	\$0.1249	\$0.1250	\$0.1196	\$0.1141	\$0.1049	\$0.1076	\$0.1312	\$0.1277	\$0.1485	\$0.1701
DOT	DOT-Green Bay	\$0.0872	\$0.0884	\$0.0873	\$0.0919	\$0.0911	\$0.0873	\$0.0855	\$0.0913	\$0.0913	\$0.0976
DOT	DOT-PIERSTORFF A	\$0.1264	\$0.1436	\$0.1287	\$0.1347	\$0.1374	\$0.1299	\$0.1270	\$0.1342	\$0.1514	\$0.1630
DOT	DOT-PIERSTORFF B	\$0.1473	\$0.1567	\$0.1632	\$0.1553	\$0.1563	\$0.1515	\$0.1247	\$0.1653	\$0.1824	\$0.2069
DOT	DOT-West Allis	\$0.1247	\$0.1228	\$0.1246	\$0.1228	\$0.1238	\$0.1256	\$0.1237	\$0.1294	\$0.1337	\$0.1430
DPI	DPI-Delavan	\$0.0823	\$0.0844	\$0.0873	\$0.0872	\$0.1023	\$0.0983	\$0.0941	\$0.0992	\$0.1091	\$0.1156
DPI	DPI-Janesville	\$0.1029	\$0.1067	\$0.1092	\$0.1092	\$0.1049	\$0.1039	\$0.1015	\$0.1086	\$0.1174	\$0.1248
DVA	DVA-King	\$0.0693	\$0.0725	\$0.0701	\$0.0706	\$0.0690	\$0.0707	\$0.0708	\$0.0859	\$0.0932	\$0.0939
UW	UW-Eau Claire	\$0.0843	\$0.0833	\$0.0832	\$0.0853	\$0.0821	\$0.0813	\$0.0809	\$0.0886	\$0.1001	\$0.0992
UW	UW-Green Bay	\$0.0740	\$0.0766	\$0.0753	\$0.0760	\$0.0741	\$0.0757	\$0.0746	\$0.0796	\$0.0901	\$0.0951
UW	UW-La Crosse	\$0.0872	\$0.0852	\$0.0856	\$0.0850	\$0.0804	\$0.0807	\$0.0796	\$0.0890	\$0.1006	\$0.1006
UW	UW-Madison	\$0.0923	\$0.1007	\$0.0980	\$0.0993	\$0.1050	\$0.1028	\$0.1069	\$0.1097	\$0.1154	\$0.1225
UW	UW-Milwaukee	\$0.0935	\$0.0933	\$0.0882	\$0.0863	\$0.0857	\$0.0879	\$0.0895	\$0.0922	\$0.1000	\$0.1036
UW	UW-Oshkosh	\$0.0721	\$0.0748	\$0.0731	\$0.0730	\$0.0712	\$0.0669	\$0.0700	\$0.0744	\$0.0828	\$0.0887
UW	UW-Parkside	\$0.0923	\$0.0911	\$0.0880	\$0.0907	\$0.0901	\$0.0893	\$0.0882	\$0.0964	\$0.1033	\$0.1123
UW	UW-Platteville	\$0.0772	\$0.0818	\$0.0817	\$0.0821	\$0.0792	\$0.0783	\$0.0767	\$0.0799	\$0.0892	\$0.0959
UW	UW-River Falls	\$0.0957	\$0.0915	\$0.0835	\$0.0913	\$0.0875	\$0.0851	\$0.0914	\$0.0979	\$0.1016	\$0.0940
UW	UW-Stevens Point	\$0.0699	\$0.0717	\$0.0787	\$0.0757	\$0.0692	\$0.0697	\$0.0707	\$0.0757	\$0.0848	\$0.0898
UW	UW-Stout	\$0.0808	\$0.0845	\$0.0848	\$0.0861	\$0.0823	\$0.0839	\$0.0825	\$0.0906	\$0.1020	\$0.1024
UW	UW-Superior	\$0.0672	\$0.0700	\$0.0721	\$0.0744	\$0.0659	\$0.0651	\$0.0755	\$0.0887	\$0.0858	\$0.0928
UW	UW-Whitewater	\$0.0860	\$0.0858	\$0.0845	\$0.0837	\$0.0836	\$0.0859	\$0.0868	\$0.0912	\$0.0977	\$0.1029
UW	UW-Eau Claire, Barron	\$0.1044	\$0.1100	\$0.0867	\$0.0922	\$0.0936	\$0.0952	\$0.0937	\$0.0945	\$0.0963	\$0.0963
UW	UW-Green Bay, Manitowoc	\$0.0863	\$0.0867	\$0.0822	\$0.0808	\$0.0781	\$0.0757	\$0.0751	\$0.0740	\$0.0740	\$0.0884
UW	UW-Green Bay, Marinette	\$0.1082	\$0.1114	\$0.1159	\$0.1070	\$0.1054	\$0.1001	\$0.0946	\$0.1046	\$0.1224	\$0.1323
UW	UW-Green Bay, Sheboygan	\$0.0978	\$0.1006	\$0.1004	\$0.1019	\$0.1074	\$0.1044	\$0.0997	\$0.1060	\$0.1121	\$0.1206
UW	UW-Milwaukee, Washington	\$0.1154	\$0.1158	\$0.1167	\$0.1121	\$0.1122	\$0.1059	\$0.1103	\$0.1184	\$0.1263	\$0.1431
UW	UW-Milwaukee, Waukesha	\$0.1071	\$0.1044	\$0.1029	\$0.1038	\$0.1037	\$0.1079	\$0.1122	\$0.1128	\$0.1235	\$0.1316
UW	UW-Oshkosh, Fond du Lac	\$0.1044	\$0.1100	\$0.0990	\$0.0992	\$0.1061	\$0.1001	\$0.1009	\$0.0994	\$0.1107	\$0.0626
UW	UW-Oshkosh, Fox Cities	\$0.1009	\$0.1062	\$0.1023	\$0.1055	\$0.1005	\$0.0908	\$0.0948	\$0.1232	\$0.1038	\$0.1189
UW	UW-Platteville, Baraboo	\$0.0970	\$0.1120	\$0.1092	\$0.1102	\$0.1073	\$0.1003	\$0.1120	\$0.1105	\$0.1242	\$0.1099
UW	UW-Platteville, Richland	\$0.1055	\$0.0927	\$0.0924	\$0.0853	\$0.0823	\$0.0809	\$0.0863	\$0.0971	\$0.1037	
UW	UW-Stevens Point, Marshfield	\$0.0819	\$0.0674	\$0.0767	\$0.0698	\$0.0846	\$0.0830	\$0.0816	\$0.0900	\$0.1044	\$0.0954
UW	UW-Stevens Point, Wausau	\$0.0844	\$0.0931	\$0.0920	\$0.0910	\$0.0923	\$0.0872	\$0.0863	\$0.0929	\$0.1056	\$0.1130
UW	UW-Whitewater, Rock	\$0.1044	\$0.1096	\$0.1169	\$0.1111	\$0.1109	\$0.1137	\$0.1293	\$0.1333	\$0.1272	\$0.1303
		\$0.0892	\$0.0938	\$0.0917	\$0.0924	\$0.0939	\$0.0930	\$0.0954	\$0.0994	\$0.1069	\$0.1124
	DHS	\$0.0818	\$0.0836	\$0.0819	\$0.0832	\$0.0828	\$0.0826	\$0.0864	\$0.0908	\$0.0985	\$0.1033
	DNR	\$0.1294	\$0.1293	\$0.1204	\$0.1316	\$0.1266	\$0.1285	\$0.1266	\$0.1346	\$0.1419	\$0.1535
	DOA	\$0.1062	\$0.1095	\$0.1043	\$0.1057	\$0.1068	\$0.1051	\$0.1069	\$0.1101	\$0.1200	\$0.1304
	DOC	\$0.0840	\$0.0857	\$0.0858	\$0.0859	\$0.0845	\$0.0838	\$0.0834	\$0.0872	\$0.0952	\$0.0977
	DOT	\$0.1182	\$0.1200	\$0.1175	\$0.1194	\$0.1131	\$0.1112	\$0.1189	\$0.1227	\$0.1301	\$0.1423
	DPI	\$0.0894	\$0.0921	\$0.0950	\$0.0949	\$0.1034	\$0.1005	\$0.0968	\$0.1023	\$0.1121	\$0.1187
	DVA	\$0.0693	\$0.0725	\$0.0701	\$0.0706	\$0.0690	\$0.0707	\$0.0708	\$0.0859	\$0.0932	\$0.0939
	UW	\$0.0890	\$0.0942	\$0.0922	\$0.0928	\$0.0950	\$0.0940	\$0.0969	\$0.1007	\$0.1077	\$0.1134
		\$0.0892	\$0.0938	\$0.0917	\$0.0924	\$0.0939	\$0.0930	\$0.0954	\$0.0994	\$0.1069	\$0.1124